

REV	DESCRIPTION	BY	DATE	-	----	--	--/--/--	-	----	--	--/--/--
-	----	--	--/--/--	-	----	--	--/--/--	-	----	--	--/--/--

T-bus
27.0 in



T-bus
27.0 in

T-bus
36.5 in

T-bus
19.5 in

T-bus
27.0 in


T-bus
27.0 in

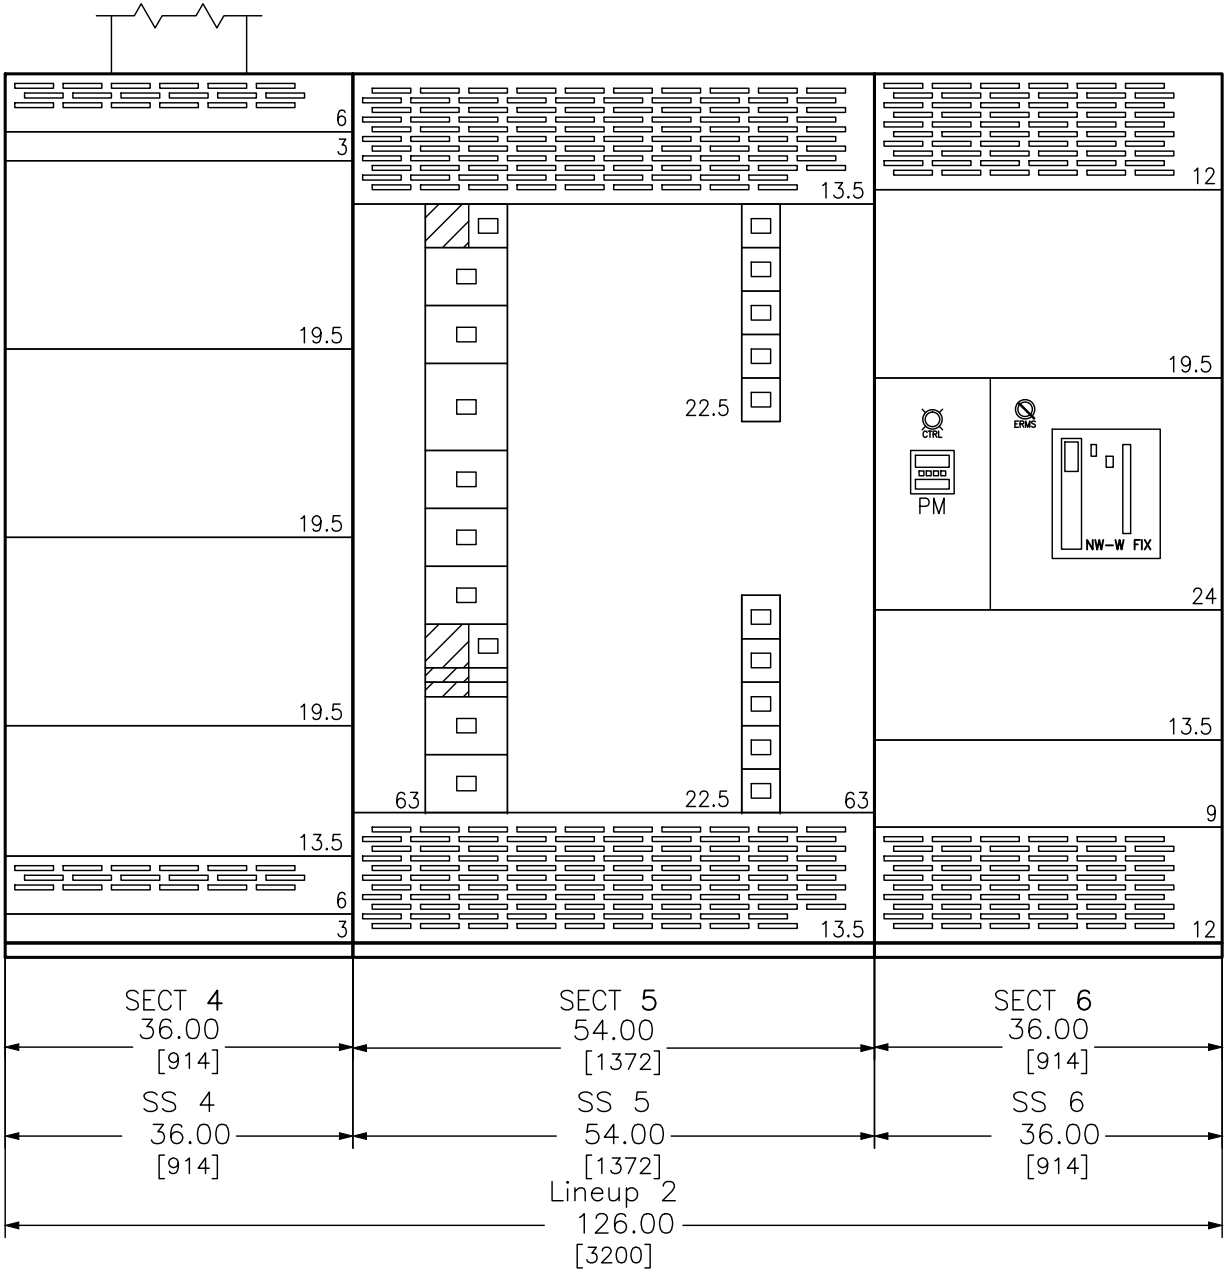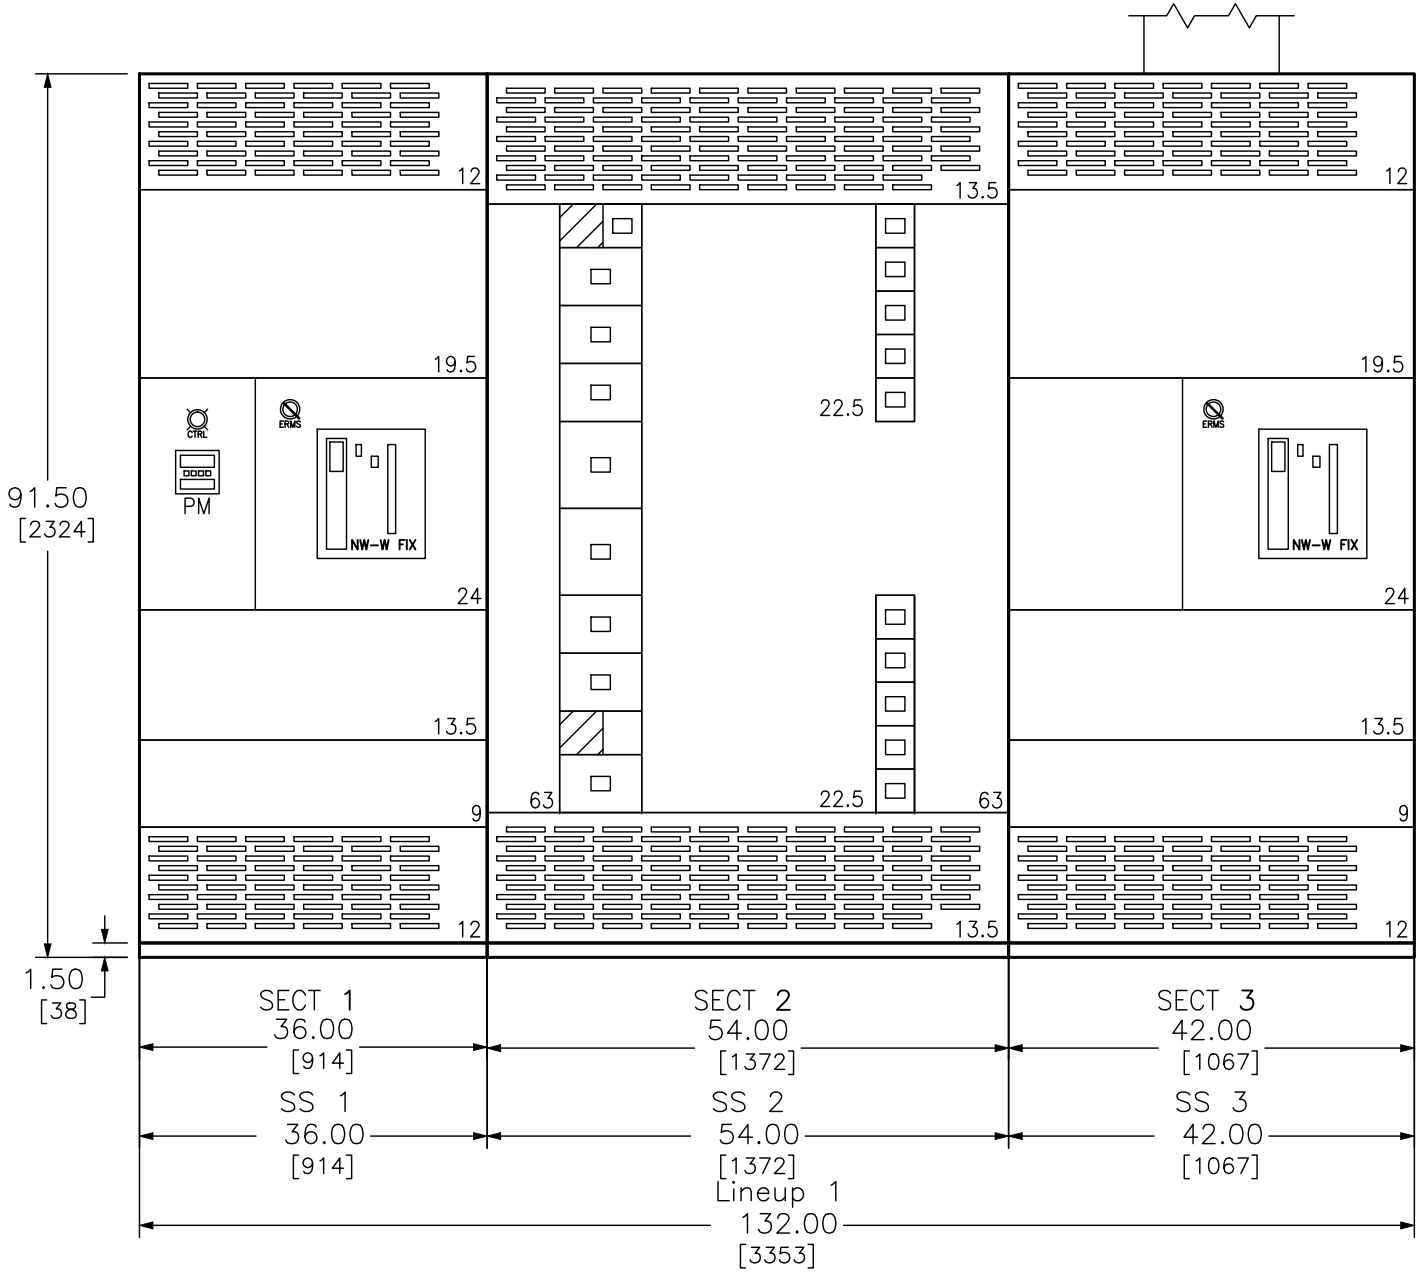


DUAL DIMENSIONS: INCHES
MILLIMETERS

JOB NAME:	Wayne Sanderson Farms Processing Plant Union Sprin	EQUIPMENT DESIGNATION:	SBA/SBB Bus
JOB LOCATION:		EQUIPMENT TYPE:	QED-2 Switchboard
DRAWN BY:	(Q2C)	DRAWING TYPE:	ELEVATION VIEW
ENGR:		 by Schneider Electric	
DATE:	January 11 2024		
DRAWING STATUS:	QUOTE	NOT FOR CONSTRUCTION	DWG# FQ-4635367-135592392-01
			PG 1 OF 3
			REV -


REV	DESCRIPTION	BY	DATE	-	----	--	--/--/--	-	----	--	--/--/--
-	----	--	--/--/--	-	----	--	--/--/--	-	----	--	--/--/--

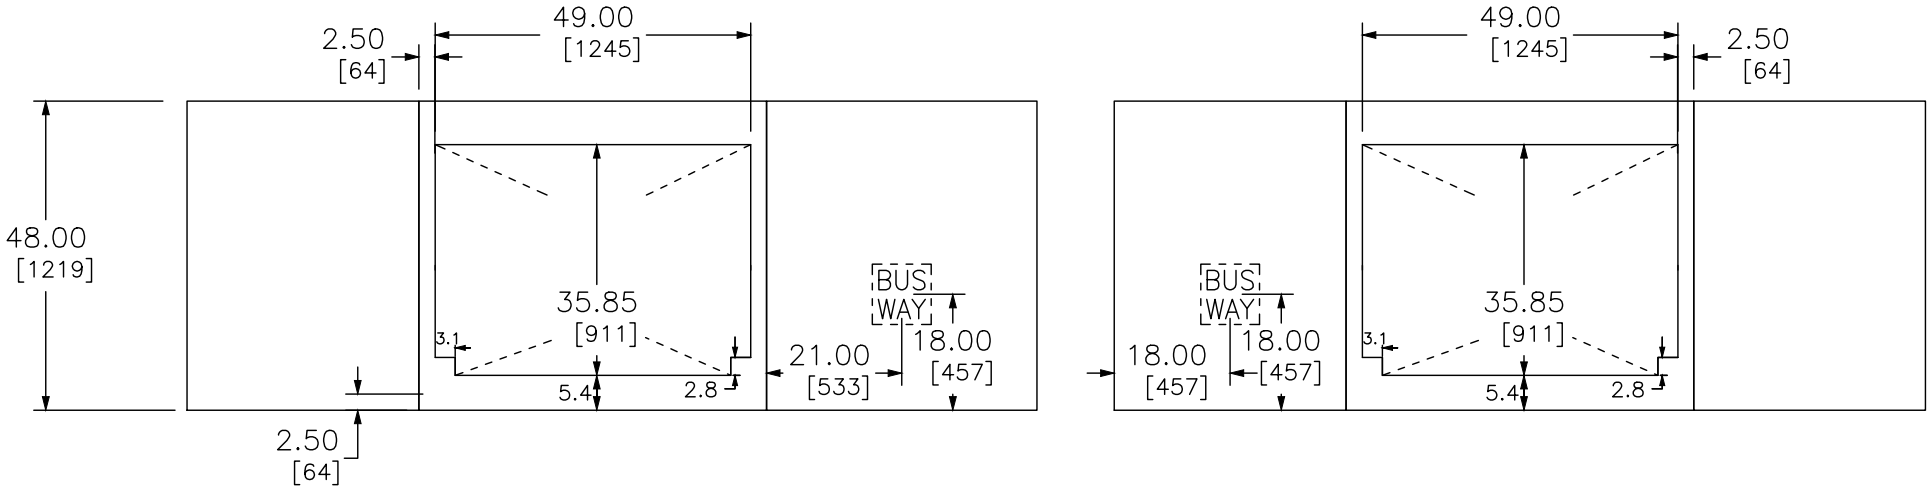

TOP VIEW — FRONT

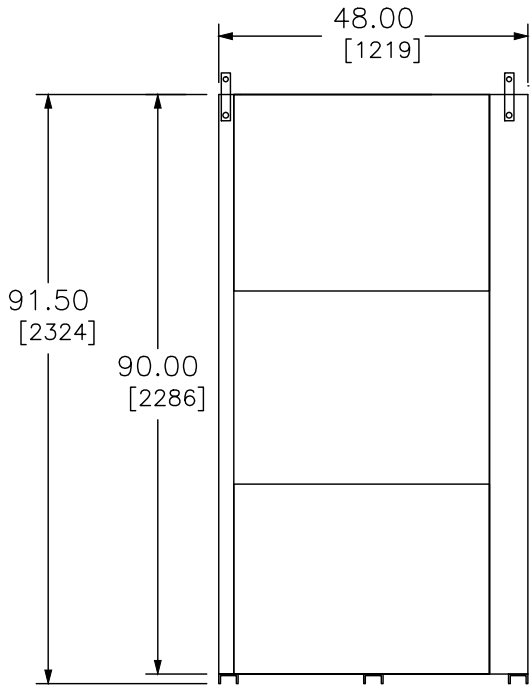

LEFT SIDE VIEW

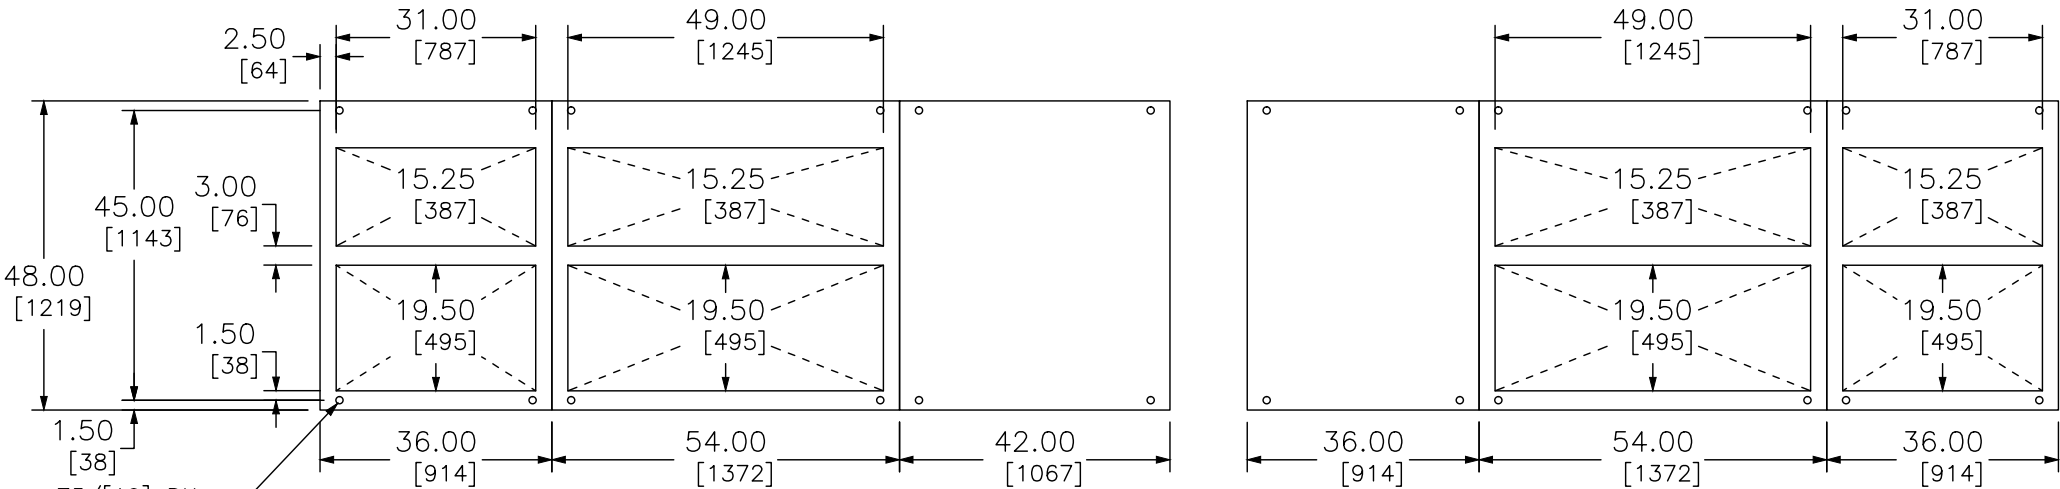

FLOOR PLAN — FRONT

NOTE: ALL DEVICES REQUIRING DRILLING OR INSERTION IN MOUNTING PAD SUCH AS CONDUIT, ANCHORING STUDS, SLEEVE INSERTS, ETC. SHOULD BE INSTALLED BEFORE SETTING EQUIPMENT IN PLACE.

DUAL DIMENSIONS: INCHES
MILLIMETERS

JOB NAME:	Wayne Sanderson Farms Processing Plant Union Sprin	EQUIPMENT DESIGNATION:	SBA/SBB Bus
JOB LOCATION:		EQUIPMENT TYPE:	QED-2 Switchboard
DRAWN BY:	(Q2C)	DRAWING TYPE:	SIDE, TOP VIEW & FLOOR PLAN
ENGR:			
DATE:	January 11 2024		
DRAWING STATUS:	QUOTE	NOT FOR CONSTRUCTION	DWG# FQ-4635367-135592392-01
			PG 2 OF 3
			REV -

REV	DESCRIPTION	BY	DATE	-	----	--	--/--/--	-	----	--	--/--/--
-	----	--	--/--/--	-	----	--	--/--/--	-	----	--	--/--/--

SWITCHBOARD GENERAL NOTES

PRODUCT DESCRIPTION & RATINGS

Power System Data

480Y/277V 3Ph 4W 60Hz / 3 Phase Wye
Solidly Grounded
System Short Circuit Current Rating: 100kA RMS
Incoming Section 1 Cable Through the Bottom Left of Lineup
Incoming Section 4 Busway Through the Top Not Required
Incoming Section 6 Cable Through the Bottom Right of Lineup

Bus System Data

3000A Silver Plated Copper Main Bus
(4) .25x2.00 IN/6x51 mm Cu Bus Bar Per Phase/Neutral
(1) .25x1.75 IN/6x44 mm Cu Ground Bus

Enclosure Data

Type 1 Free Standing
Exterior Paint Color: ANSI 49
Front Accessibility Only Required
Handling: Rollers & Lifting Assemblies

Estimated Shipping Weight

Shipping Split 1 1160.00 lbs / 526.18 kgs
Shipping Split 2 1430.00 lbs / 648.65 kgs
Shipping Split 3 1327.00 lbs / 601.93 kgs
Shipping Split 4 755.00 lbs / 342.47 kgs
Shipping Split 5 1395.00 lbs / 632.77 kgs
Shipping Split 6 1160.00 lbs / 526.18 kgs
Complete Lineup 7227.00 lbs / 3278.17 kgs

Code Standards

U.L. Deadfront and suitable for use as Service Entrance
when not more than six (6) disconnecting means are provided.

Rating Nameplates

ST1– Service Entrance – Section Bus 3000A
ST2– Deadfront – Section Bus 3000A
ST3– Deadfront – Section Bus 3000A
ST4– Deadfront – Section Bus 3000A
ST5– Deadfront – Section Bus 3000A
ST6– Service Entrance – Section Bus 3000A

PRODUCT INFORMATION

Wiring

All wiring to be Machine Tool Wire type

Instruction Bulletins

Reference 80043–055 For Handling, Installation,
Anchoring, Inspection And Maintenance Information

Product Accessories/Options

24V Trip Unit Display Power
Locally Mounted ERMS Switch


APPROVED FOR RELEASE & PRODUCTION

DOLEAC ELECTRIC COMPANY, INC.

D. L. DOLEAC, 01/25/2024

JOB NAME:	Wayne Sanderson Farms Processing Plant Union Sprin	EQUIPMENT DESIGNATION:	SBA/SBB Bus
JOB LOCATION:		EQUIPMENT TYPE:	QED–2 Switchboard
DRAWN BY:	(Q2C)	DRAWING TYPE:	GENERAL NOTES
ENGR:		SQUARE D by Schneider Electric	
DATE:	January 11 2024		
DRAWING STATUS:	QUOTE	NOT FOR CONSTRUCTION	DWG# FQ–4635367–135592392–01
			PG 3 OF 3
			REV –

REV	DESCRIPTION	BY	DATE										
-	----	--	--/--/--	-	----	--	--/--/--	-	----	--	--/--/--	-	----

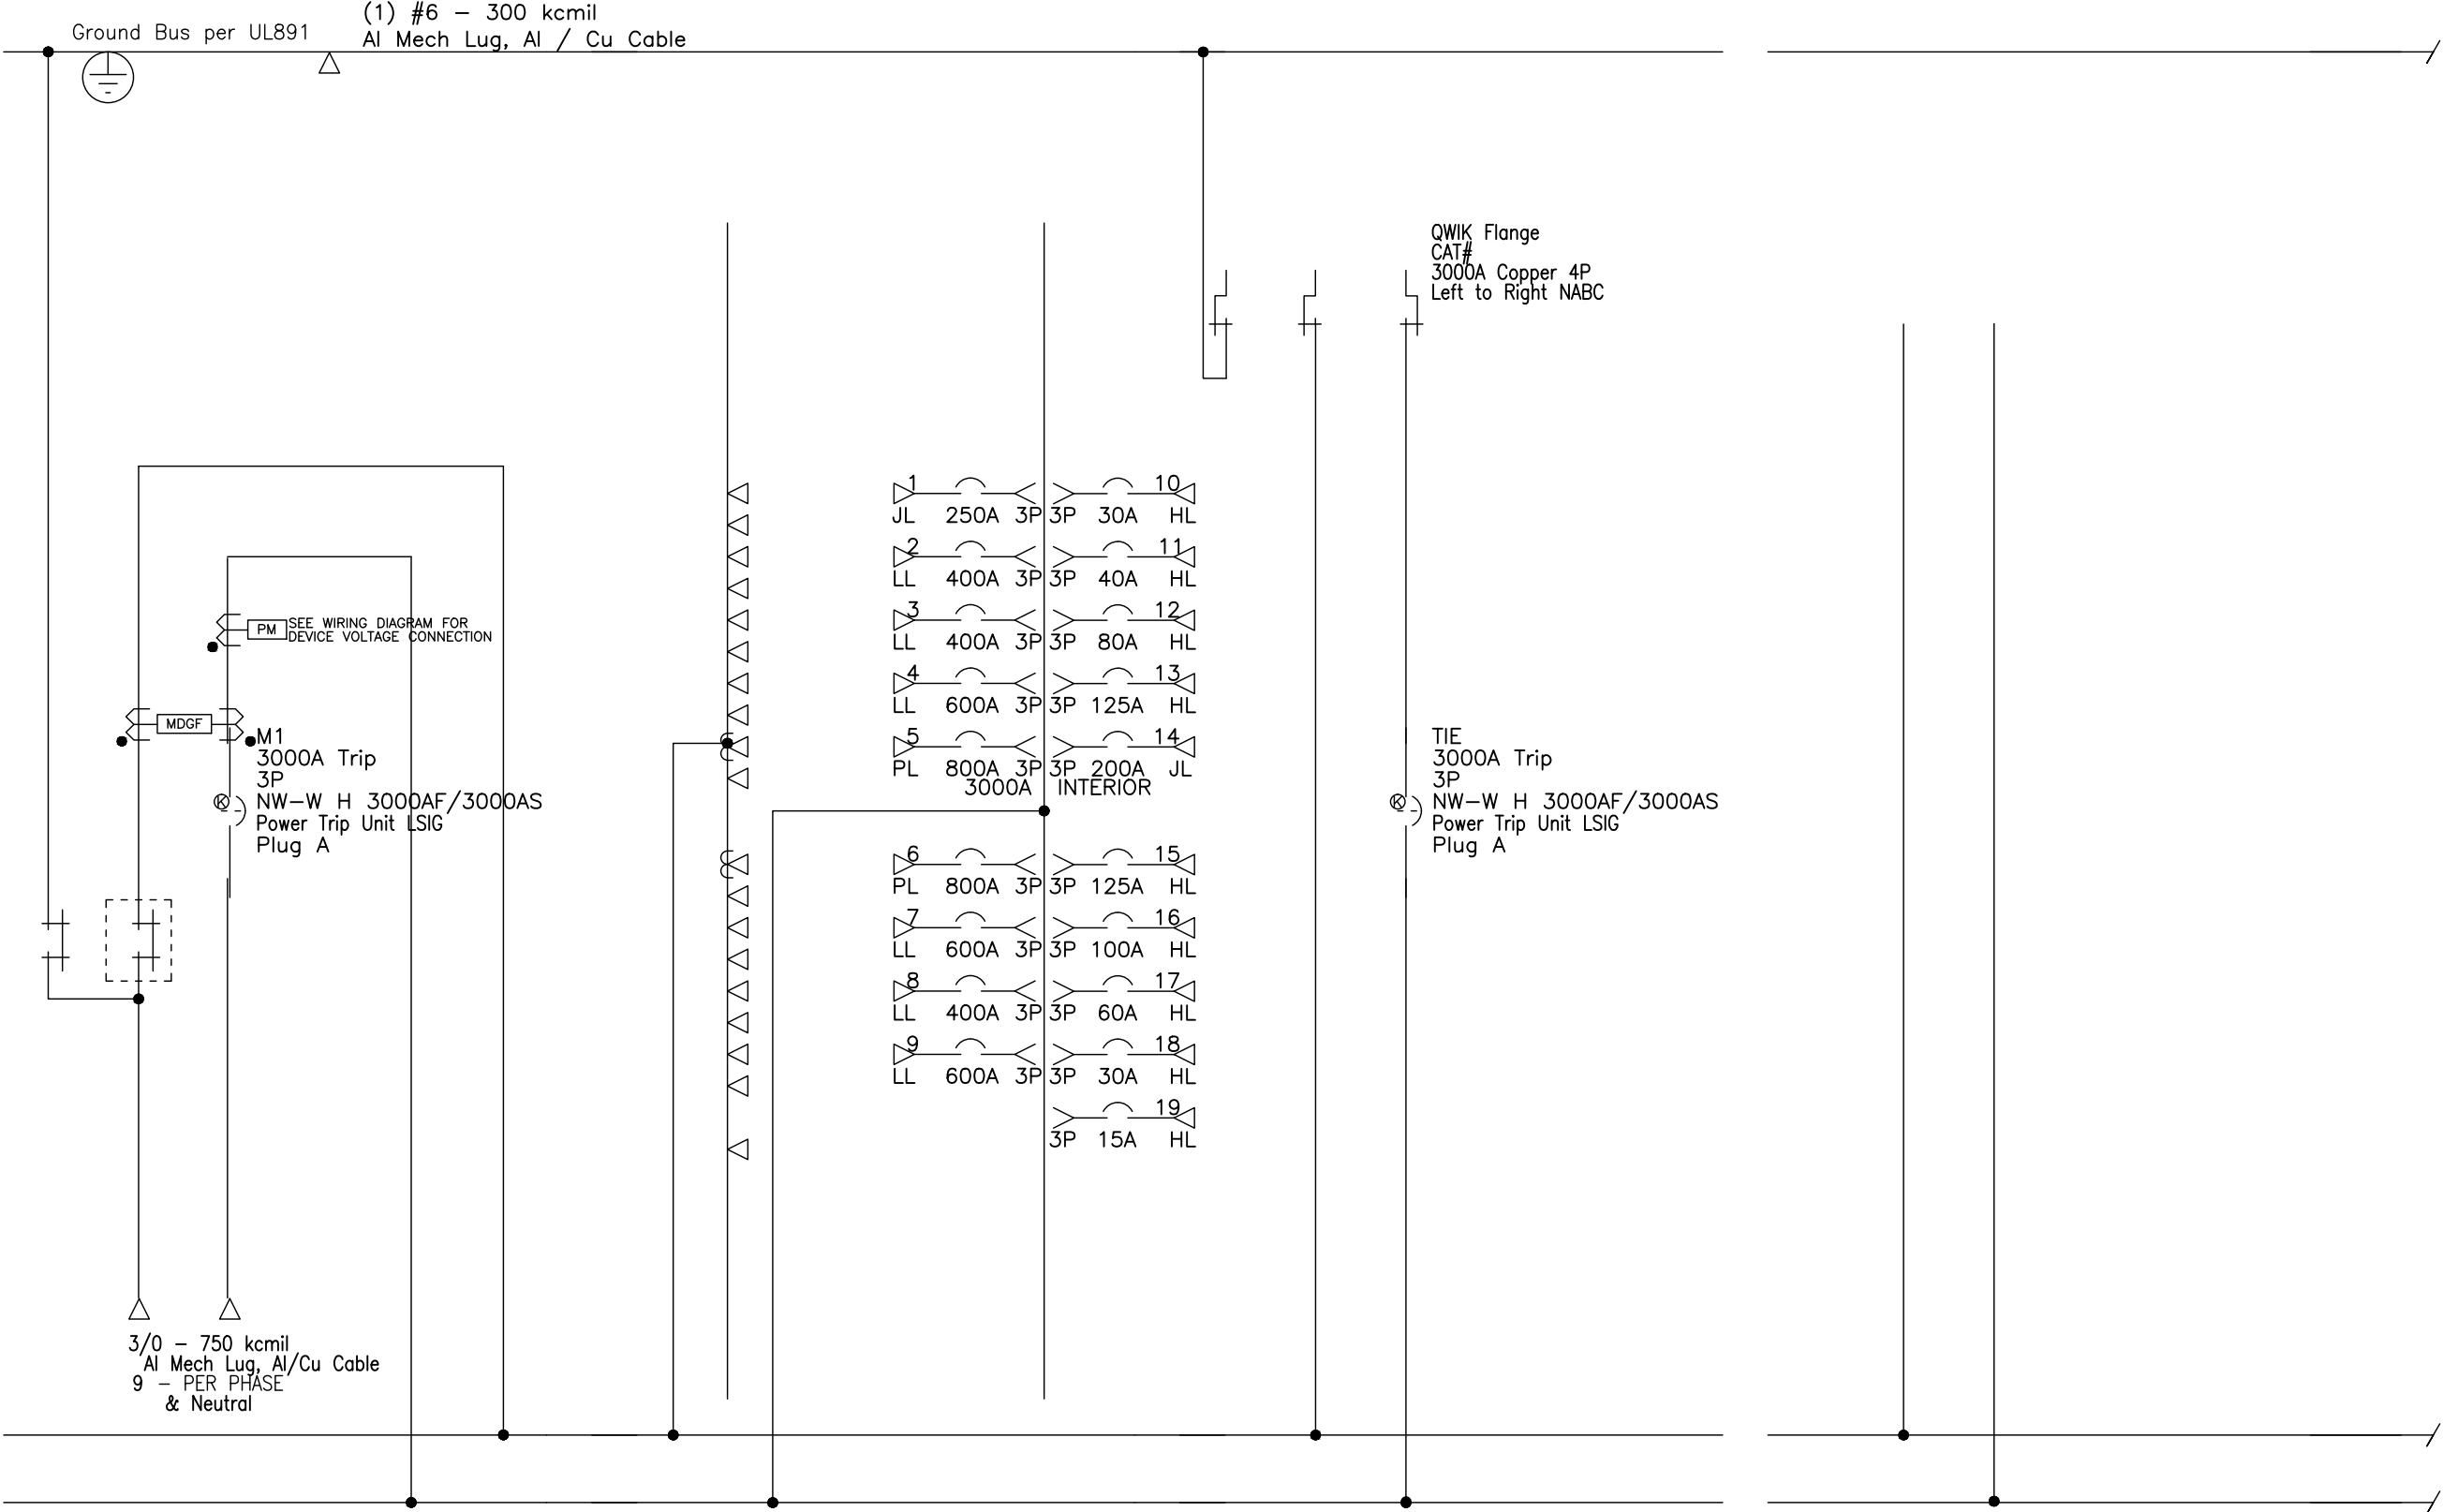

SECTION 1


SECTION 2

SECTION 3

SECTION 4

JOB NAME:	Wayne Sanderson Farms Processing Plant Union Sprin	EQUIPMENT DESIGNATION:	SBA/SBB Bus
JOB LOCATION:		EQUIPMENT TYPE:	QED-2 Switchboard
DRAWN BY:	(Q2C)	DRAWING TYPE:	ONE LINE
ENGR:		 by Schneider Electric	
DATE:	January 11 2024		
DRAWING STATUS:	QUOTE	DWG#	OQ-4635367-135592392-01
		PG	1 OF 4
		REV	-

REV	DESCRIPTION	BY	DATE										
-	----	--	--/--/--	-	----	--	--/--/--	-	----	--	--/--/--	-	----

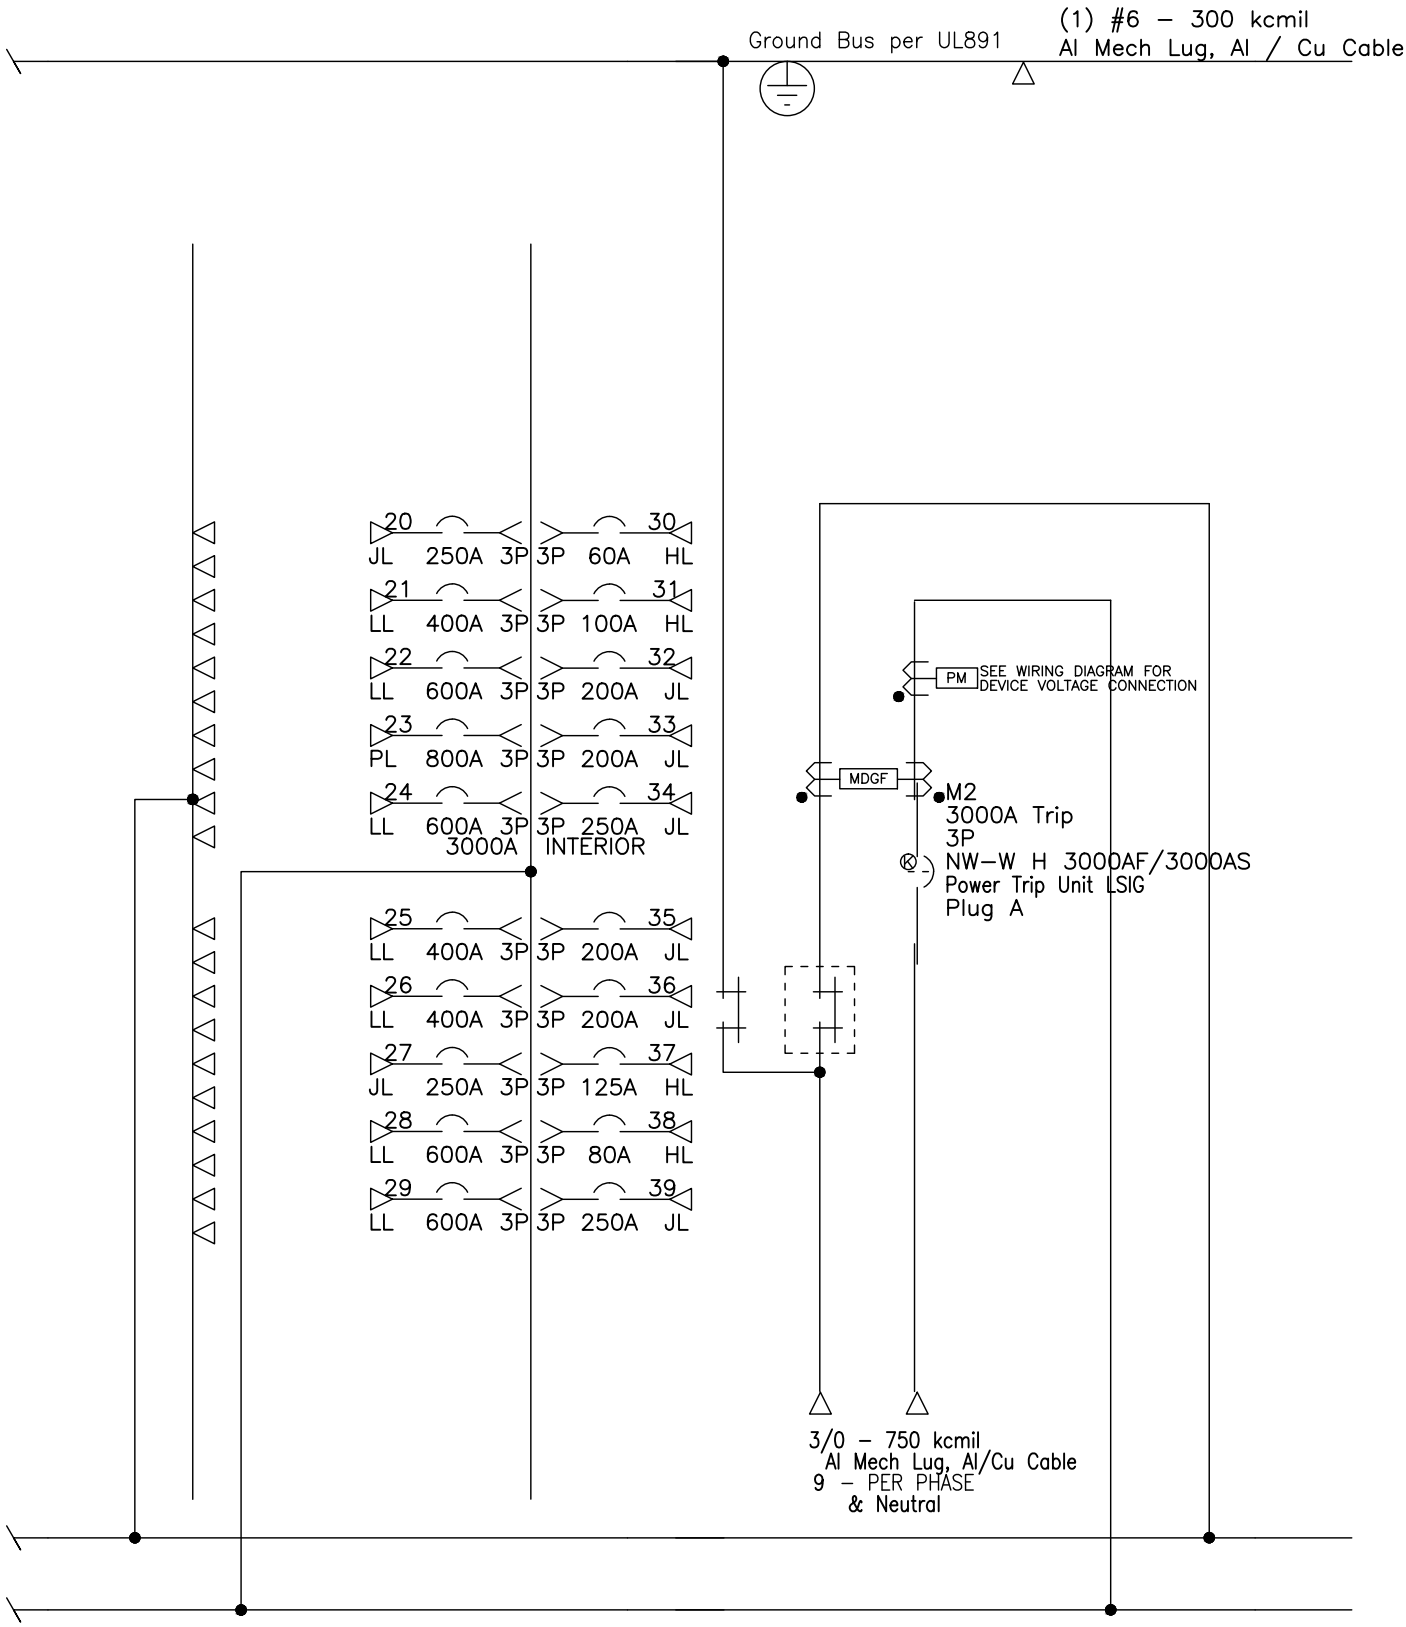

SECTION 5

SECTION 6

JOB NAME:	Wayne Sanderson Farms Processing Plant Union Sprin	EQUIPMENT DESIGNATION:	SBA/SBB Bus
JOB LOCATION:		EQUIPMENT TYPE:	QED-2 Switchboard
DRAWN BY:	(Q2C)	DRAWING TYPE:	ONE LINE
ENGR:		 by Schneider Electric	
DATE:	January 11 2024		
DRAWING STATUS:	QUOTE	DWG#	OQ-4635367-135592392-01
		PG	2 OF 4
		REV	-

REV	DESCRIPTION	BY	DATE	-	----	--	--/--/--	-	----	--	--/--/--
-	----	--	--/--/--	-	----	--	--/--/--	-	----	--	--/--/--

POWER STYLE QED-2 SWITCHBOARD

SECT NO	CKT NO	IMD /GMD CONFIG	DEVICE/FRAME RATING	TRIP AMP	FUSE/ TRIP	#P	DESIGNATION	N/P	LUG/WIRE INFORMATION				ACCESSORIES / NOTES
									QTY	PHASE WIRE RANGE	QTY	NEUT WIRE RANGE	
1	M1	FIX	NW-W H 3000AF/3000AS Plug A	3000A	P-LSIG	3P		No	9	3/0 – 750 kcmil	9	3/0 – 750 kcmil	SDE1,PFR,CTU,MNA,OF4,UC2,MX1,KEY PM5K,ERMS,TU
2	1	4.5 in	JL	250A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
2	2	6 in	LL 400A	400A	S-LI	3P		No	1	500 kcmil	1	500 kcmil	
2	3	6 in	LL400A 100%	400A	S-LI	3P		No	2	3/0 – 250 kcmil	2	3/0 – 250 kcmil	
2	4	6 in	LL 600A	600A	S-LI	3P		No	2	4/0 – 500kcmil	2	4/0 – 500kcmil	
2	5	9 in	PL 800A Plug A	800A	P-LSIG	3P		No	3	3/0 – 500 kcmil	3	3/0 – 500kcmil	GF TU
2	6	9 in	PL 800A Plug A	800A	P-LSIG	3P		No	3	3/0 – 500 kcmil	3	3/0 – 500kcmil	GF TU
2	7	6 in	LL 600A	600A	S-LI	3P		No	2	4/0 – 500kcmil	2	4/0 – 500kcmil	
2	8	6 in	LL 400A	400A	S-LI	3P		No	1	500 kcmil	1	500 kcmil	
2	9	6 in	LL 600A	600A	S-LI	3P		No	2	4/0 – 500kcmil	2	4/0 – 500kcmil	
2	10	4.5 in	HL	30A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
2	11	4.5 in	HL	40A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
2	12	4.5 in	HL	80A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
2	13	4.5 in	HL	125A	–	3P		No	1	#6 – 3/0 AWG	1	#6 – 3/0 AWG	
2	14	4.5 in	JL	200A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
2	15	4.5 in	HL	125A	–	3P		No	1	#6 – 3/0 AWG	1	#6 – 3/0 AWG	
2	16	4.5 in	HL	100A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
2	17	4.5 in	HL	60A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
2	18	4.5 in	HL	30A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
2	19	4.5 in	HL	15A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
3	TIE	FIX	NW-W H 3000AF/3000AS Plug A	3000A	P-LSIG	3P		No	–	–	–	–	SDE1,OF4,UC2,KEY ERMS,TU
5	20	4.5 in	JL	250A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
5	21	6 in	LL400A 100%	400A	S-LI	3P		No	2	3/0 – 250 kcmil	2	3/0 – 250 kcmil	
5	22	6 in	LL 600A	600A	S-LI	3P		No	2	4/0 – 500kcmil	2	4/0 – 500kcmil	
5	23	9 in	PL 800A Plug A	800A	S-LI	3P		No	3	3/0 – 500 kcmil	3	3/0 – 500kcmil	
5	24	6 in	LL 600A	600A	S-LI	3P		No	2	4/0 – 500kcmil	2	4/0 – 500kcmil	

LEGEND	
CTU	Capacitor Trip Unit
ERMS	Energy Reduction Maintenance SW
GF	Ground Fault
KEY	Key Interlock
MNA	Under Voltage Trip Adj Time Delay
MX1	Shunt Trip
OF4	4 Form C Breaker Aux Contacts
PFR	Phase Failure Relay
PM5K	Power Meter PM55XX
SDE1	Over Current Trip Switch
TU	24V Trip Unit Display Power
UC2	Modified Differential Ground Fault

JOB NAME:	Wayne Sanderson Farms Processing Plant Union Sprin	EQUIPMENT DESIGNATION:	SBA/SBB Bus
JOB LOCATION:		EQUIPMENT TYPE:	QED-2 Switchboard
DRAWN BY:	(Q2C)	DRAWING TYPE:	SCHEDULE
ENGR:		SQUARE D[®] by Schneider Electric	
DATE:	January 11 2024		
DRAWING STATUS:	QUOTE	DWG#	OQ-4635367-135592392-01
		PG	3 OF 4
		REV	–

REV	DESCRIPTION	BY	DATE	-	----	--	--/--/--	-	----	--	--/--/--	-	----
-	----	--	--/--/--	-	----	--	--/--/--	-	----	--	--/--/--	-	----

POWER STYLE QED-2 SWITCHBOARD

SECT NO	CKT NO	IMD /GMD CONFIG	DEVICE/FRAME RATING	TRIP AMP	FUSE/ TRIP	#P	DESIGNATION	N/P	LUG/WIRE INFORMATION				ACCESSORIES / NOTES
									QTY	PHASE WIRE RANGE	QTY	NEUT WIRE RANGE	
5	25	6 in	LL 400A	400A	S-LI	3P		No	2	3/0 – 250 kcmil	2	3/0 – 250 kcmil	
5	26	6 in	LL400A 100%	400A	S-LI	3P		No	2	3/0 – 250 kcmil	2	3/0 – 250 kcmil	
5	27	4.5 in	JL	250A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
5	28	6 in	LL 600A	600A	S-LI	3P		No	2	4/0 – 500kcmil	2	4/0 – 500kcmil	
5	29	6 in	LL 600A	600A	S-LI	3P		No	2	4/0 – 500kcmil	2	4/0 – 500kcmil	
5	30	4.5 in	HL	60A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
5	31	4.5 in	HL	100A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
5	32	4.5 in	JL	200A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
5	33	4.5 in	JL	200A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
5	34	4.5 in	JL	250A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
5	35	4.5 in	JL	200A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
5	36	4.5 in	JL	200A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
5	37	4.5 in	HL	125A	–	3P		No	1	#6 – 3/0 AWG	1	#6 – 3/0 AWG	
5	38	4.5 in	HL	80A	–	3P		No	1	#14 – 1/0 AWG	1	#14 – 1/0 AWG	
5	39	4.5 in	JL	250A	–	3P		No	1	3/0 – 350 kcmil	1	3/0 – 350kcmil	
6	M2	FIX	NW-W H 3000AF/3000AS Plug A	3000A	P-LSIG	3P		No	9	3/0 – 750 kcmil	9	3/0 – 750 kcmil	SDE1,PFR,CTU,MNA,OF4,UC2,MX1,KEY PM5K,ERMS,TU

JOB NAME:	Wayne Sanderson Farms Processing Plant Union Sprin	EQUIPMENT DESIGNATION:	SBA/SBB Bus
JOB LOCATION:		EQUIPMENT TYPE:	QED-2 Switchboard
DRAWN BY:	(Q2C)	DRAWING TYPE:	SCHEDULE
ENGR:		SQUARE D[™] by Schneider Electric	
DATE:	January 11 2024		
DRAWING STATUS:	QUOTE	DWG#	OQ-4635367-135592392-01
		PG	4 OF 4
		REV	–