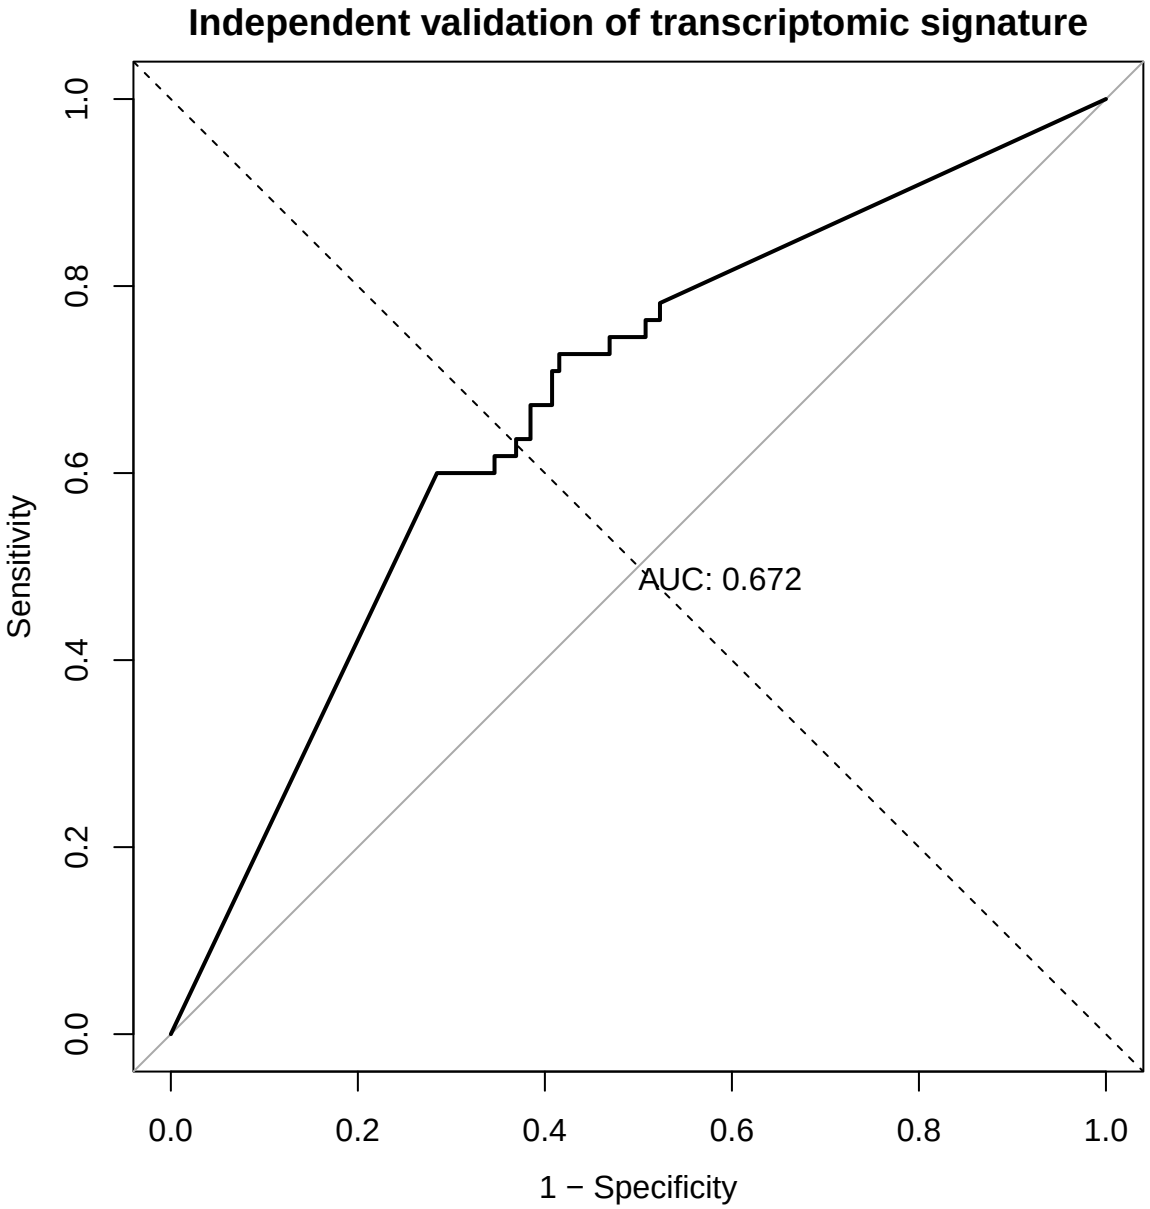
Independent validation of transcriptomic signature
Sensitivity
1 − Specificity
0.0
0.2
0.4
0.6
0.8
1.0
AUC: 0.672