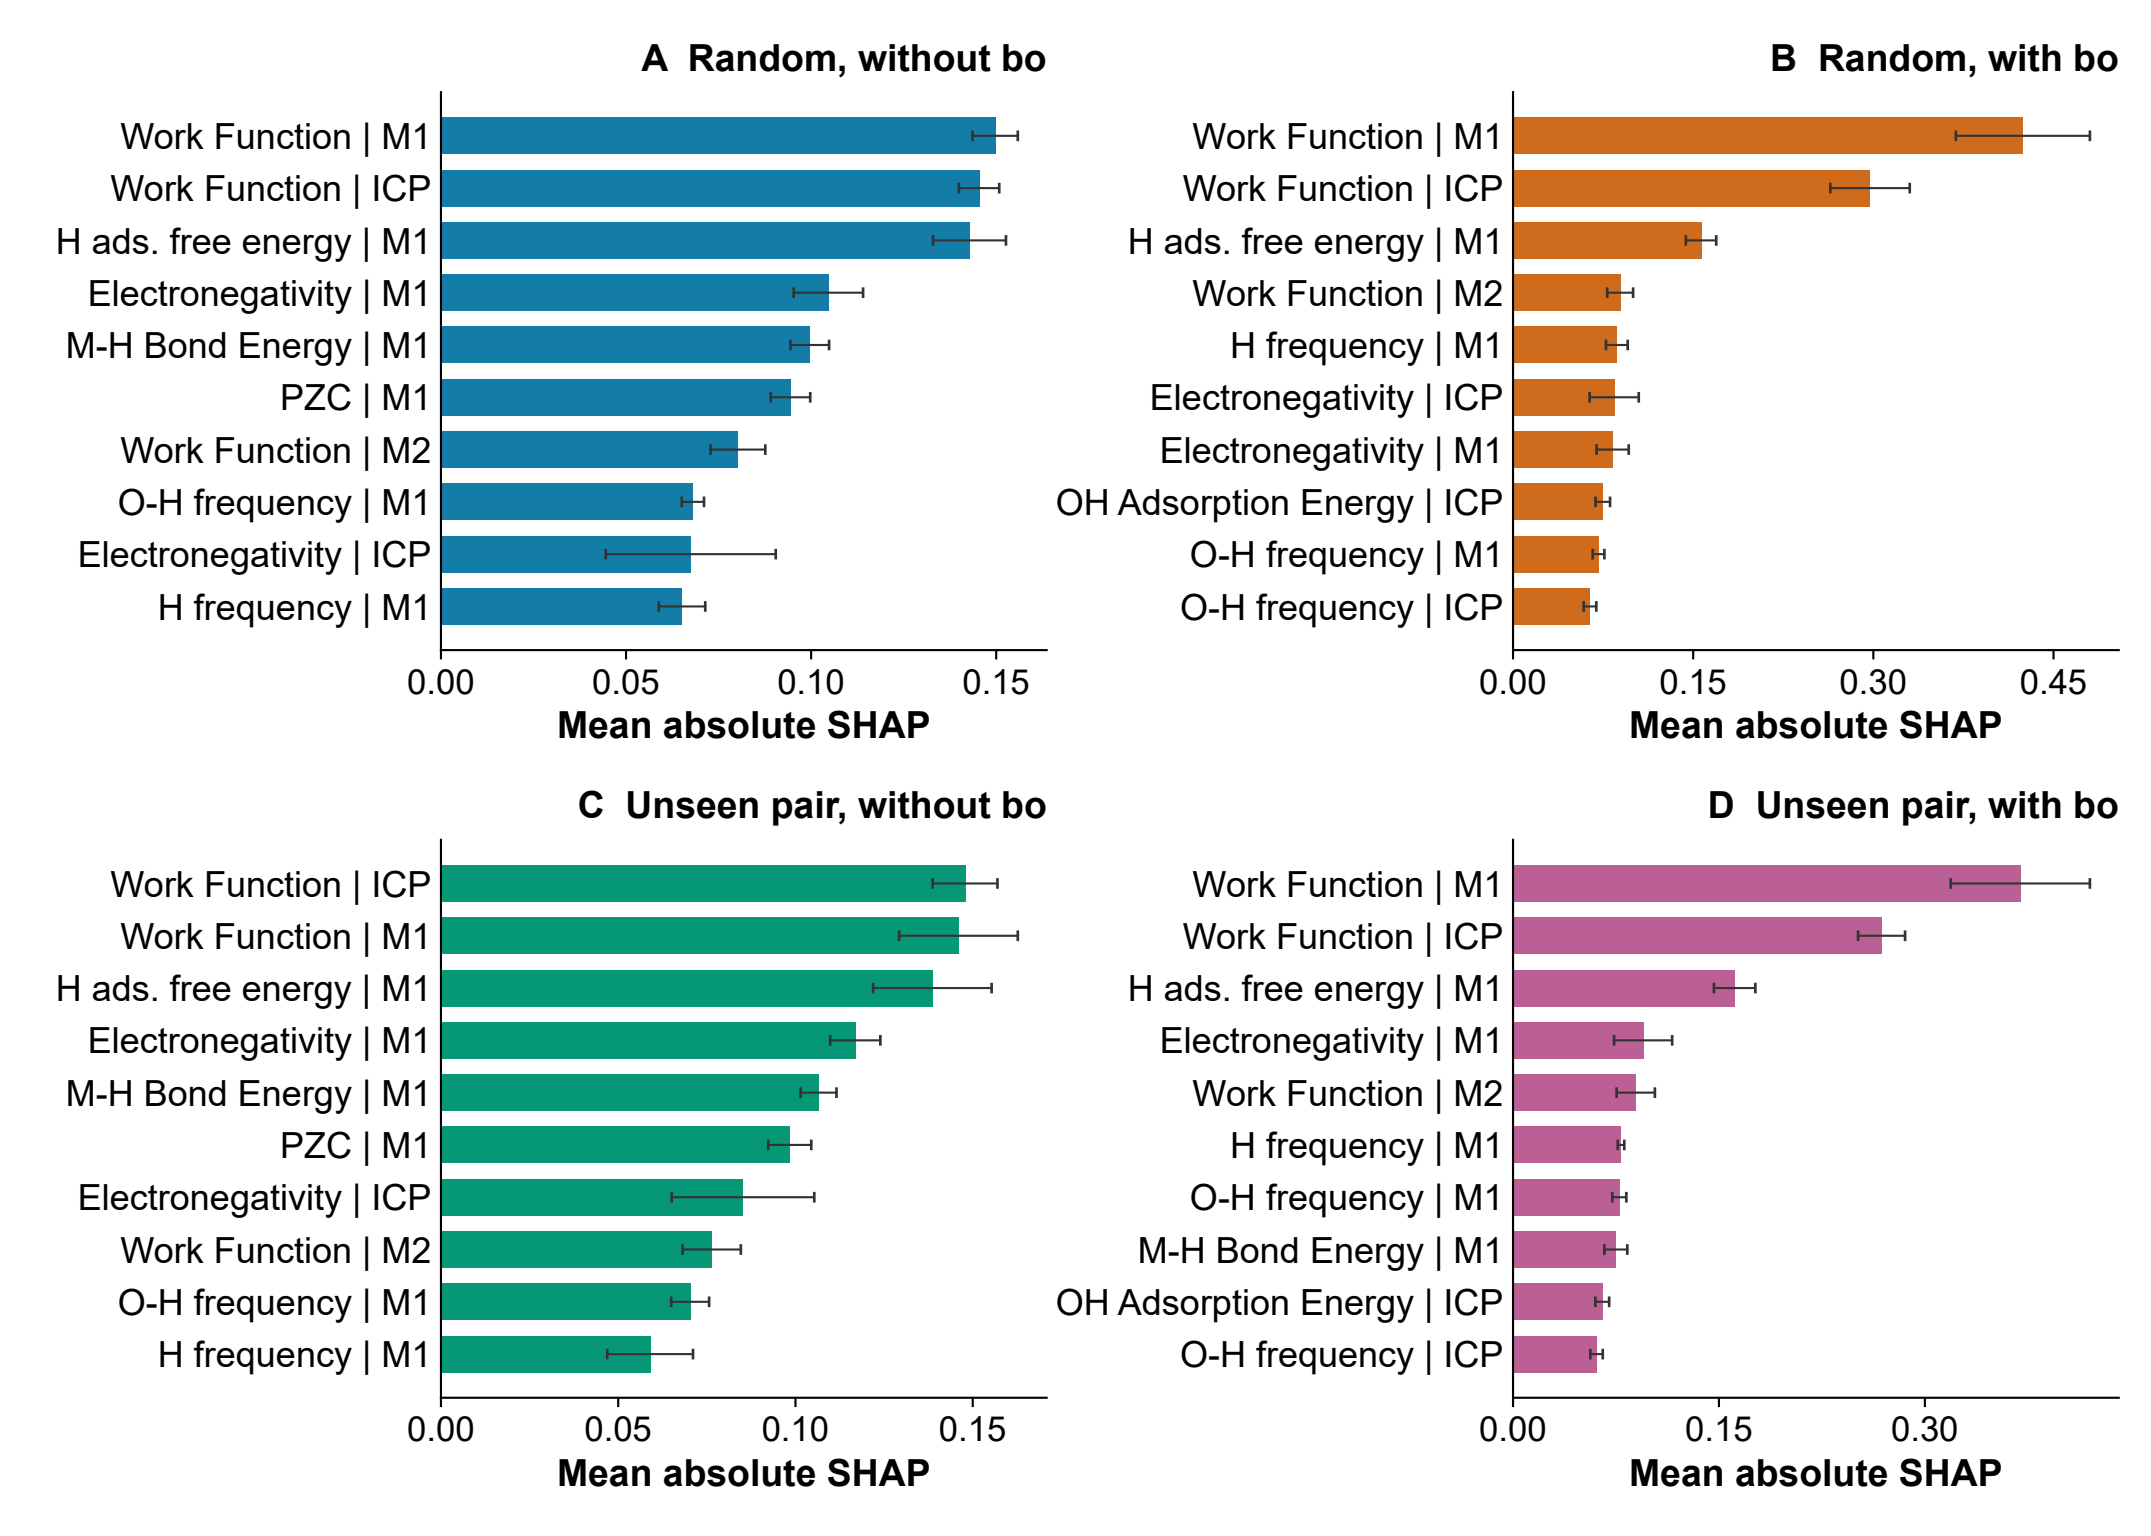
A Random, without bo
Work Function | M1
Work Function | ICP
H ads. free energy | M1
Electronegativity | M1
M-H Bond Energy | M1
PZC | M1
Work Function | M2
O-H frequency | M1
Electronegativity | ICP
H frequency | M1
0.00
0.05
0.10
0.15
Mean absolute SHAP
B Random, with bo
Work Function | M1
Work Function | ICP
H ads. free energy | M1
Work Function | M2
H frequency | M1
Electronegativity | ICP
Electronegativity | M1
OH Adsorption Energy | ICP
O-H frequency | M1
O-H frequency | ICP
0.00
0.15
0.30
0.45
Mean absolute SHAP
C Unseen pair, without bo
Work Function | ICP
Work Function | M1
H ads. free energy | M1
Electronegativity | M1
M-H Bond Energy | M1
PZC | M1
Electronegativity | ICP
Work Function | M2
O-H frequency | M1
H frequency | M1
0.00
0.05
0.10
0.15
Mean absolute SHAP
D Unseen pair, with bo
Work Function | M1
Work Function | ICP
H ads. free energy | M1
Electronegativity | M1
Work Function | M2
H frequency | M1
O-H frequency | M1
M-H Bond Energy | M1
OH Adsorption Energy | ICP
O-H frequency | ICP
0.00
0.15
0.30
Mean absolute SHAP