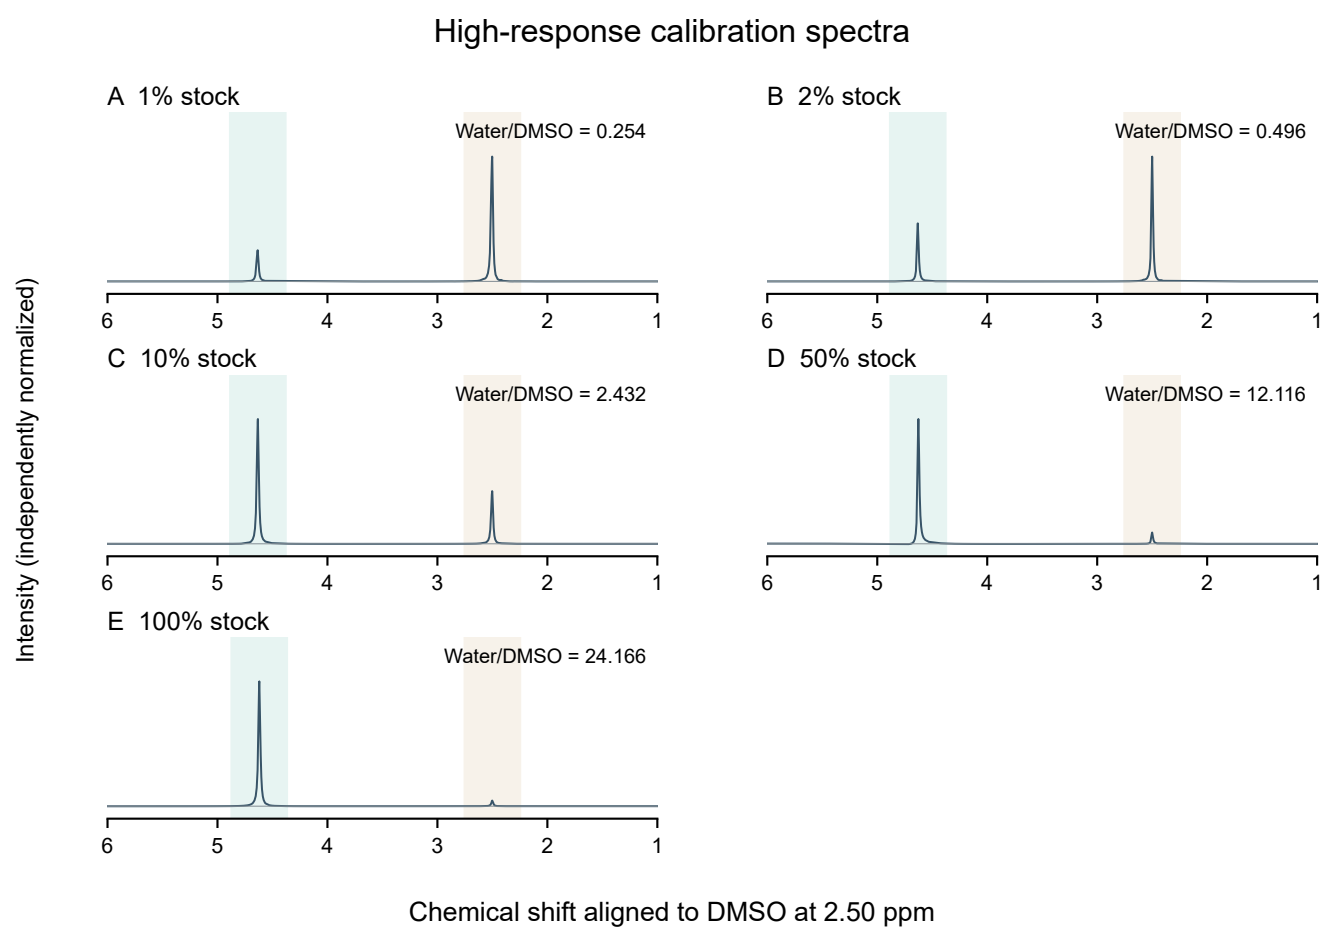
High-response calibration spectra
A 1% stock
Water/DMSO = 0.254
B 2% stock
Water/DMSO = 0.496
C 10% stock
Water/DMSO = 2.432
D 50% stock
Water/DMSO = 12.116
E 100% stock
Water/DMSO = 24.166
6
5
4
3
2
1
Intensity (independently normalized)
Chemical shift aligned to DMSO at 2.50 ppm