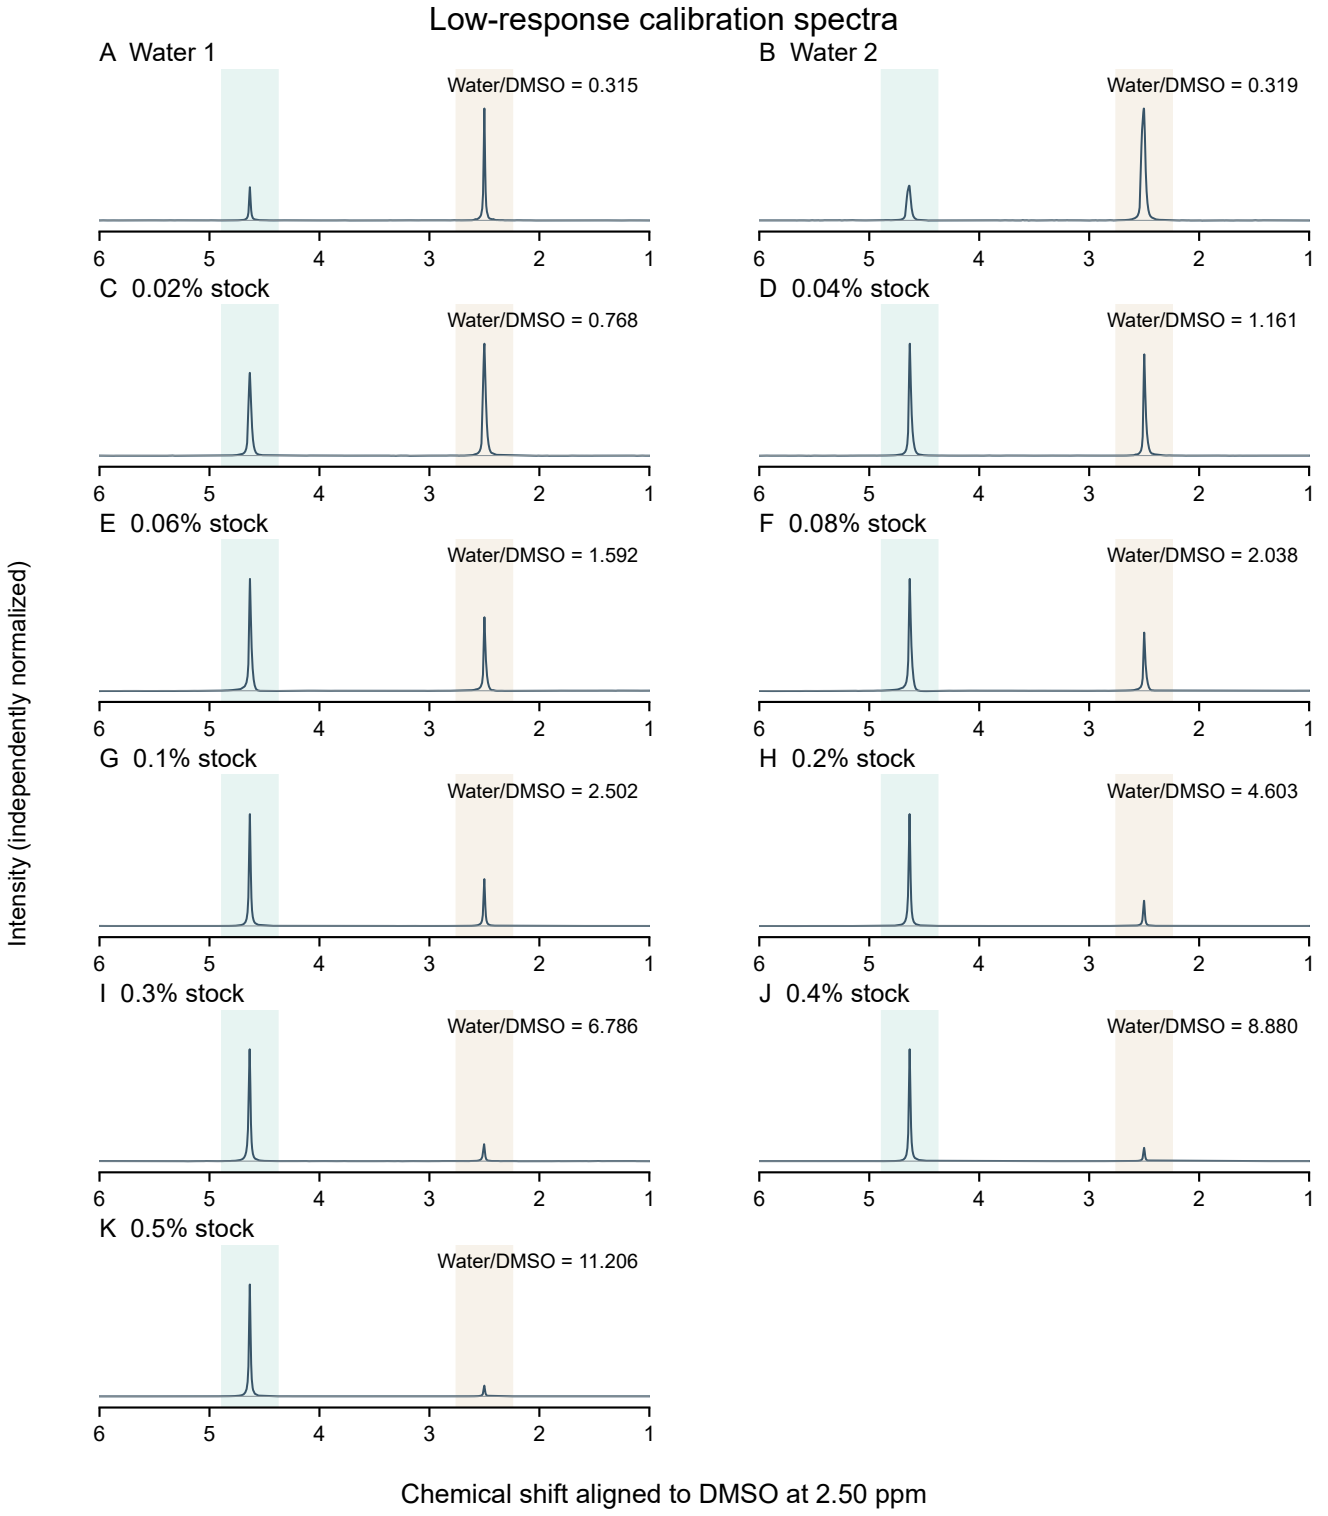
Low-response calibration spectra
A Water 1
Water/DMSO = 0.315
B Water 2
Water/DMSO = 0.319
C 0.02% stock
Water/DMSO = 0.768
D 0.04% stock
Water/DMSO = 1.161
E 0.06% stock
Water/DMSO = 1.592
F 0.08% stock
Water/DMSO = 2.038
G 0.1% stock
Water/DMSO = 2.502
H 0.2% stock
Water/DMSO = 4.603
I 0.3% stock
Water/DMSO = 6.786
J 0.4% stock
Water/DMSO = 8.880
K 0.5% stock
Water/DMSO = 11.206
6 5 4 3 2 1
Intensity (independently normalized)
Chemical shift aligned to DMSO at 2.50 ppm