




Base Station

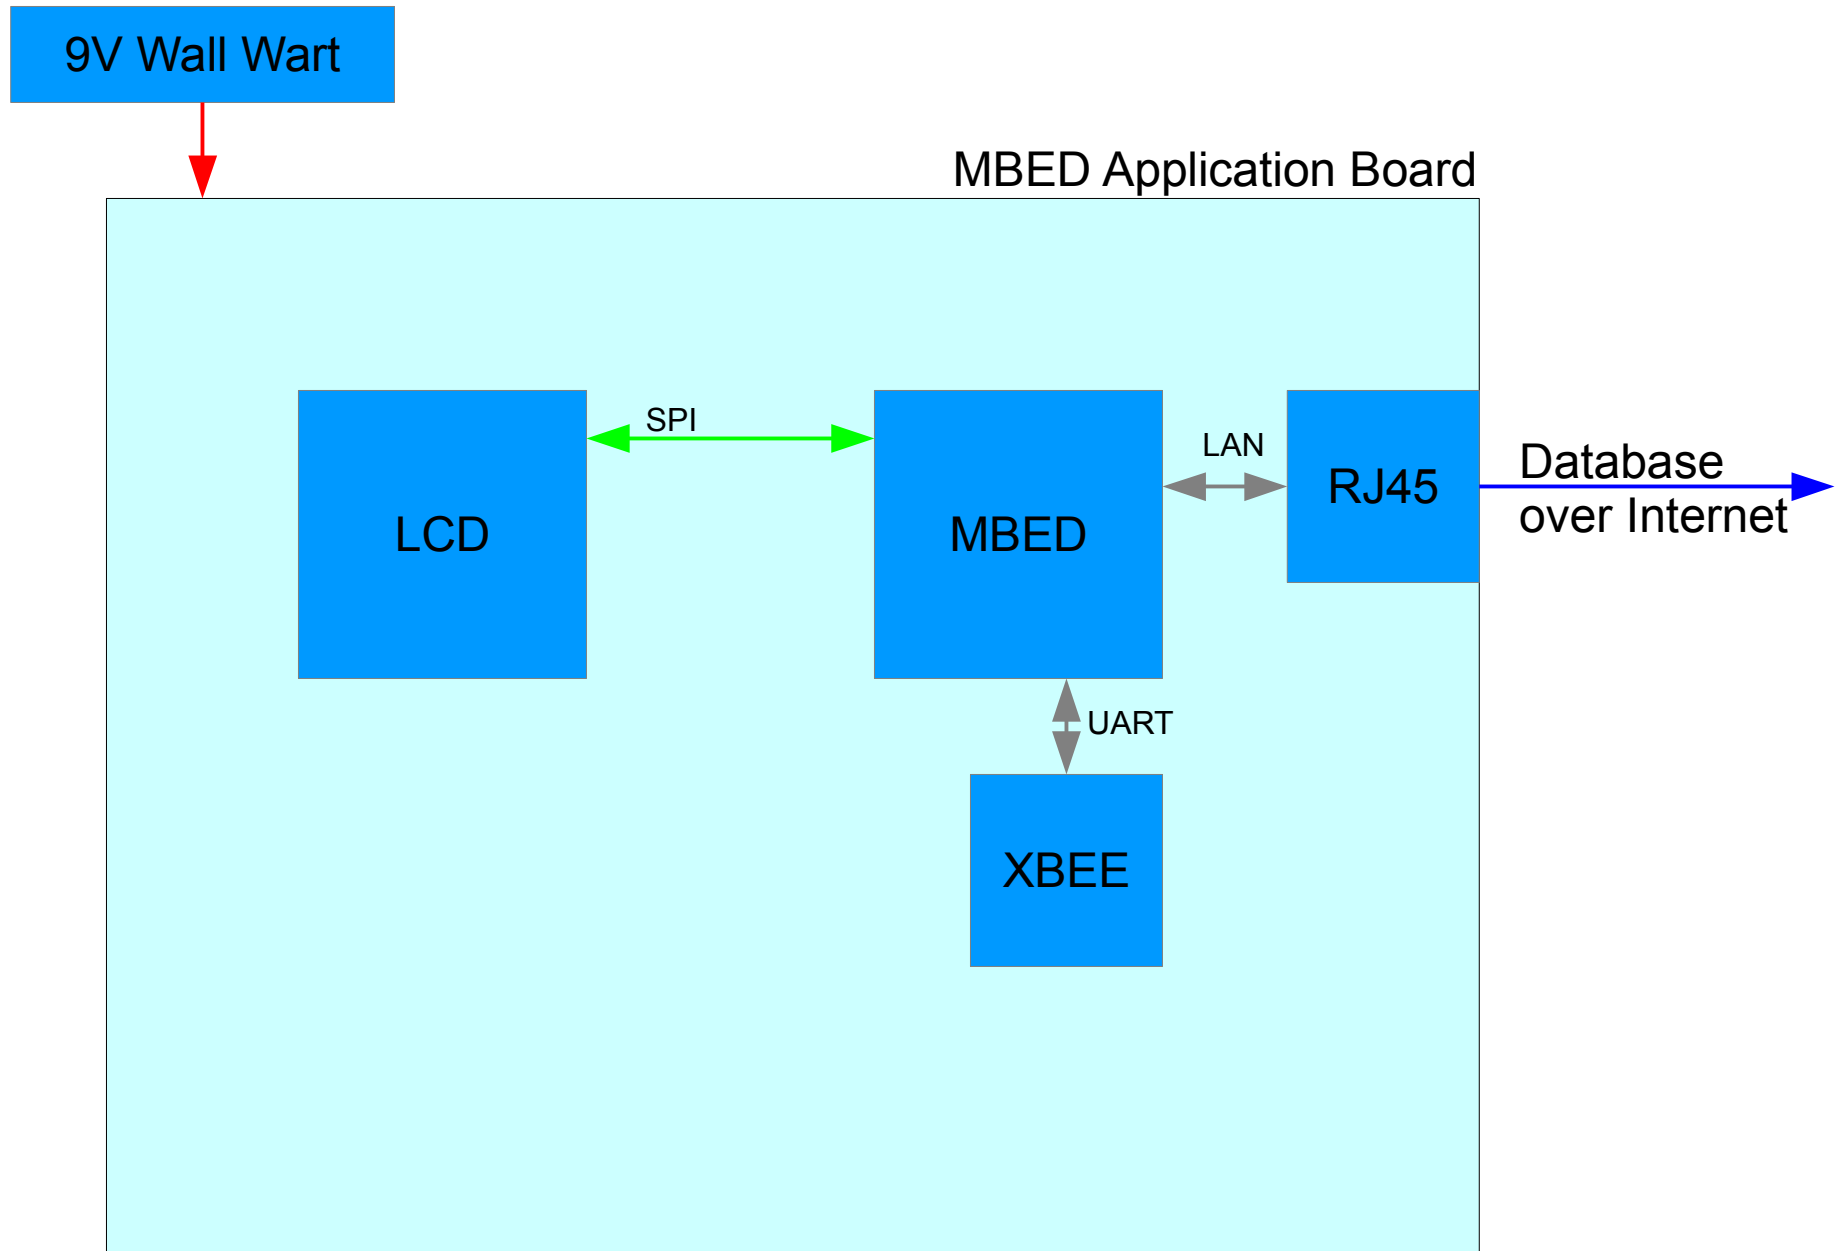

Standard Vent Unit

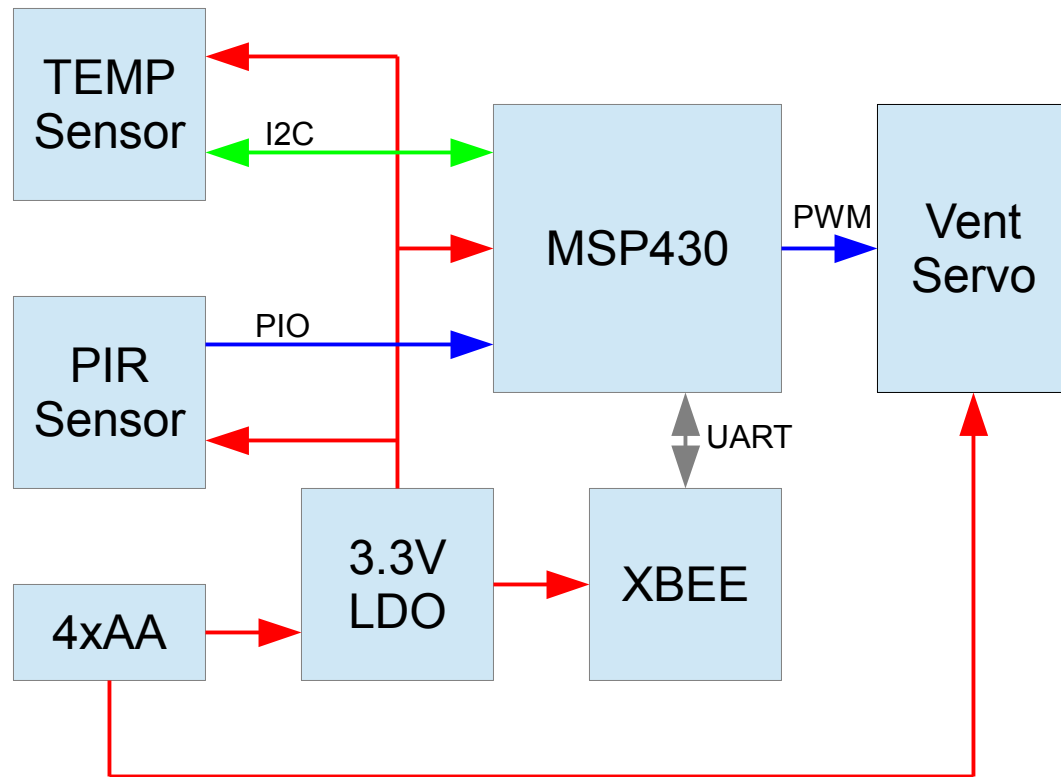

Thermostat Unit

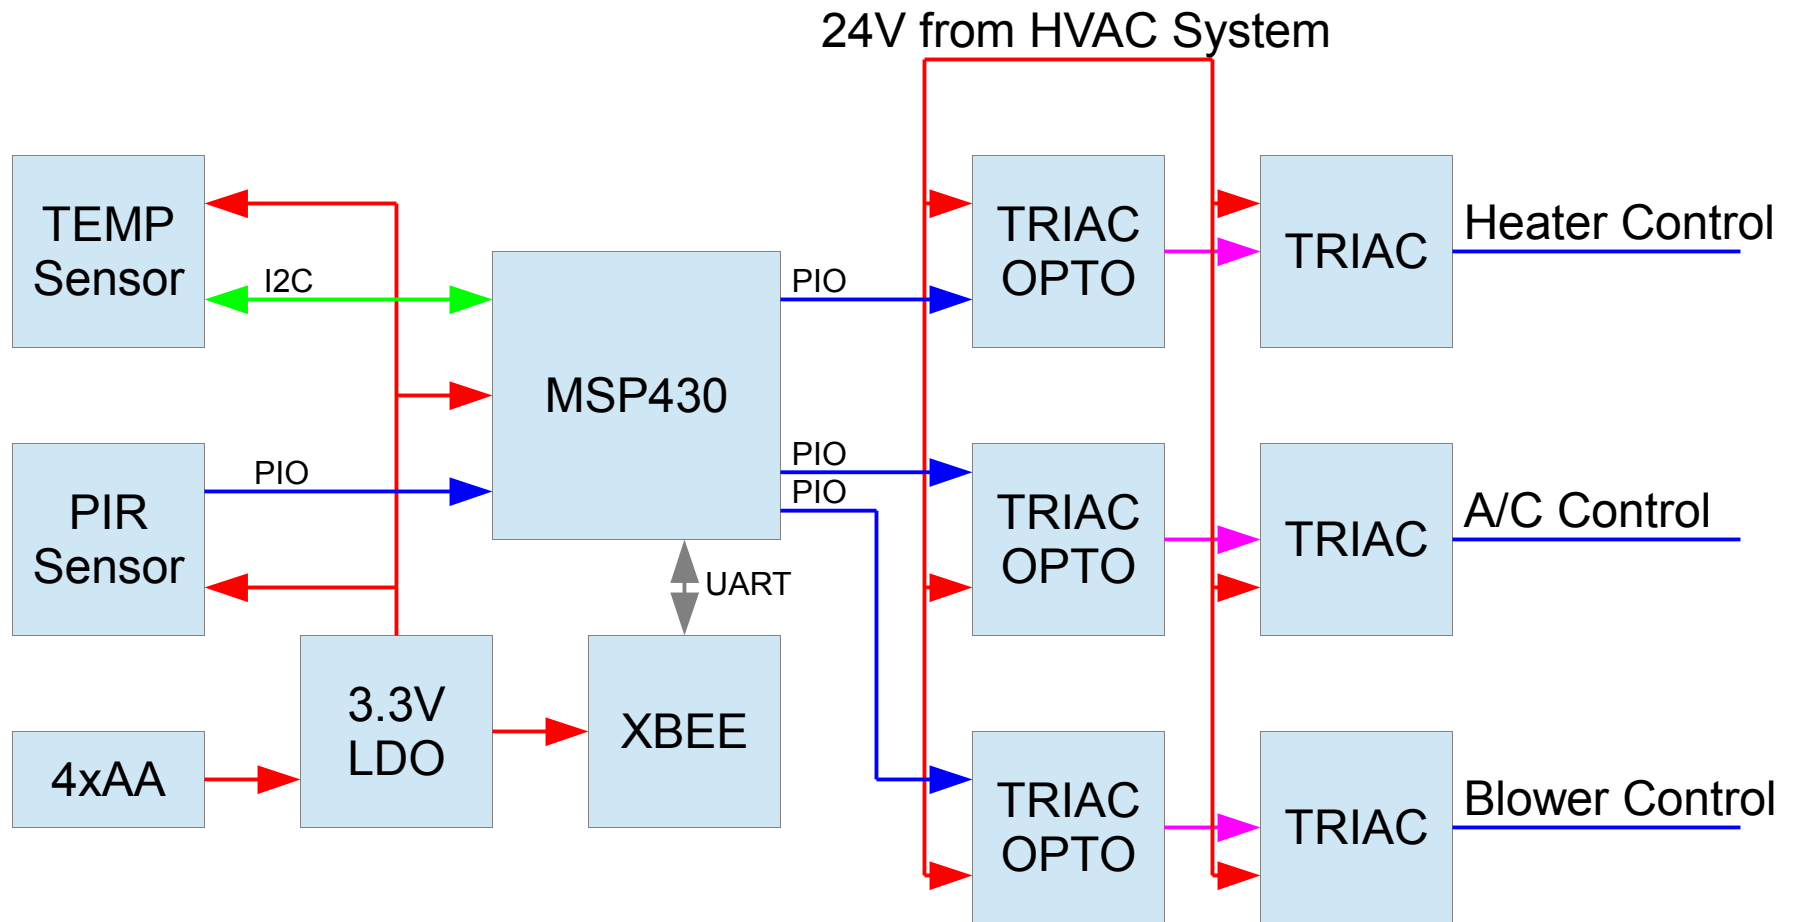


Possible Modifications:


- Draw power from 24V HVAC supply
- Graphical Interface

Gas Sensor Unit

Optional for utility & increased gas sensor accuracy

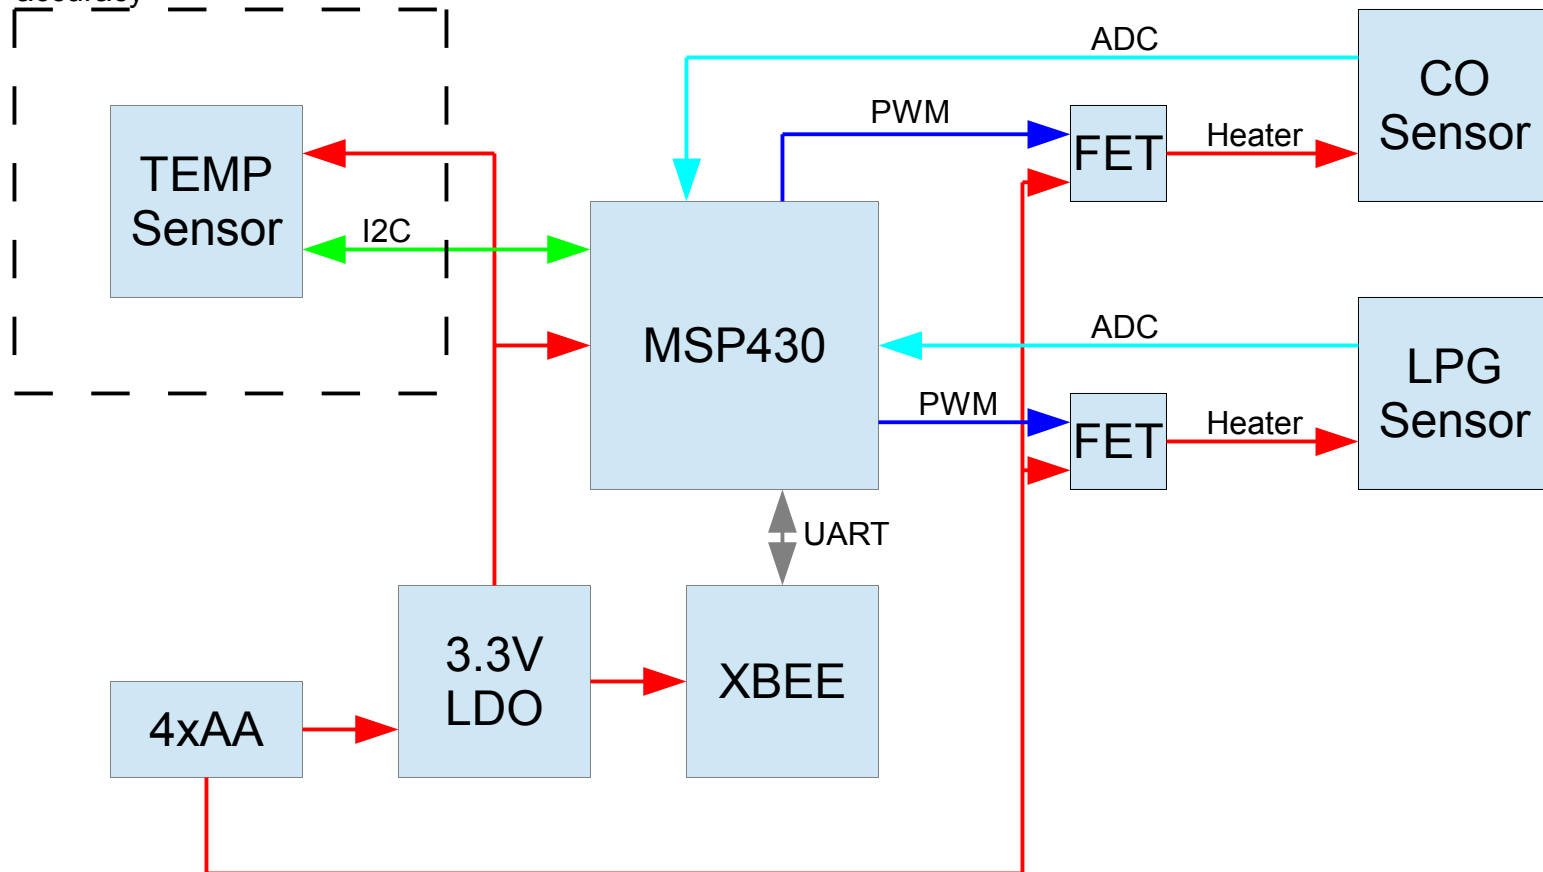


Wall Plug On/Off & Dimming Unit

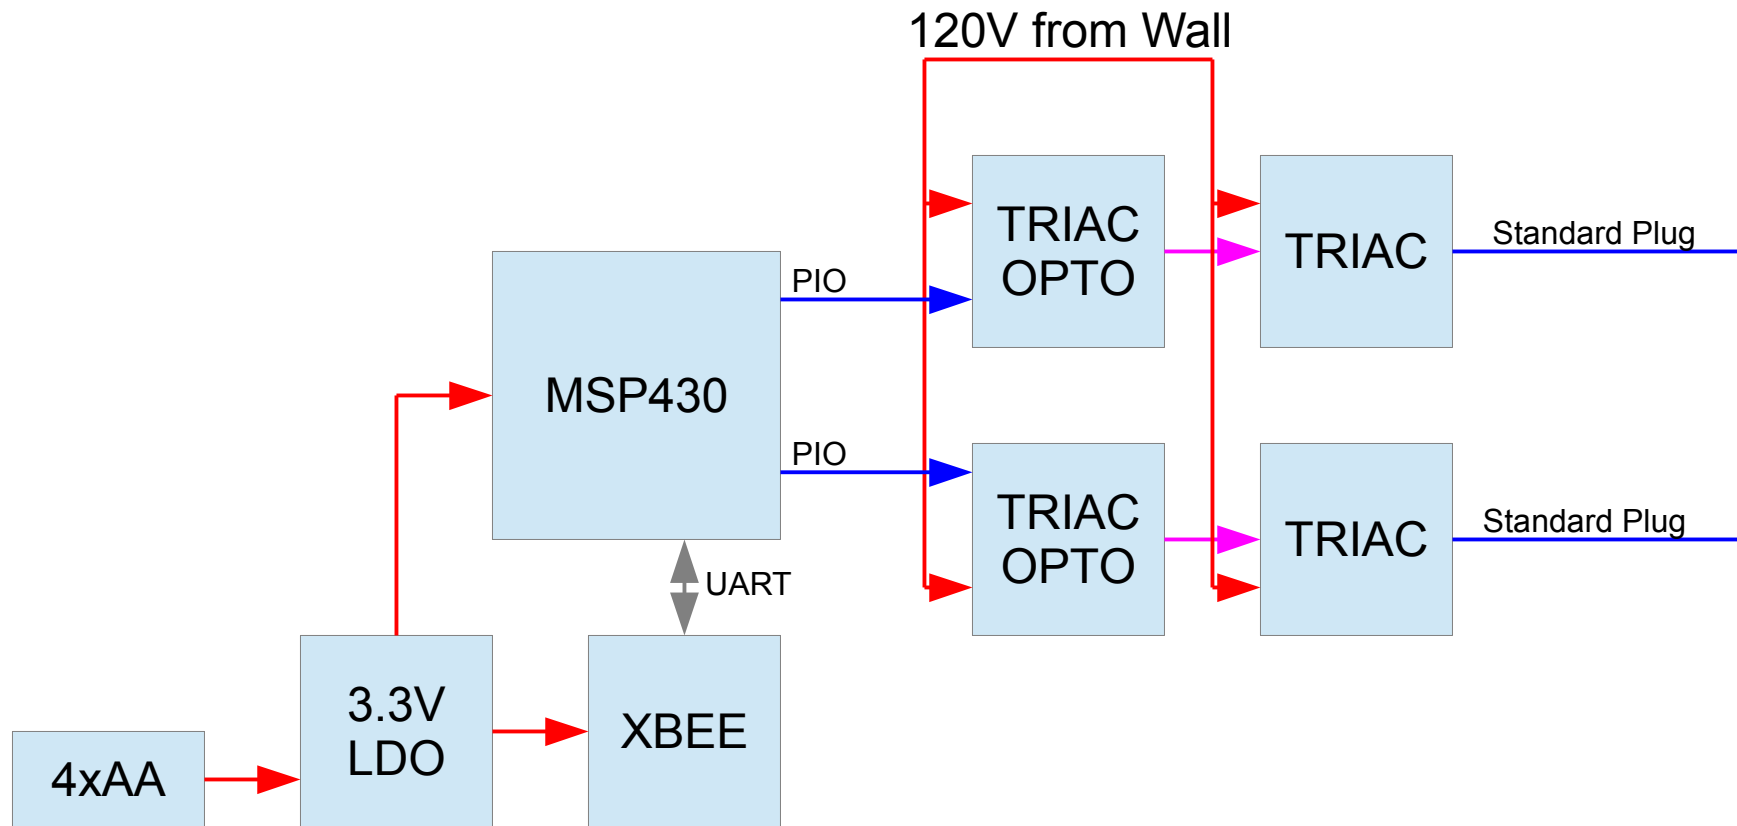


Possible Modifications:

- Current-sense resistors between TRIACs and plugs
- Draw power from wall with pre-built supply

RFID Door Unit

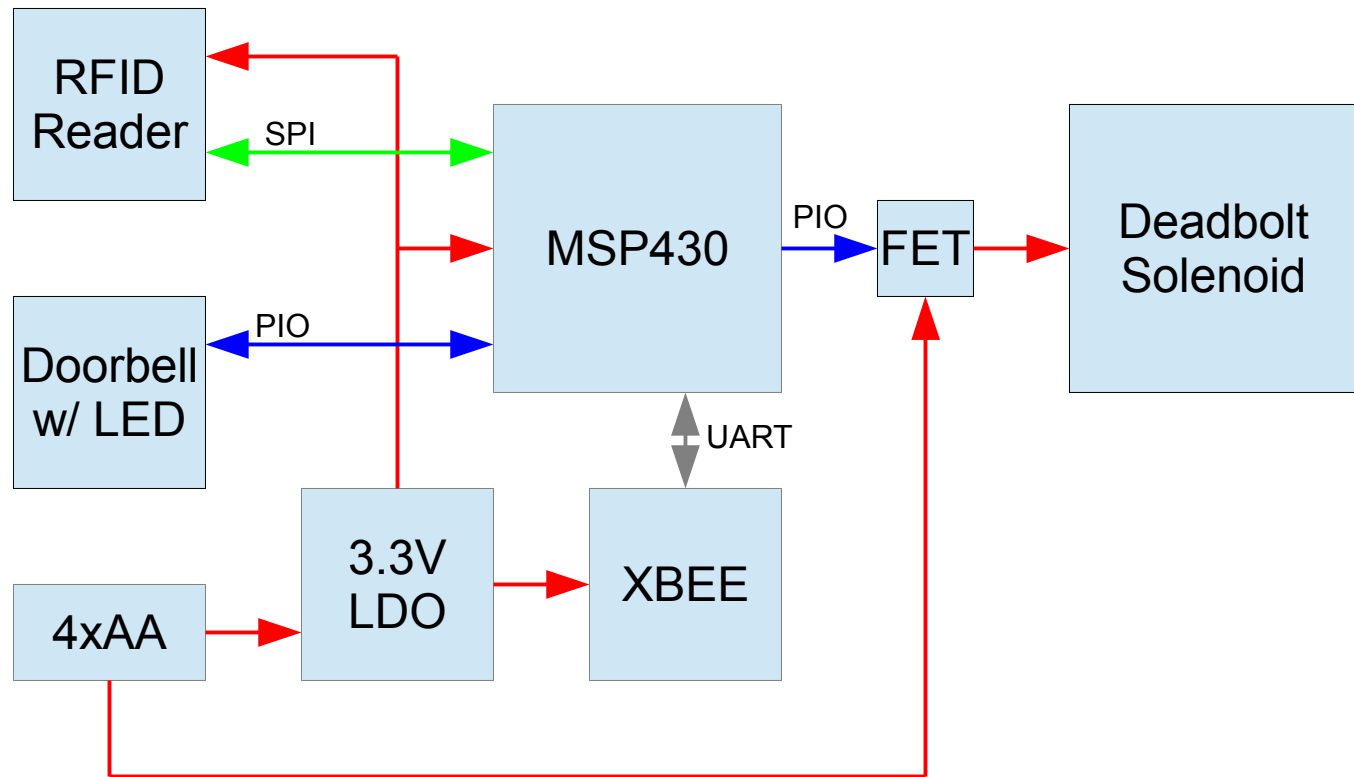

Audio Unit

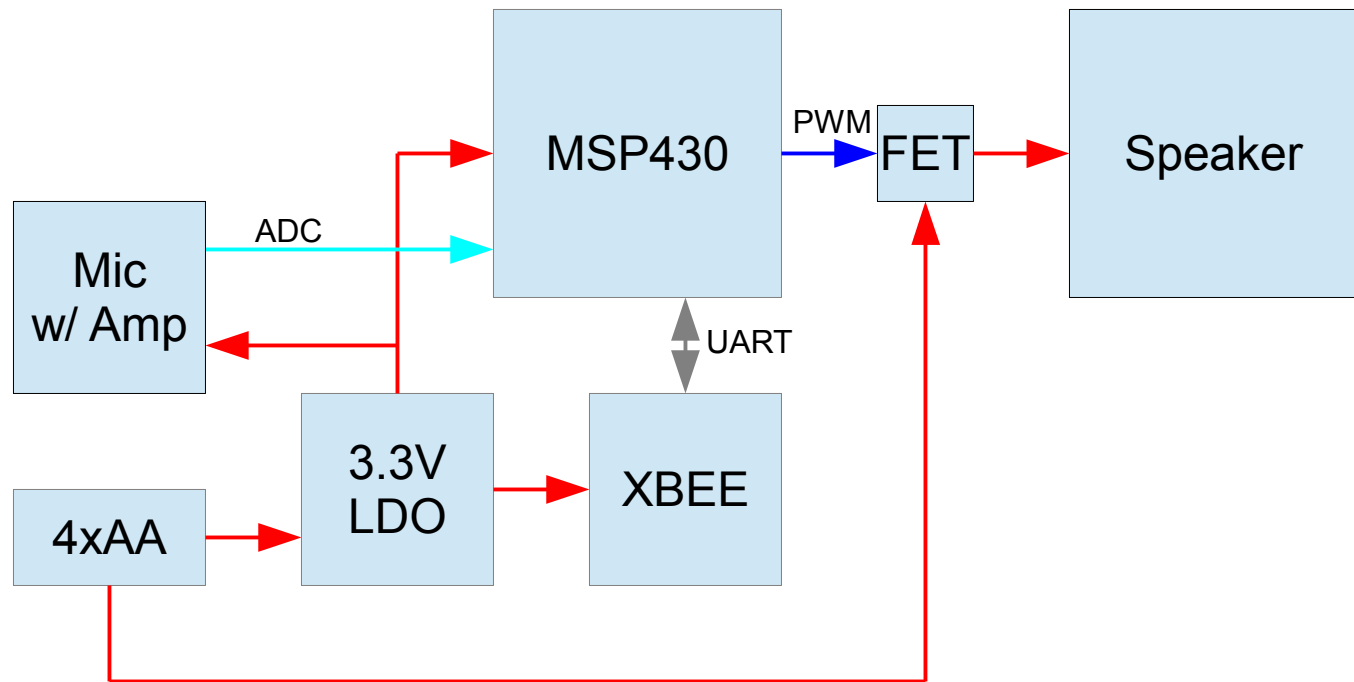

Layout/Usage Example

 = Standard Unit

