




Solar LT Panels

Industry Leaders Trust Us!

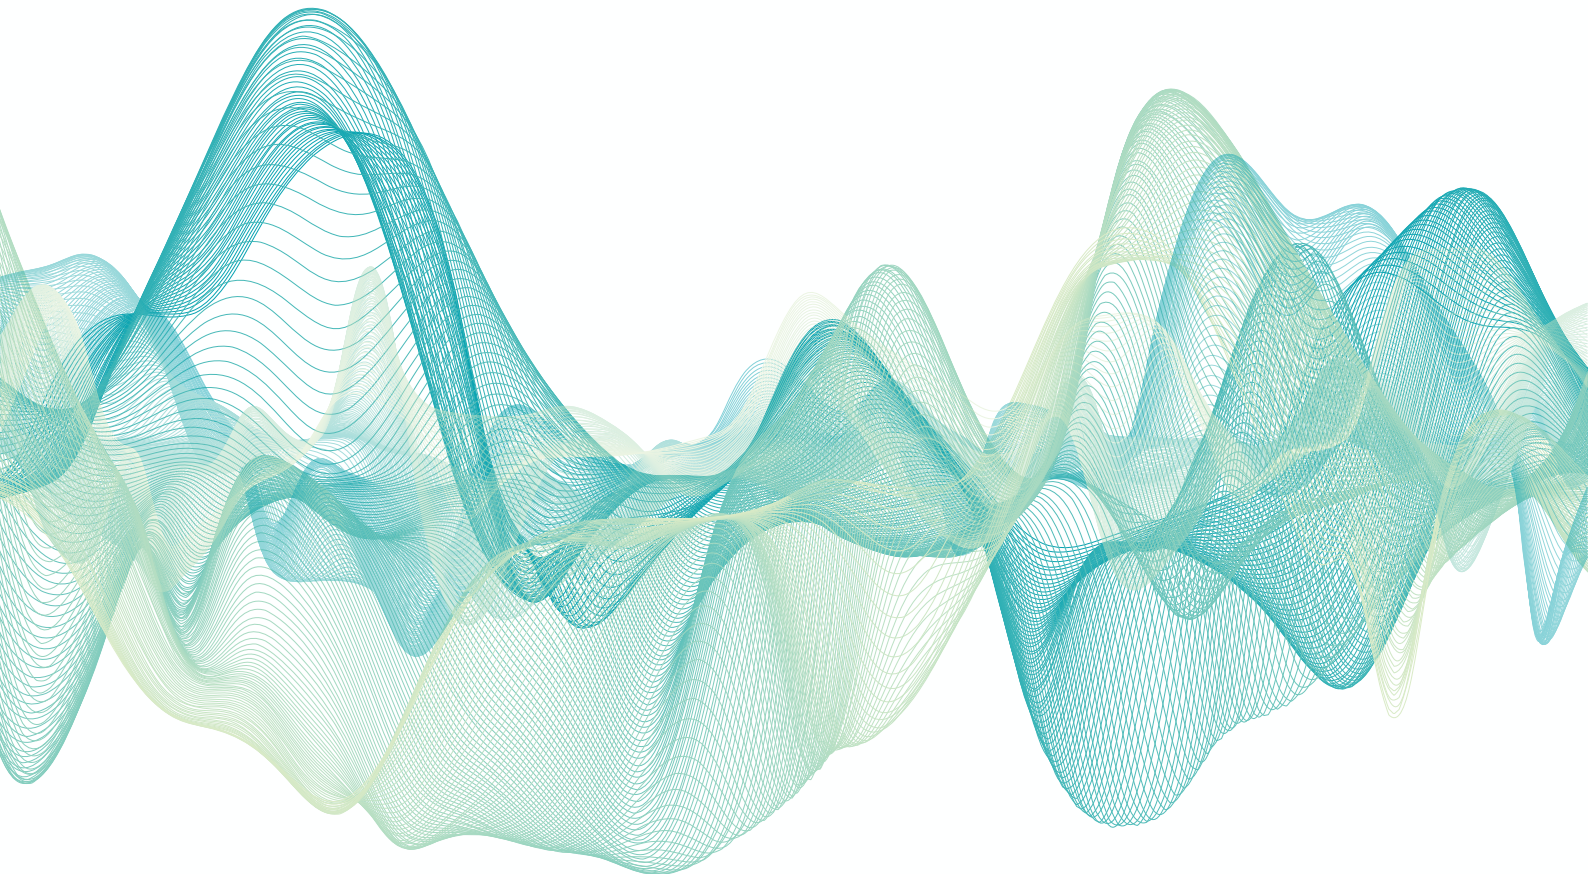

15+

Years of Experience

100+

Satisfied Customers

3,500+


In-house Panels
Fabrication Unit

60,000+sq.ft.

State of Art Manufacturing Facility

1,000+


Projects

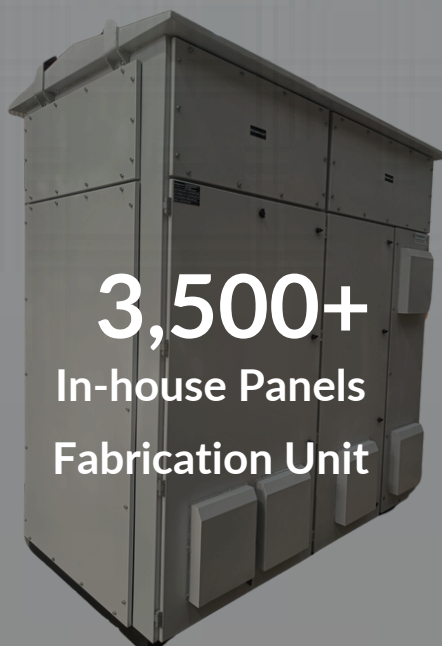

800V & 415V LT Panel Specification

Parameter	415V LT Panel	800V LT Panel
Voltage & Frequency Rating	415V AC, 50 Hz	800V AC, 50 Hz
Current Rating	Up to 4000 A, 65 KA	Up to 4000 A, 50 KA
Enclosure IP Type	IP55-rated weatherproof enclosure	
Busbar System	Electrolytic grade Cu/Al busbar	
Switchgear	MCCB/MCB, SFU, Switches, etc.	
Metering	Power & Energy Data System	
Protection	L-S-I-G & Surge Protection	
SCADA Compatibility	Integrity to SCADA	
Modularity	Modular design with Scalability & Expandability	
Compliance & Certifications	Complies Relevant IS/IEC Standard (e.g. IEC61439)	
Environmental Rating	Indoor/Outdoor/Coastal/Seismic area	
Application	Kusum yojana Renewable & Infrastructure Projects, Pumping Stations	

Expertise

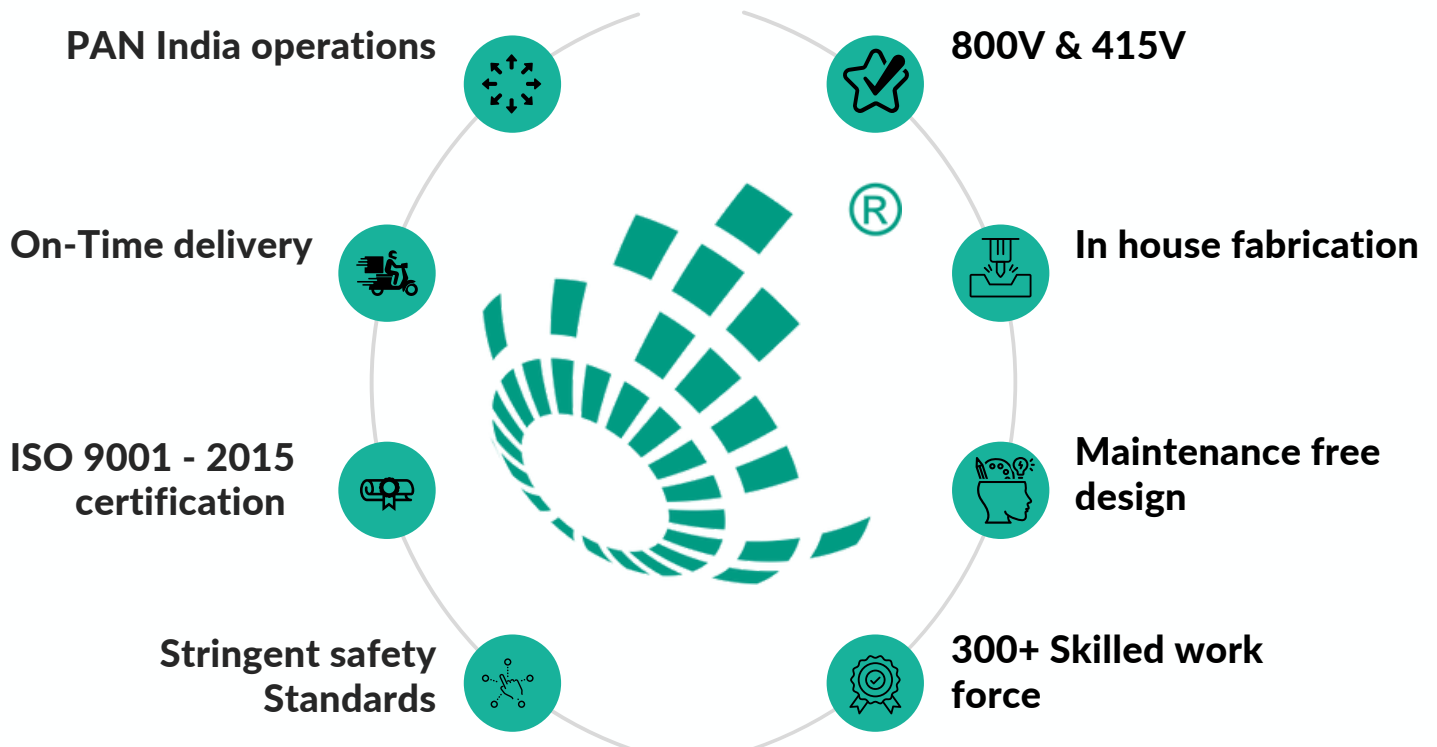

Value Creation



IP 55 protection test

Temperature rise test

50kA short-circuit test

Impulse test

Type Test Certificates

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
Incorporated in the Republic of India under the Companies Act, 1956. Registered Office: 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009. Tel: +91 79 6586 0000. Email: erda@erda.org

TEST REPORT SHEET 1 OF 4
NAME & ADDRESS OF CUSTOMER: ADAPTIVE ENGINEERING PVT. LTD., 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009.
REPORT NO.: EP-1921-090261
CUSTOMER REF. NO.: AD-1921-090261
DATE: 18.02.2023
DATE OF SAMPLE RECEIPT: 29.02.2023
DATE OF TESTING: 03.03.2023

SAMPLE DESCRIPTION
*1250A, 415V, 50Hz 3 Ph+N MCC Panel
Rated operational voltage (U_n): 415 V
Rated operational current (I_n): 1250 A
Rated frequency (f): 50 Hz
Rated insulation voltage (U_i): 690 V
No. of phases: 3 Ph+N
Extinction/Non-extinction: Non-Extinction
Rated short-time withstand current (I_{sc}): Three phase: 50 kA for 1 sec. between neutral phase and earth/Three phase: 1250A Peak between nearest phase and neutral
Quantity (Each): 1 No.

TEST DETAILS
Short time withstand current and peak withstand current test (CL No. 10.11.1.3.3, IEC No. 10.11.1.3.3) (Only on horizontal busbar and vertical busbar)

TEST SPECIFICATIONS
As per customer requirement & test procedure followed as per IEC 61439-2:2011

ENCLOSURES:
NUMBER OF PHOTOGRAPH: Two
NUMBER OF TEST CIRCUIT DIAGRAM: Two
NUMBER OF DRAWING: Two

REMARKS: The sample (Only horizontal busbar and vertical busbar) conforms to the requirements of short-time withstand current and peak withstand current test as specified by customer.

PREPARED BY: [Signature]
CHECKED BY: [Signature]
APPROVED BY: [Signature]

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
Incorporated in the Republic of India under the Companies Act, 1956. Registered Office: 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009. Tel: +91 79 6586 0000. Email: erda@erda.org

TEST REPORT SHEET 2 OF 4
NAME & ADDRESS OF CUSTOMER: ADAPTIVE ENGINEERING PVT. LTD., 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009.
REPORT NO.: EP-1921-090261
CUSTOMER REF. NO.: AD-1921-090261
DATE: 18.02.2023
DATE OF SAMPLE RECEIPT: 29.02.2023
DATE OF TESTING: 03.03.2023

SAMPLE DESCRIPTION
*1250A, 415V, 50Hz 3 Ph+N MCC Panel
Rated operational voltage (U_n): 415 V
Rated operational current (I_n): 1250 A
Rated frequency (f): 50 Hz
Rated insulation voltage (U_i): 690 V
No. of phases: 3 Ph+N
Extinction/Non-extinction: Non-Extinction
Rated short-time withstand current (I_{sc}): Three phase: 50 kA for 1 sec. between neutral phase and earth/Three phase: 1250A Peak between nearest phase and neutral
Quantity (Each): 1 No.

TEST DETAILS
Short time withstand current and peak withstand current test (CL No. 10.11.1.3.3, IEC No. 10.11.1.3.3) (Only on horizontal busbar and vertical busbar)

TEST SPECIFICATIONS
As per customer requirement & test procedure followed as per IEC 61439-2:2011

ENCLOSURES:
NUMBER OF PHOTOGRAPH: Two
NUMBER OF TEST CIRCUIT DIAGRAM: Two
NUMBER OF DRAWING: Two

REMARKS: The sample (Only horizontal busbar and vertical busbar) conforms to the requirements of short-time withstand current and peak withstand current test as specified by customer.

PREPARED BY: [Signature]
CHECKED BY: [Signature]
APPROVED BY: [Signature]

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
Incorporated in the Republic of India under the Companies Act, 1956. Registered Office: 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009. Tel: +91 79 6586 0000. Email: erda@erda.org

TEST REPORT SHEET 3 OF 4
NAME & ADDRESS OF CUSTOMER: ADAPTIVE ENGINEERING PVT. LTD., 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009.
REPORT NO.: EP-1921-090261
CUSTOMER REF. NO.: AD-1921-090261
DATE: 18.02.2023
DATE OF SAMPLE RECEIPT: 29.02.2023
DATE OF TESTING: 03.03.2023

SAMPLE DESCRIPTION
*1250A, 415V, 50Hz 3 Ph+N MCC Panel
Rated operational voltage (U_n): 415 V
Rated operational current (I_n): 1250 A
Rated frequency (f): 50 Hz
Rated insulation voltage (U_i): 690 V
No. of phases: 3 Ph+N
Extinction/Non-extinction: Non-Extinction
Rated short-time withstand current (I_{sc}): Three phase: 50 kA for 1 sec. between neutral phase and earth/Three phase: 1250A Peak between nearest phase and neutral
Quantity (Each): 1 No.

TEST DETAILS
Short time withstand current and peak withstand current test (CL No. 10.11.1.3.3, IEC No. 10.11.1.3.3) (Only on horizontal busbar and vertical busbar)

TEST SPECIFICATIONS
As per customer requirement & test procedure followed as per IEC 61439-2:2011

ENCLOSURES:
NUMBER OF PHOTOGRAPH: Two
NUMBER OF TEST CIRCUIT DIAGRAM: Two
NUMBER OF DRAWING: Two

REMARKS: The sample (Only horizontal busbar and vertical busbar) conforms to the requirements of short-time withstand current and peak withstand current test as specified by customer.

PREPARED BY: [Signature]
CHECKED BY: [Signature]
APPROVED BY: [Signature]

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
Incorporated in the Republic of India under the Companies Act, 1956. Registered Office: 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009. Tel: +91 79 6586 0000. Email: erda@erda.org

TEST REPORT SHEET 1 OF 4
NAME & ADDRESS OF CUSTOMER: ADAPTIVE ENGINEERING PVT. LTD., 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009.
REPORT NO.: EP-1921-090261
CUSTOMER REF. NO.: AD-1921-090261
DATE: 18.02.2023
DATE OF SAMPLE RECEIPT: 29.02.2023
DATE OF TESTING: 03.03.2023

SAMPLE DESCRIPTION
*1250A, 415V, 50Hz 3 Ph+N MCC Panel
Rated operational voltage (U_n): 415 V
Rated operational current (I_n): 1250 A
Rated frequency (f): 50 Hz
Rated insulation voltage (U_i): 690 V
No. of phases: 3 Ph+N
Extinction/Non-extinction: Non-Extinction
Rated short-time withstand current (I_{sc}): Three phase: 50 kA for 1 sec. between neutral phase and earth/Three phase: 1250A Peak between nearest phase and neutral
Quantity (Each): 1 No.

TEST DETAILS
Short time withstand current and peak withstand current test (CL No. 10.11.1.3.3, IEC No. 10.11.1.3.3) (Only on horizontal busbar and vertical busbar)

TEST SPECIFICATIONS
As per customer requirement & test procedure followed as per IEC 61439-2:2011

ENCLOSURES:
NUMBER OF PHOTOGRAPH: Two
NUMBER OF TEST CIRCUIT DIAGRAM: Two
NUMBER OF DRAWING: Two

REMARKS: The sample (Only horizontal busbar and vertical busbar) conforms to the requirements of short-time withstand current and peak withstand current test as specified by customer.

PREPARED BY: [Signature]
CHECKED BY: [Signature]
APPROVED BY: [Signature]

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
Incorporated in the Republic of India under the Companies Act, 1956. Registered Office: 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009. Tel: +91 79 6586 0000. Email: erda@erda.org

TEST REPORT SHEET 2 OF 4
NAME & ADDRESS OF CUSTOMER: ADAPTIVE ENGINEERING PVT. LTD., 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009.
REPORT NO.: EP-1921-090261
CUSTOMER REF. NO.: AD-1921-090261
DATE: 18.02.2023
DATE OF SAMPLE RECEIPT: 29.02.2023
DATE OF TESTING: 03.03.2023

SAMPLE DESCRIPTION
*1250A, 415V, 50Hz 3 Ph+N MCC Panel
Rated operational voltage (U_n): 415 V
Rated operational current (I_n): 1250 A
Rated frequency (f): 50 Hz
Rated insulation voltage (U_i): 690 V
No. of phases: 3 Ph+N
Extinction/Non-extinction: Non-Extinction
Rated short-time withstand current (I_{sc}): Three phase: 50 kA for 1 sec. between neutral phase and earth/Three phase: 1250A Peak between nearest phase and neutral
Quantity (Each): 1 No.

TEST DETAILS
Short time withstand current and peak withstand current test (CL No. 10.11.1.3.3, IEC No. 10.11.1.3.3) (Only on horizontal busbar and vertical busbar)

TEST SPECIFICATIONS
As per customer requirement & test procedure followed as per IEC 61439-2:2011

ENCLOSURES:
NUMBER OF PHOTOGRAPH: Two
NUMBER OF TEST CIRCUIT DIAGRAM: Two
NUMBER OF DRAWING: Two

REMARKS: The sample (Only horizontal busbar and vertical busbar) conforms to the requirements of short-time withstand current and peak withstand current test as specified by customer.

PREPARED BY: [Signature]
CHECKED BY: [Signature]
APPROVED BY: [Signature]

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
Incorporated in the Republic of India under the Companies Act, 1956. Registered Office: 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009. Tel: +91 79 6586 0000. Email: erda@erda.org

TEST REPORT SHEET 3 OF 4
NAME & ADDRESS OF CUSTOMER: ADAPTIVE ENGINEERING PVT. LTD., 21/1, Chitra-Anant, Old Bldg, Ashram Road, Ahmedabad - 380 009.
REPORT NO.: EP-1921-090261
CUSTOMER REF. NO.: AD-1921-090261
DATE: 18.02.2023
DATE OF SAMPLE RECEIPT: 29.02.2023
DATE OF TESTING: 03.03.2023

SAMPLE DESCRIPTION
*1250A, 415V, 50Hz 3 Ph+N MCC Panel
Rated operational voltage (U_n): 415 V
Rated operational current (I_n): 1250 A
Rated frequency (f): 50 Hz
Rated insulation voltage (U_i): 690 V
No. of phases: 3 Ph+N
Extinction/Non-extinction: Non-Extinction
Rated short-time withstand current (I_{sc}): Three phase: 50 kA for 1 sec. between neutral phase and earth/Three phase: 1250A Peak between nearest phase and neutral
Quantity (Each): 1 No.

TEST DETAILS
Short time withstand current and peak withstand current test (CL No. 10.11.1.3.3, IEC No. 10.11.1.3.3) (Only on horizontal busbar and vertical busbar)


TEST SPECIFICATIONS
As per customer requirement & test procedure followed as per IEC 61439-2:2011

ENCLOSURES:
NUMBER OF PHOTOGRAPH: Two
NUMBER OF TEST CIRCUIT DIAGRAM: Two
NUMBER OF DRAWING: Two

REMARKS: The sample (Only horizontal busbar and vertical busbar) conforms to the requirements of short-time withstand current and peak withstand current test as specified by customer.


PREPARED BY: [Signature]
CHECKED BY: [Signature]
APPROVED BY: [Signature]

Installed Capacity - 45GW+

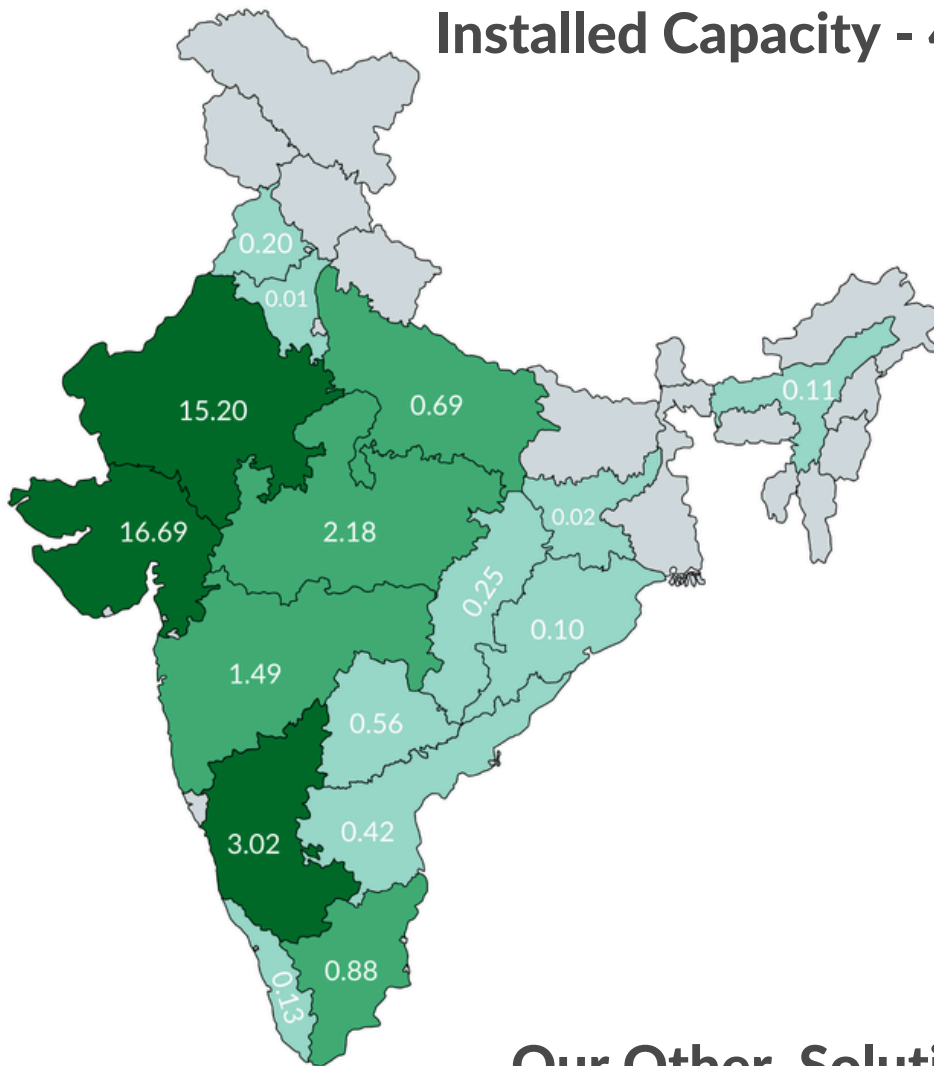

State	Capacity (GW)	No. of Sites
Gujarat	16.69	108
Rajasthan	15.20	68
Karnataka	3.02	63
Madhya Pradesh	2.18	28
Maharashtra	1.49	45
Tamil Nadu	0.88	7
Uttar Pradesh	0.69	30
Telangana	0.56	27
Andhra Pradesh	0.42	4
Chhattisgarh	0.25	9
Punjab	0.20	8
Kerala	0.13	4
Assam	0.11	4
Odisha	0.10	3
Jharkhand	0.02	1
Haryana	0.01	2
Grand Total	41.93	411

Our Other Solutions

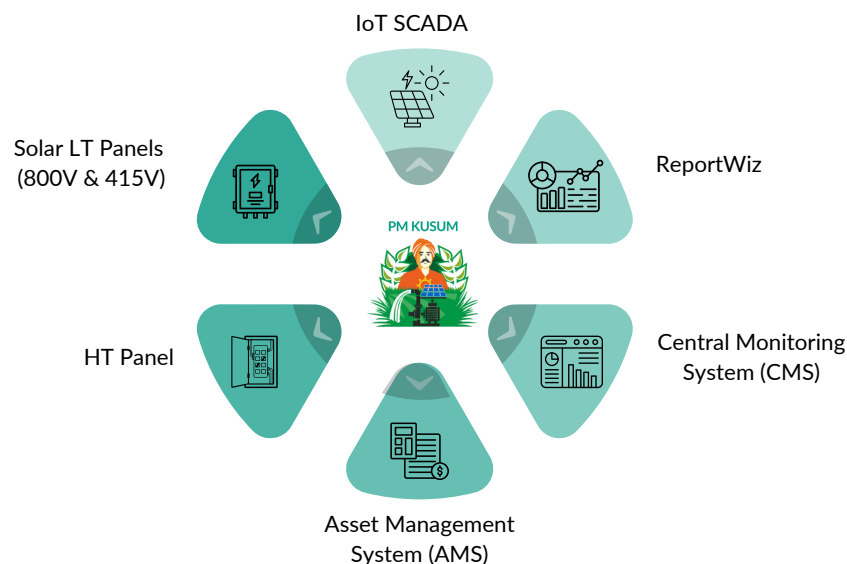

21st Floor, "Yash Anant",
Opp. Old RBI,
Ashram Road,
Ahmedabad - 380009,
Gujarat, India

+917969269000

info@adaptive-engg.com

Know More

