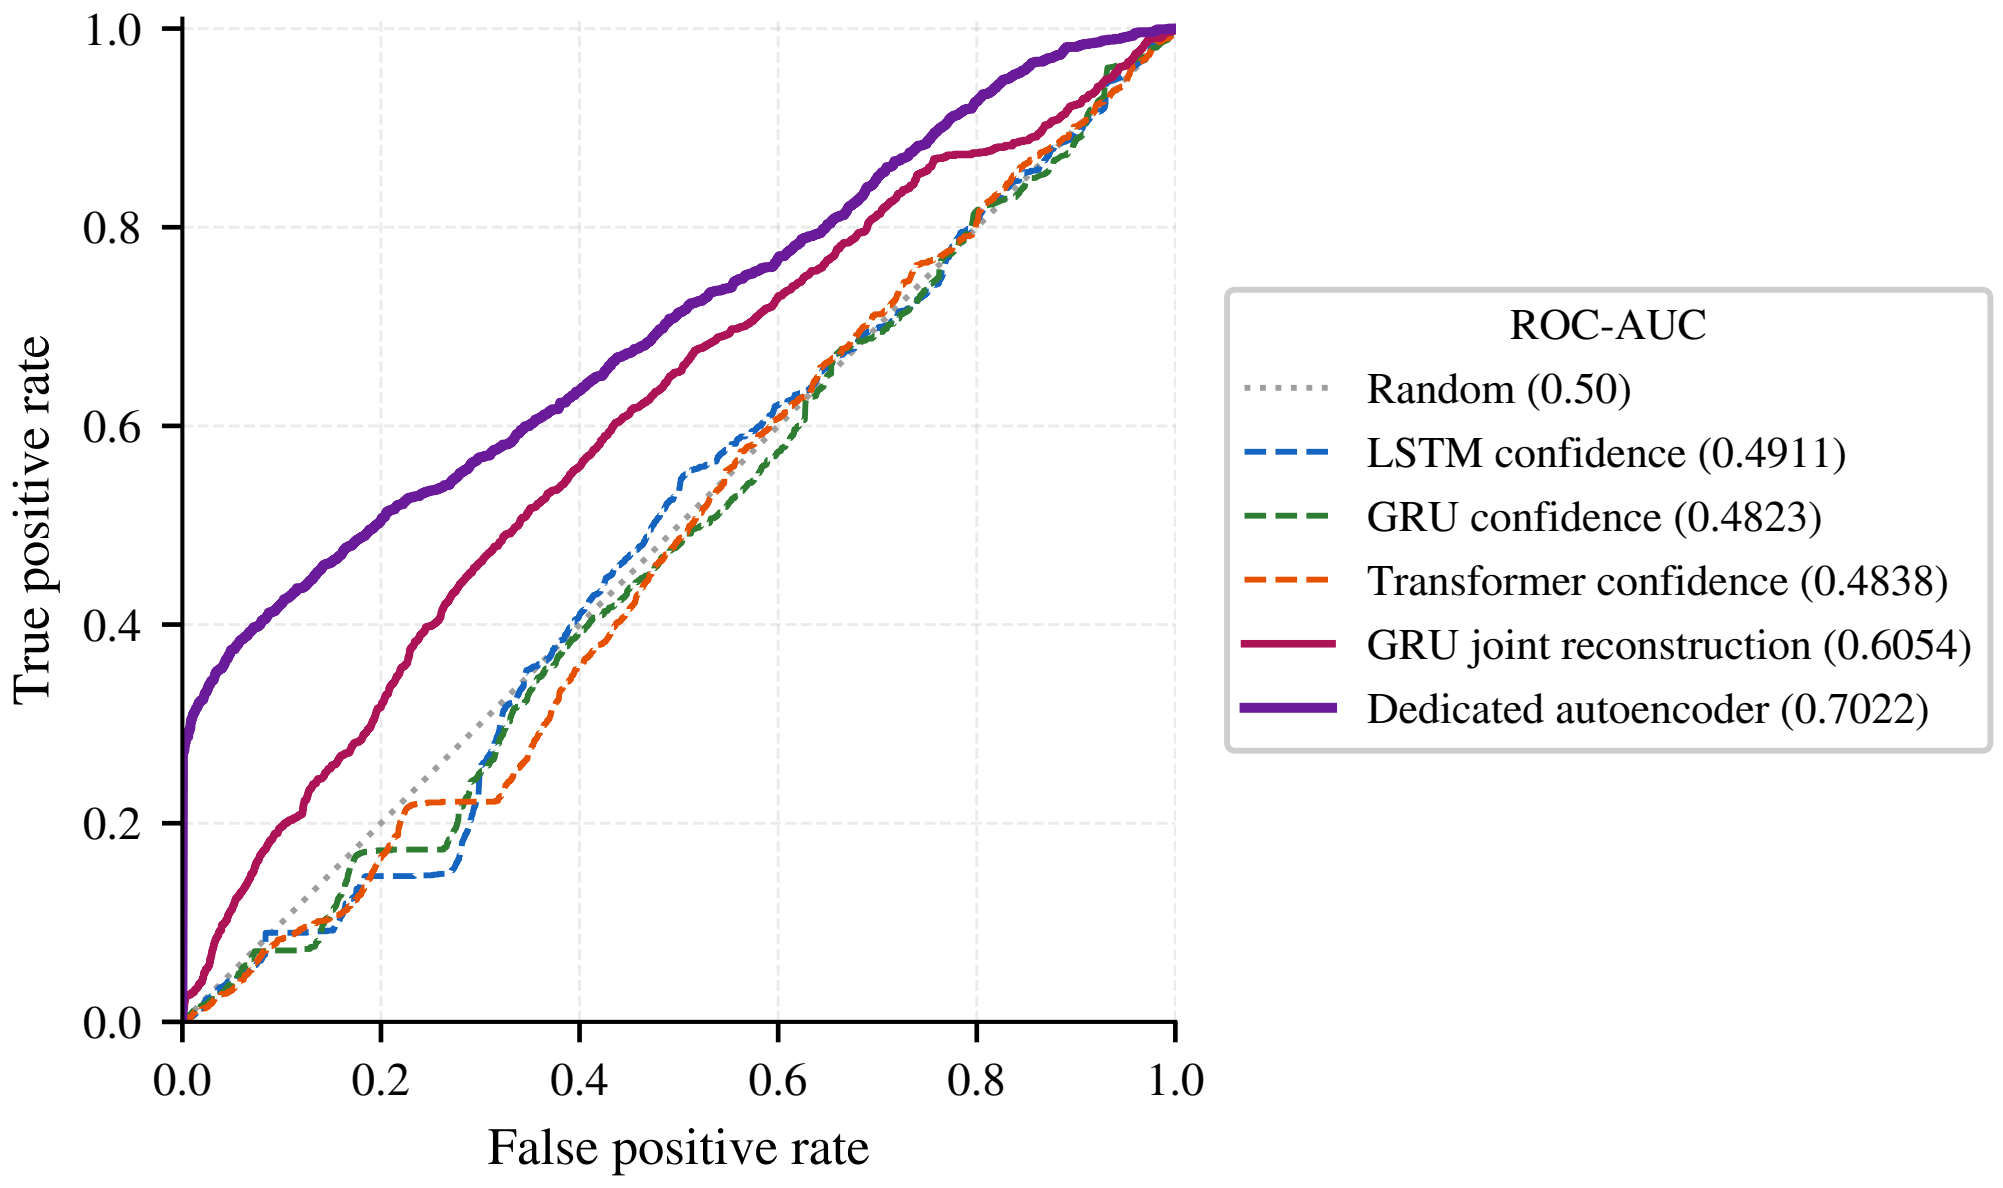
True positive rate
False positive rate
0.0
0.2
0.4
0.6
0.8
1.0
ROC-AUC
Random (0.50)
LSTM confidence (0.4911)
GRU confidence (0.4823)
Transformer confidence (0.4838)
GRU joint reconstruction (0.6054)
Dedicated autoencoder (0.7022)