


Difference Spectrum and Model Fit

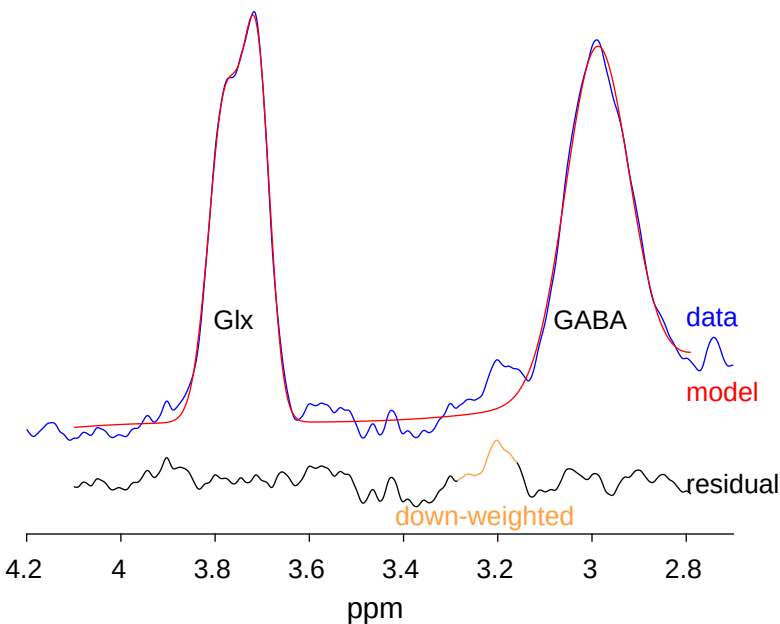

Filename: P38912.7

Area

GABA+: 0.00104
Glx: 0.000935
Water: 17.8
Cr: 0.00745

Linewidth

Water: 10.01 Hz
Cr: 8.88 Hz

SNR

Water: 100225
Cr: 173


Fit Error

GABA+,Water: 2.52%
GABA+,Cr: 2.81%
Glx,Water: 2.48%
Glx,Cr: 2.77%

Quantification

GABA+/Water: 2.18 i.u.
GABA+/Cr: 0.14
Glx/Water: 7.09 i.u.
Glx/Cr: 0.13
FitVer: 220624

Reference Signals

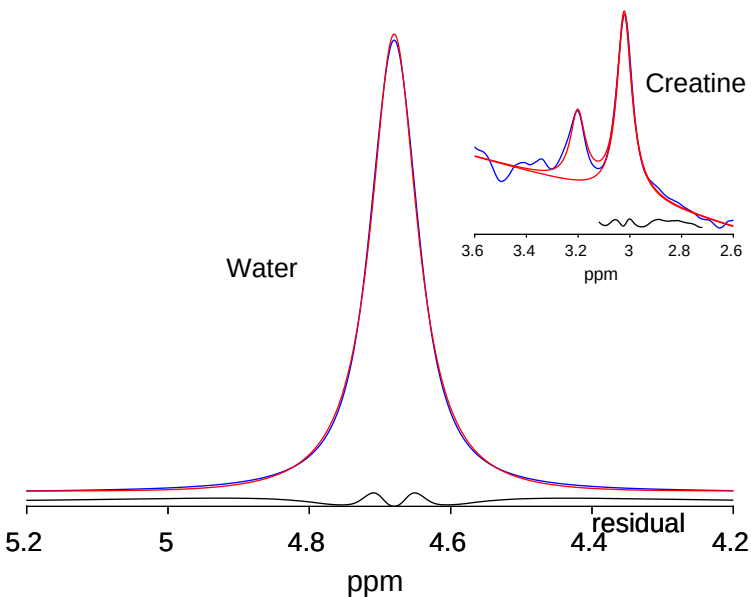

3.3.0