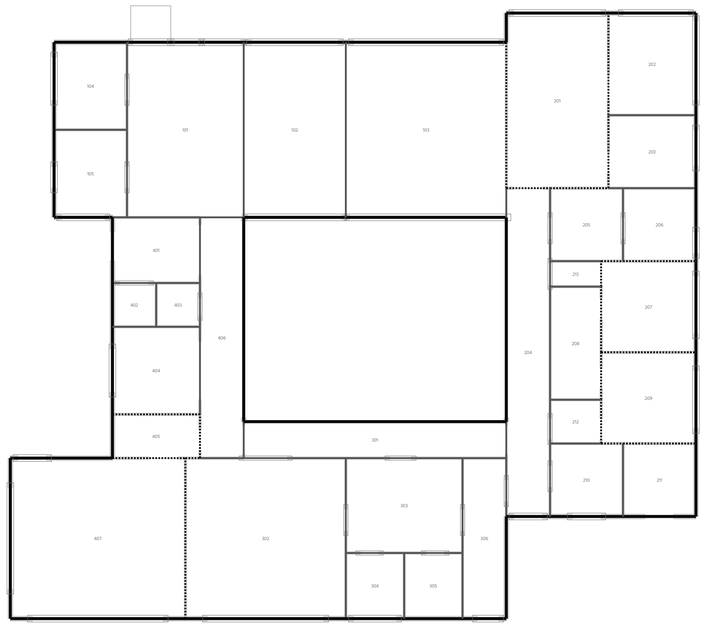

1 WALL FRAMING PLAN

SCALE: 3/32" = 1'-0"

WALL TYPES

TYPE	DESCRIPTION	BUILD-UP	LENGTH
W1	Steel Stud Exterior Wall (Rainscreen)	150 mm galvanized LGS studs (1.15 mm BMT) @ 400 mm as infill within the RC frame (slip head track at beams), 150 mm mineral-wool cavity insulation, 12 mm fiber-cement sheathing (SCG Smartboard / Shera) + breather membrane, 25 mm ventilated r…	498 ft
W2	Steel Stud Partition (Wet Face)	92 mm LGS @ 400 mm, 12 mm cement board + liquid/sheet waterproofing membrane on wet face (min 1.8 m in showers, full height in steam; finishes unchanged, Japanese earth plaster in wellness wet room), fiber-cement board + lime plaster on dry …	407 ft
W3	Acoustic Steel Stud Partition	Double 92 mm LGS on isolated tracks (studio 407) / 52 mm LGS + resilient channel (bedrooms), 75 mm acoustic mineral wool, 2 layers 12 mm fiber-cement board each side, AR mesh tape + lime plaster, subtle textured plaster finish (texture TBD), …	174 ft

WALL LEGEND

- W1 LGS steel stud exterior wall (rainscreen)
- W2 LGS steel stud partition
- W3 Acoustic steel stud (studio + bedrooms)
- W4 RC wall (pool, retaining, cistern, shear)
- L1 LGS box header over opening

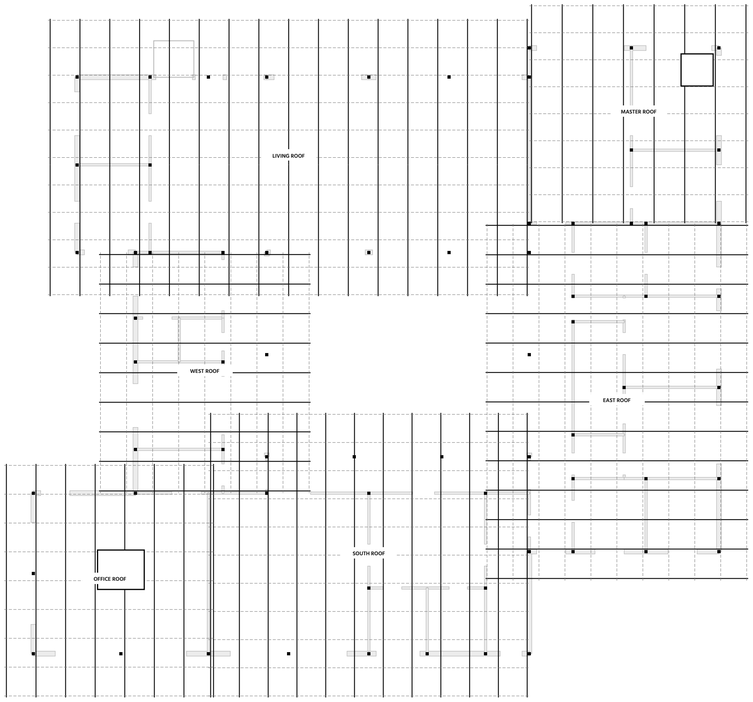

2 ROOF FRAMING PLAN

SCALE: 3/32" = 1'-0"

ROOF FRAMING SCHEDULE

MARK	MEMBER	SECTION / SPEC	QTY
R1	Steel rafter	H-150 x 75 x 5 x 7, SS400, @ 1.2 m, cantilevers to eaves	84
P1	C-purlin	C-100 x 50 x 20 x 2.3, @ 1.1 m max	60
SK	Skylight trimmer	RHS 100 x 50 x 3.2 frame	4
--	Roof deck	Standing seam 0.5 mm AZ150 + 75 mm PIR + underlay	6
--	Connections	Rafter to RB1 via cast-in plate 200 x 200 x 12 + 4-M16 anchors	-
--	Corrosion	Hot-dip galvanized or 2-coat epoxy (humid mountain climate)	-

ROOF FRAMING LEGEND

- Steel rafter R1
- C-purlin P1
- Column below (bearing)

WALL TYPES (APPROVED STANDARD)

- W1 Steel Stud Exterior: 150 mm LGS infill in RC frame, mineral wool, fiber-cement sheathing, ventilated rainscreen (white lime render or charred timber); inside fiber-cement + lime plaster, painted
- W2 Steel Stud: 92 mm LGS @ 400 mm, fiber-cement board both sides, mineral wool, lime plaster, painted; cement board + membrane on wet faces
- W3 Acoustic Stud: Double LGS / resilient channel, 75 mm mineral wool, 2 layers fiber-cement each side (studio + bedrooms)
- W4 RC Wall: Poured RC: pool, retaining walls, cistern, engineer-required shear walls only

WEBERMAN RESIDENCE

Mountain courtyard house, Thailand
Owner: Max Weberman

ISSUE

Design Development

NOT FOR CONSTRUCTION

DATE
11 Oct 2026

SCALE
3/32" = 1'-0"

MODEL
bim.json (from plan.json)

UNITS
Feet + inches (mm for members)

REVISION
DD-01

FRAMING NOTES

Interior LGS: 0.75 mm BMT studs, deflection head track at slab/beam.

Exterior LGS 150 mm infill: slip head track at RC beams, anchored to slab + columns; fiber-cement sheathing.

Studio double-stud walls on separate tracks + resilient ceiling (STC 60+).

STANDARD

No timber framing (termites): RC frame, LGS stud walls, steel roof.

Poured concrete only at pool, retaining walls, cistern and engineer-required shear walls (W4).

SHEET TITLE

Wall Framing + Roof Framing Plans

SHEET

S-102