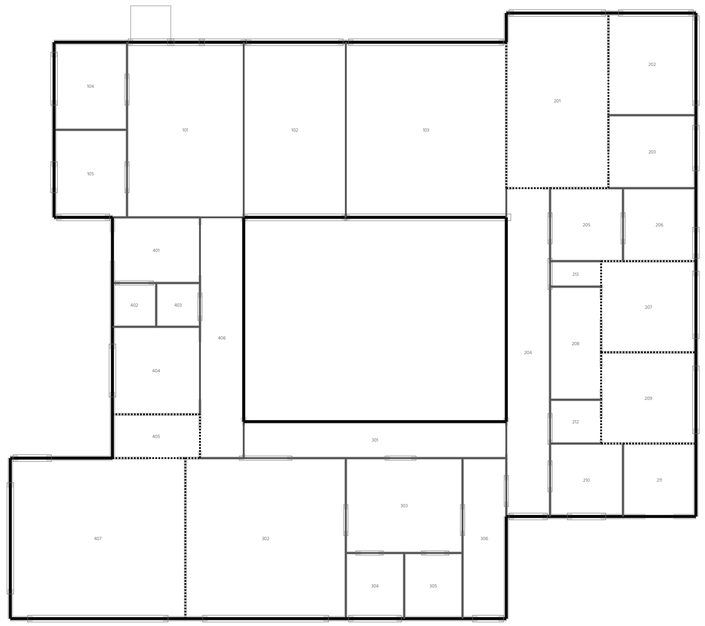

1 WALL FRAMING PLAN

SCALE: 3/32" = 1'-0"

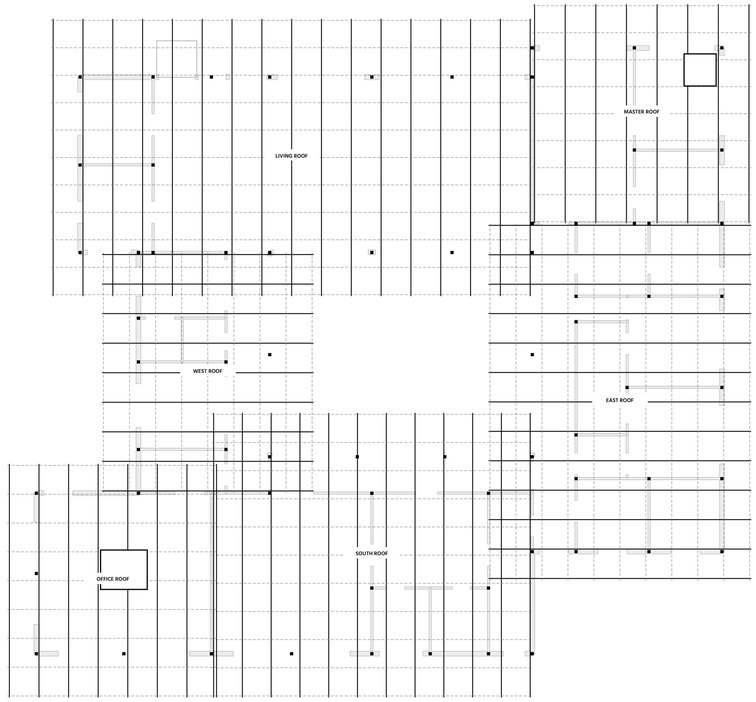

2 ROOF FRAMING PLAN

SCALE: 3/32" = 1'-0"

WALL TYPES

TYPE	DESCRIPTION	BUILD-UP	LENGTH
W1	AAC Block Exterior Wall	200 mm AAC block in RC frame (RC lintels + stiffeners), 50 mm mineral-wool exterior insulation OR ventilated charred-timber cladding on aluminium battens, lime plaster both faces	498 ft
W2	Steel Stud Partition (Wet Face)	92 mm LGS @ 400 mm, cement board on wet face + liquid/sheet waterproofing membrane (min 1.8 m in showers, full height in steam), gypsum on dry face	407 ft
W3	Acoustic Steel Stud Partition	92 mm LGS @ 400 mm (double stud on isolated tracks at studio 407), 75 mm acoustic mineral wool, 2 x 13 mm sound-rated board each side, resilient channel (STC 55+, 60+ at studio)	174 ft

WALL LEGEND

- W1 AAC exterior wall 200 mm
- W2 LGS steel stud partition
- W3 Acoustic steel stud (studio + bedrooms)
- W4 RC wall (pool, retaining, cistern, shear)
- L1 RC lintel over opening

ROOF FRAMING SCHEDULE

MARK	MEMBER	SECTION / SPEC	QTY
R1	Steel rafter	H-150 x 75 x 5 x 7, SS400, @ 1.2 m, cantilevers to eaves	84
P1	C-purlin	C-100 x 50 x 20 x 2.3, @ 1.1 m max	60
SK	Skylight trimmer	RHS 100 x 50 x 3.2 frame	4
--	Roof deck	Standing seam 0.5 mm AZ150 + 75 mm PIR + underlay	6
--	Connections	Rafter to RB1 via cast-in plate 200 x 200 x 12 + 4-M16 anchors	-
--	Corrosion	Hot-dip galvanized or 2-coat epoxy (humid mountain climate)	-

ROOF FRAMING LEGEND

- Steel rafter R1
- C-purlin P1
- Column below (bearing)

WALL TYPES (APPROVED STANDARD)

- W1 AAC Exterior: 200 mm AAC block in RC frame; exterior insulation or ventilated charred-timber cladding; lime plaster
- W2 Steel Stud: 92 mm LGS @ 400 mm, board both sides, mineral wool; cement board + membrane on wet faces
- W3 Acoustic Stud: Double/isolated LGS, 75 mm acoustic wool, 2 x sound board, resilient channel (studio + bedrooms)
- W4 RC Wall: Poured RC: pool, retaining walls, cistern, engineer-required shear walls only

WEBERMAN RESIDENCE

Mountain courtyard house, Thailand
Owner: Max Weberman

ISSUE

Design Development

NOT FOR CONSTRUCTION

DATE
11 Oct 2026

SCALE
3/32" = 1'-0"

MODEL
bim.json (from plan.json)

UNITS
Feet + inches (mm for members)

REVISION
DD-01

FRAMING NOTES

Interior LGS: 0.75 mm BMT studs, deflection head track at slab/beam.

AAC: thin-bed mortar; RC stiffener columns 100 x wall width at max 3 m and at openings > 2 m.

Studio double-stud walls on separate tracks + resilient ceiling (STC 60+).

STANDARD

No timber framing (termites): RC frame, AAC, LGS studs, steel roof.

Poured concrete only at pool, retaining walls, cistern and engineer-required shear walls (W4).

SHEET TITLE

Wall Framing + Roof Framing Plans

SHEET

S-102