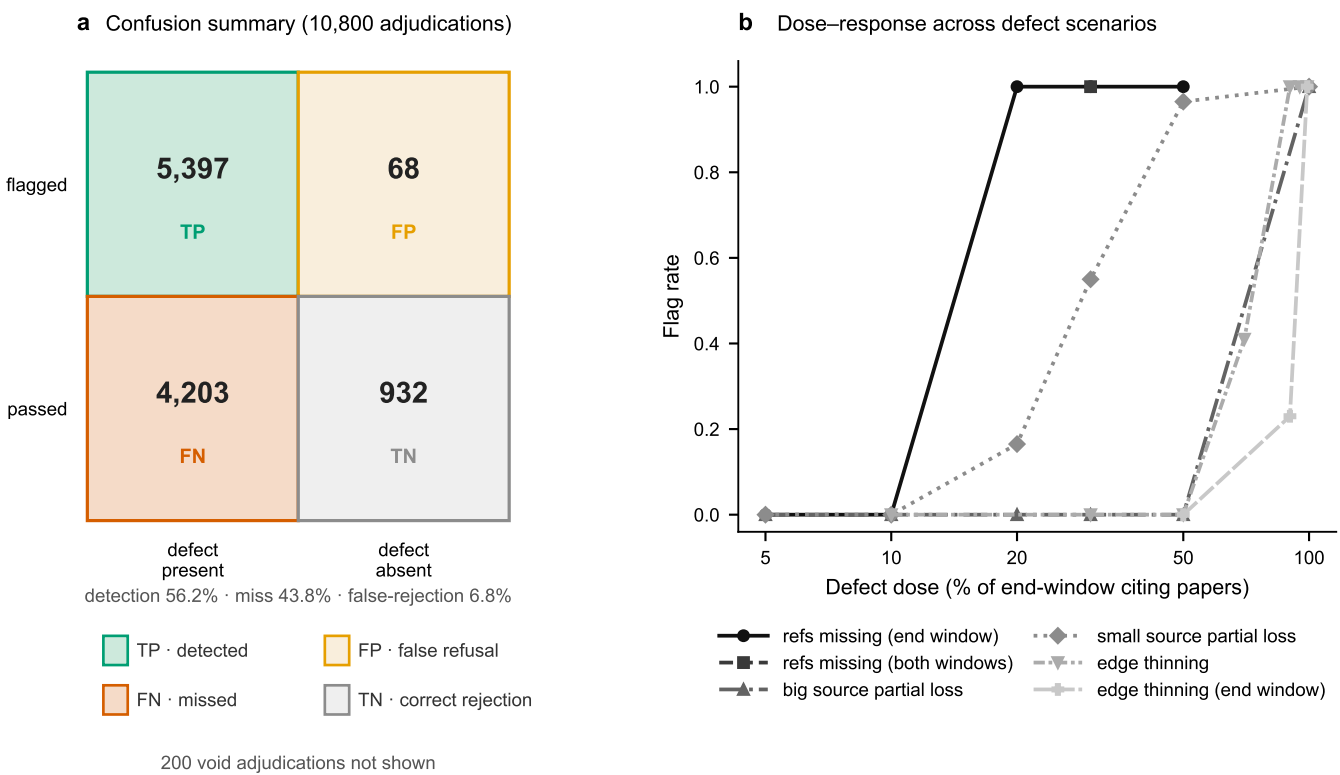
a Confusion summary (10,800 adjudications)
flagged
passed
5,397
TP
68
FP
4,203
FN
932
TN
defect present
defect absent
detection 56.2% · miss 43.8% · false-rejection 6.8%
TP · detected
FP · false refusal
FN · missed
TN · correct rejection
200 void adjudications not shown
b Dose–response across defect scenarios
Flag rate
1.0
0.8
0.6
0.4
0.2
0.0
5
10
20
50
100
Defect dose (% of end-window citing papers)
refs missing (end window)
refs missing (both windows)
big source partial loss
small source partial loss
edge thinning
edge thinning (end window)