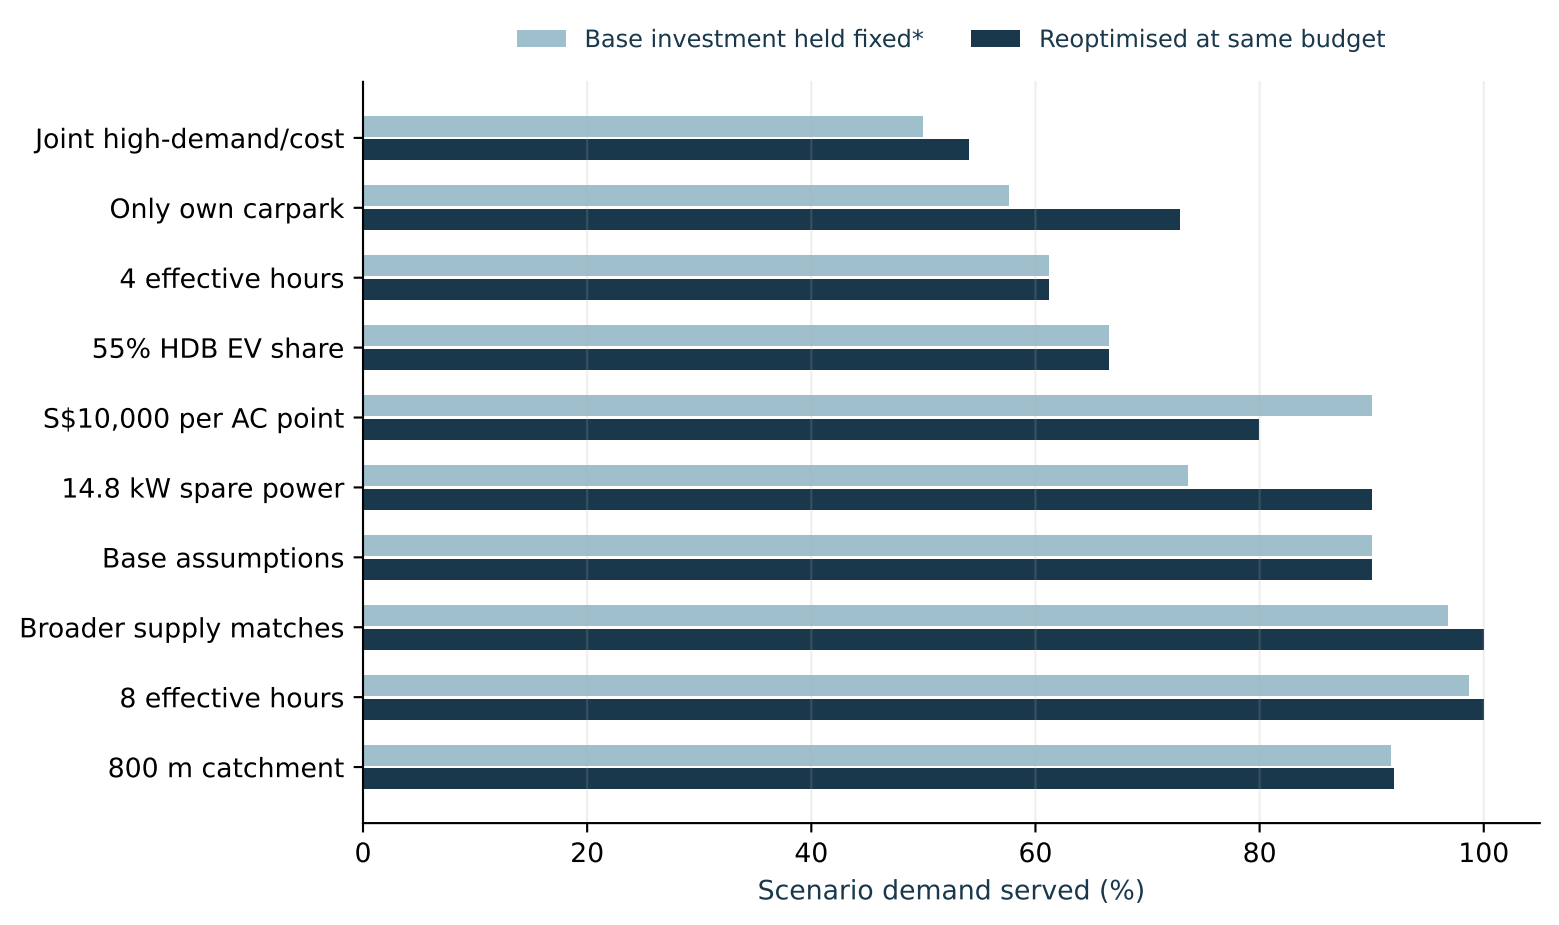
Base investment held fixed*
Reoptimised at same budget
Joint high-demand/cost
Only own carpark
4 effective hours
55% HDB EV share
S$10,000 per AC point
14.8 kW spare power
Base assumptions
Broader supply matches
8 effective hours
800 m catchment
0
20
40
60
80
100
Scenario demand served (%)