Static electrical model — not a physical medium

Spherical mode $\ell = 0$ • Fixed approximate geometry • D = electric displacement, not voltage

A. Join finite regions; outer source still unknown

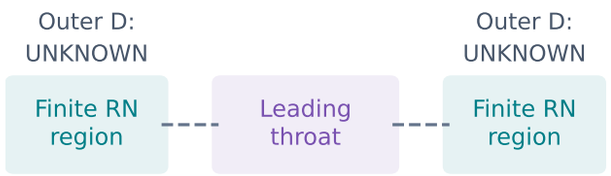

Response matrices • Leading overlap
Schematic regions, not to scale

Arbitrary outer test: (1, 1)

$D_{center}/D_{outer} \approx 1.399 \times 10^{-33}$

Static screening only

B. One radial RN segment: unit outer displacement

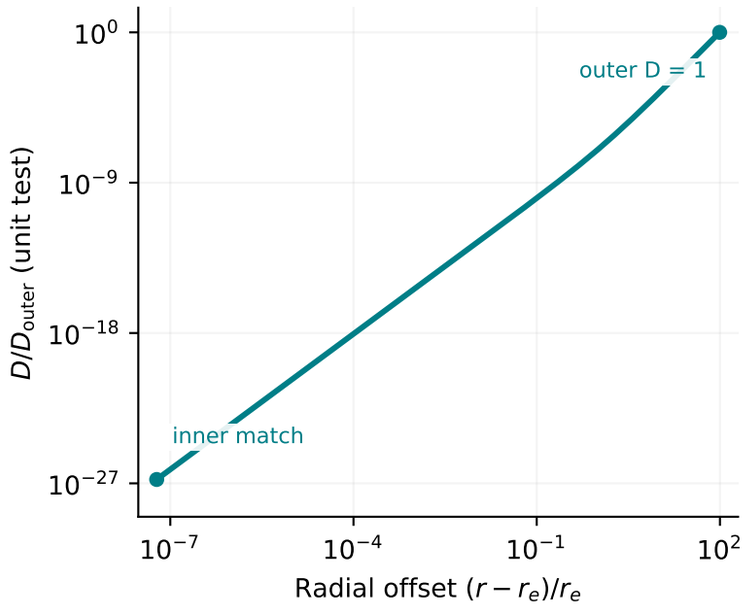

All D values use one direction through the model.
Equal test values mean opposite outward radial flux.

ρcut = 100; the curve stops at the throat match.
The throat center is not on this radial curve.

C. Omitting the mass deficit underestimates the center response

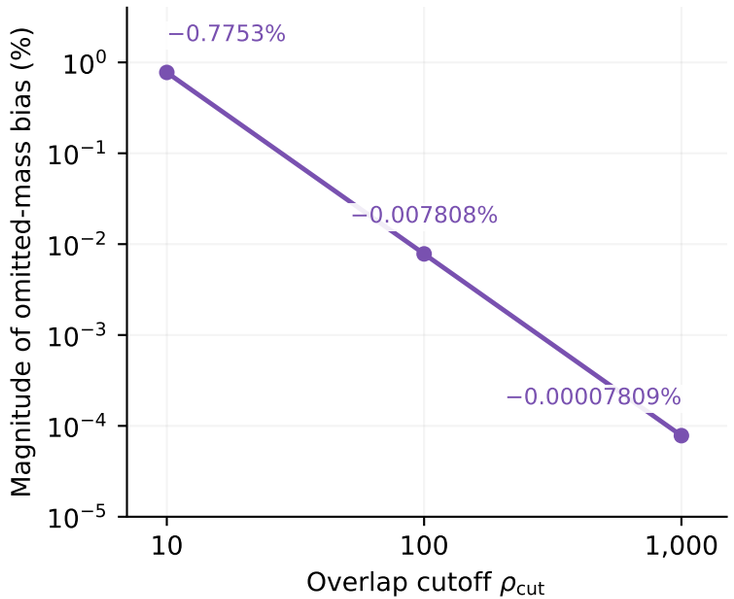

Corrected cut spread: 8.31e-11 (relative).
Internal consistency, not physical accuracy.

Charged action and overlap: MMP, Appendix A, Eqs. 5.39–5.42. Finite-region response matrices: our application.

Sphere-profile, lapse and radial corrections remain omitted; no actual outer source or self-consistent geometry is fixed.

No stable medium or 13 → 12 Sep 2027 passage established.