Two null-direction phase contrasts inside a prescribed throat

Compact clock, radial-length and shift probes · Phase π minus phase 0 · One retained sector

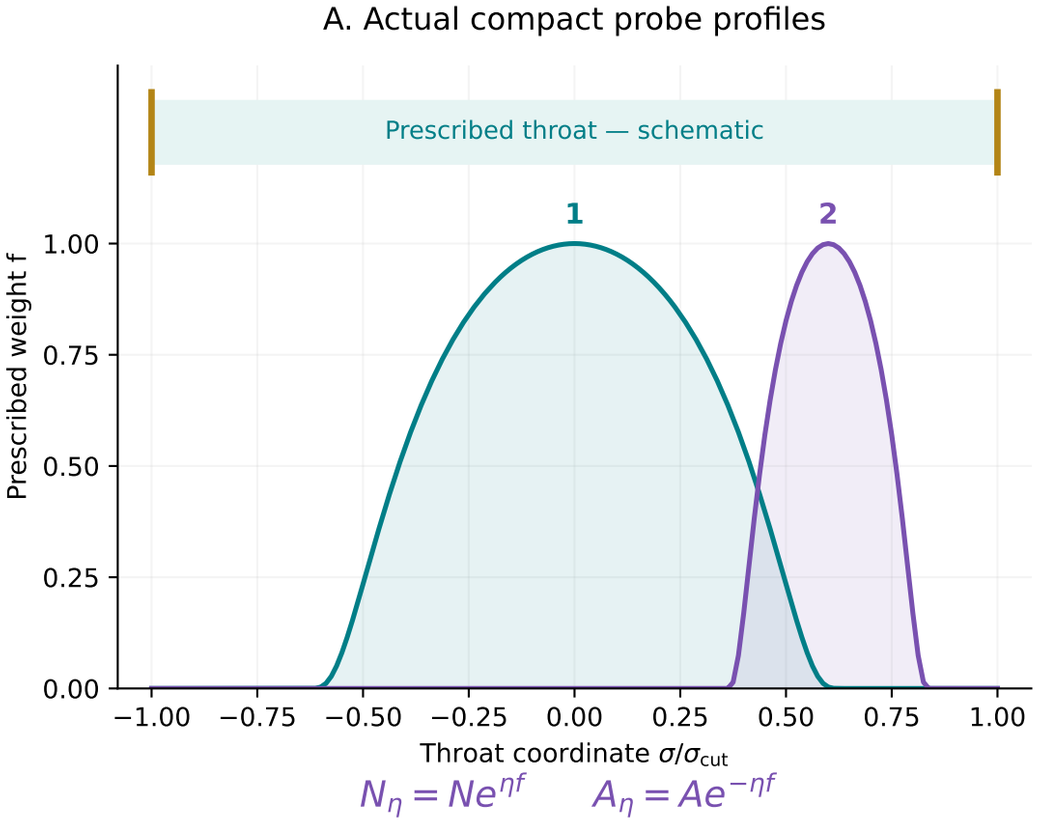

A compact shift separately probes radial energy flow.

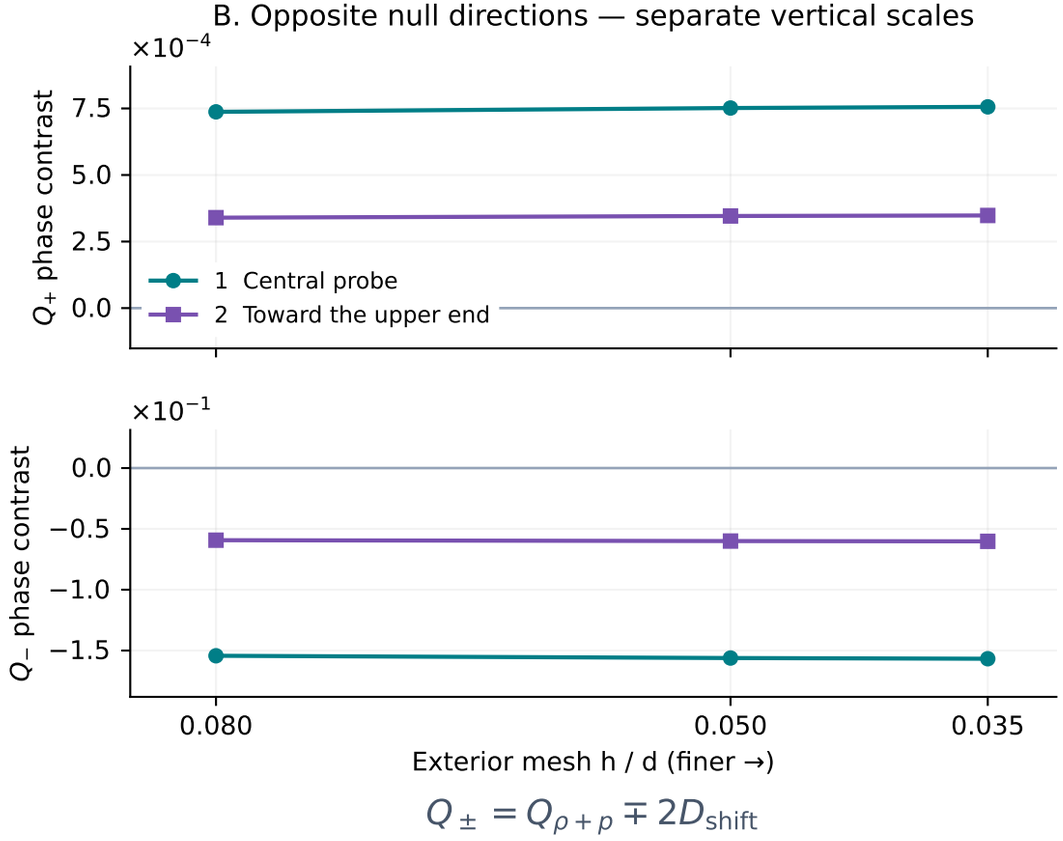

Raw weighted phase differences; no volume normalization.

Window 1e-06 ≤ κd ≤ 12. Largest latest mesh changes: Q+ 4.4e-06, Q− 0.000578. Normalized units: $\hbar = c = d = 1$.

Near cancellation needs absolute sensitivity checks. Mesh changes are diagnostics, not certified continuum or frequency-tail bounds.

These contrasts do not establish absolute NEC violation or supply the required supporting source; the geometry remains prescribed.

No stable medium or 13 Sep 2027 → 12 Sep 2027 passage demonstrated.