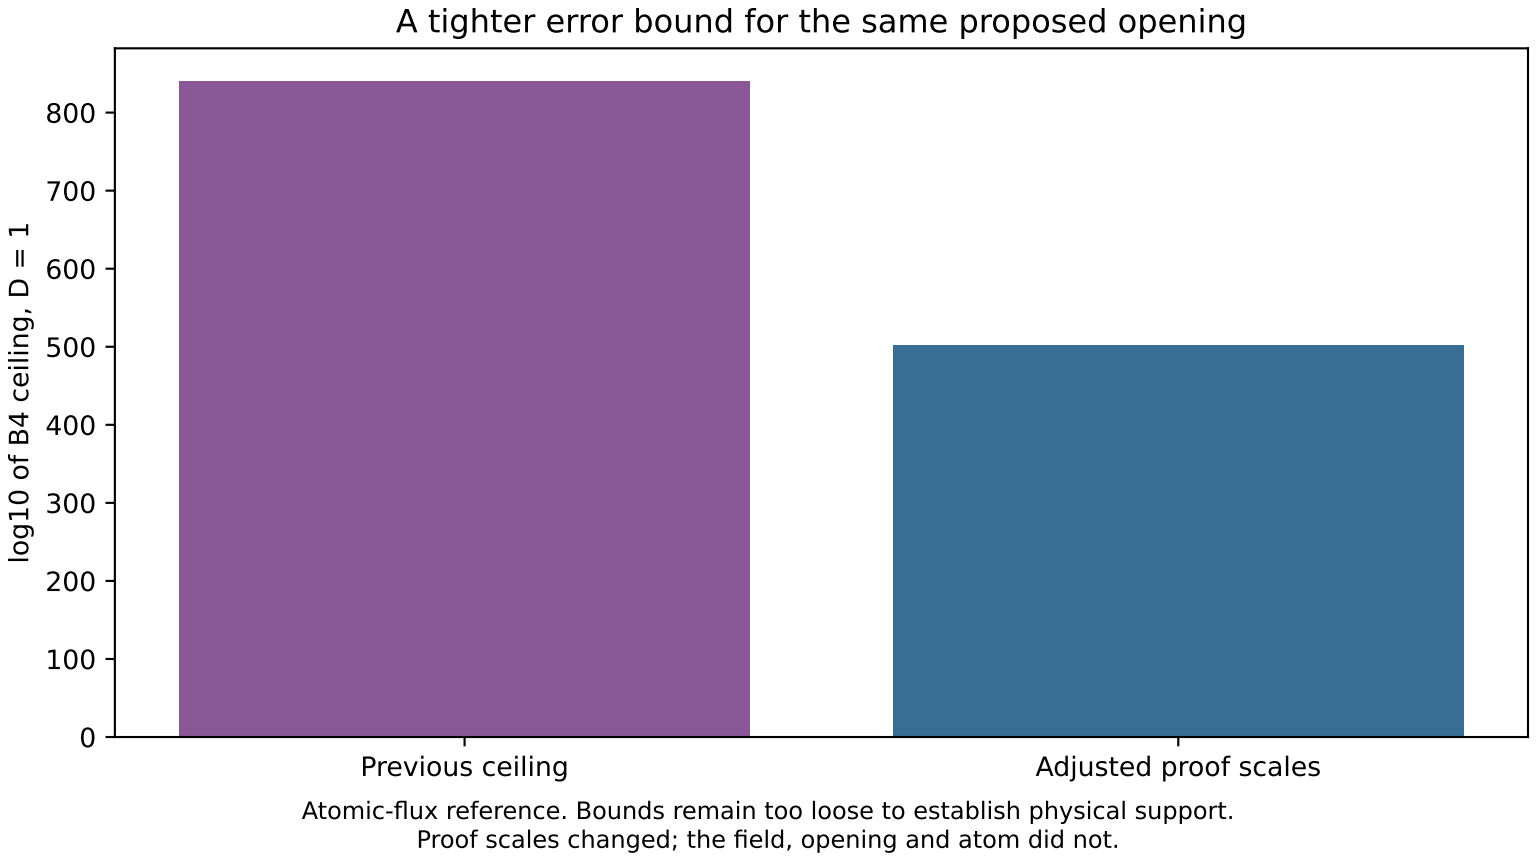
A tighter error bound for the same proposed opening
log10 of B4 ceiling, D = 1
0
100
200
300
400
500
600
700
800
Previous ceiling
Adjusted proof scales
Atomic-flux reference. Bounds remain too loose to establish physical support.
Proof scales changed; the field, opening and atom did not.