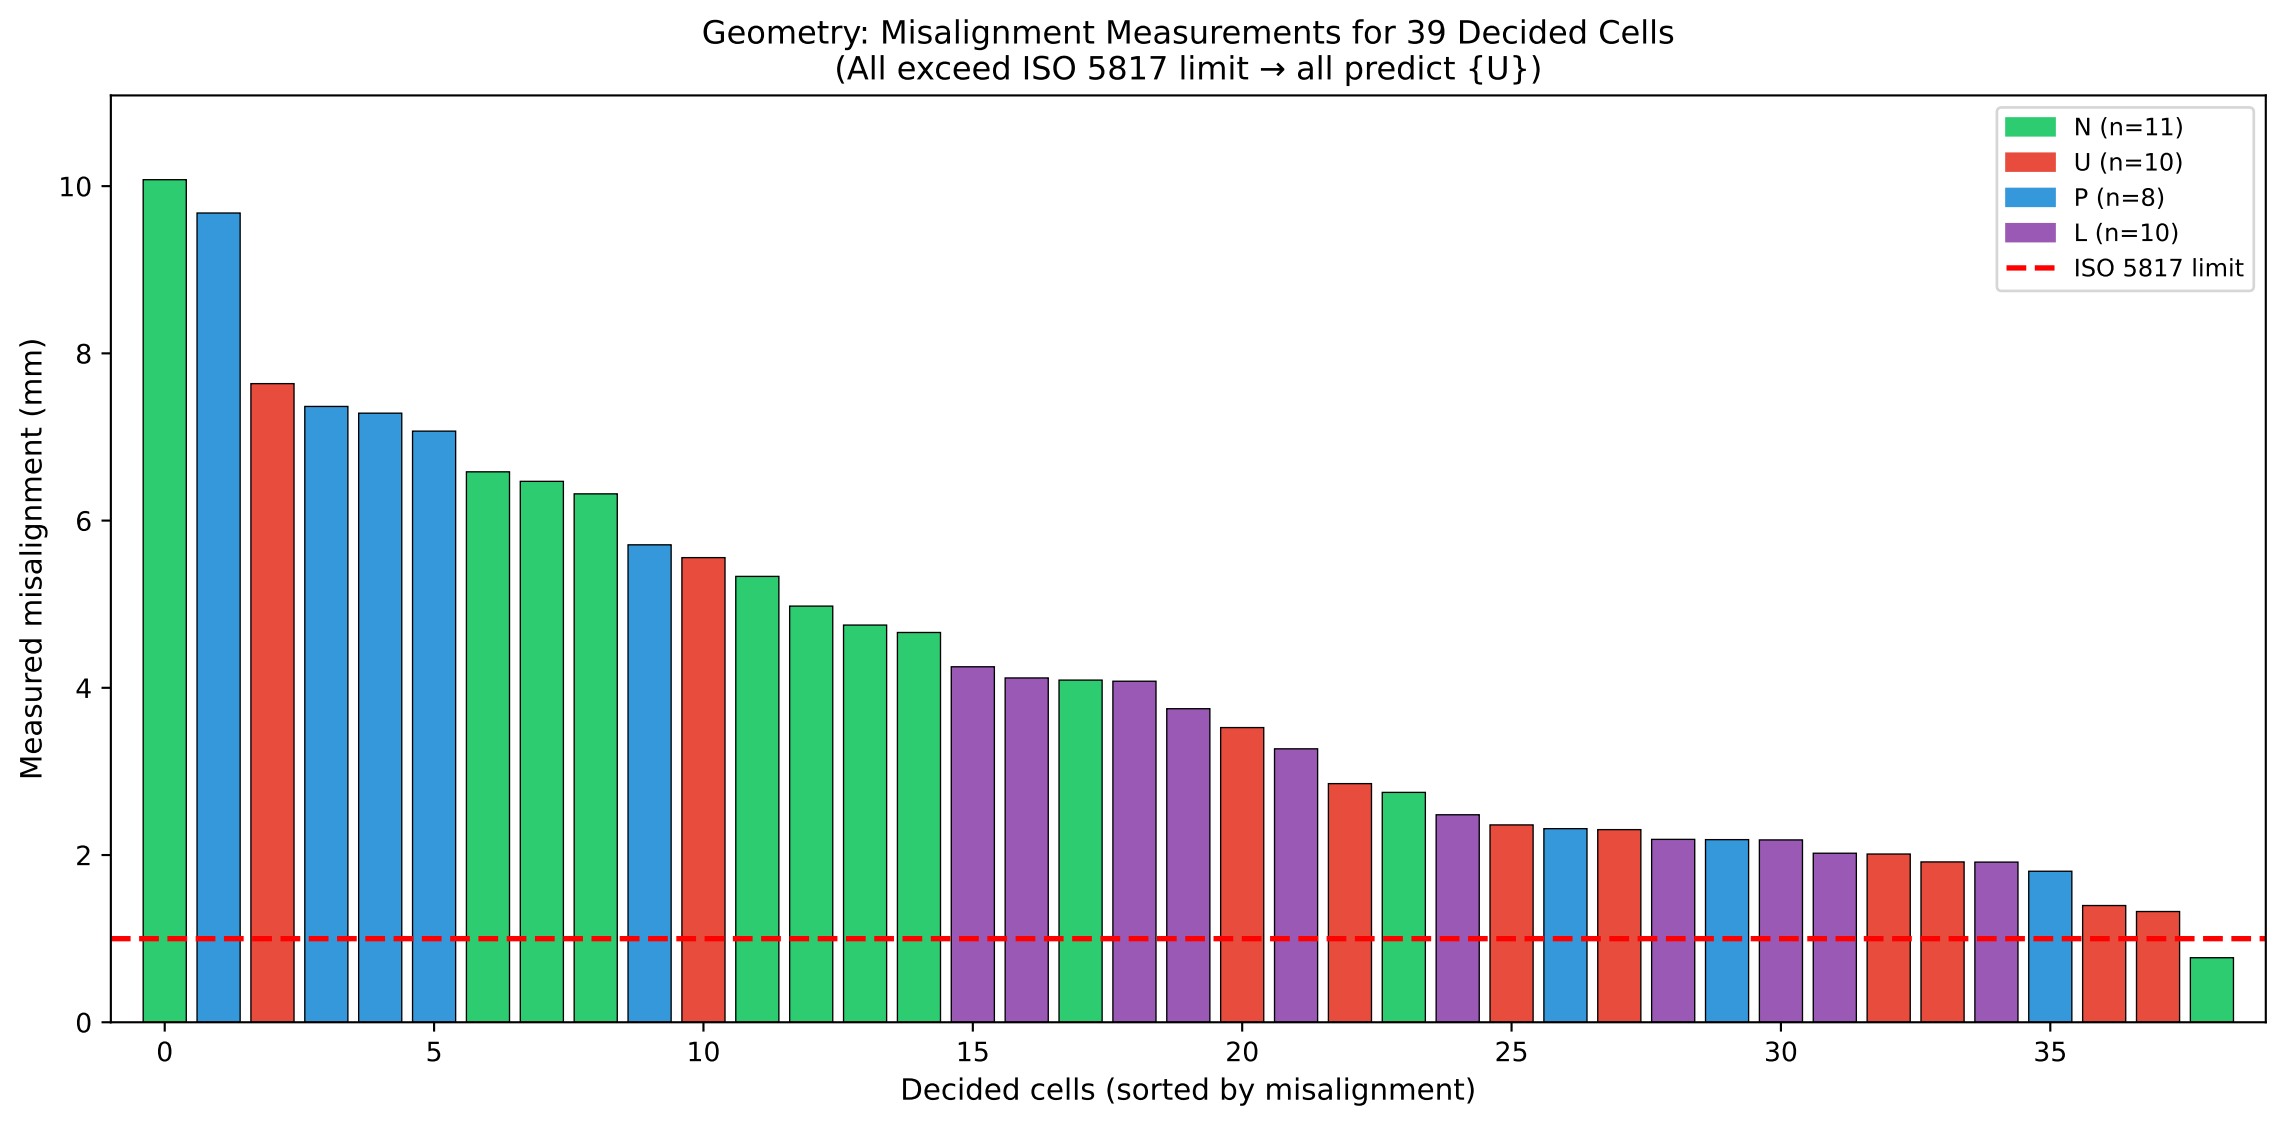
Geometry: Misalignment Measurements for 39 Decided Cells
(All exceed ISO 5817 limit → all predict {U})
N (n=11)
U (n=10)
P (n=8)
L (n=10)
ISO 5817 limit
Measured misalignment (mm)
Decided cells (sorted by misalignment)
0
2
4
6
8
10
0
5
10
15
20
25
30
35