


Conditional first phase: 5 MW IT / 6.25 MW facility

All equipment sizes are design assumptions. Full 25 MW would require a separate engineering design.

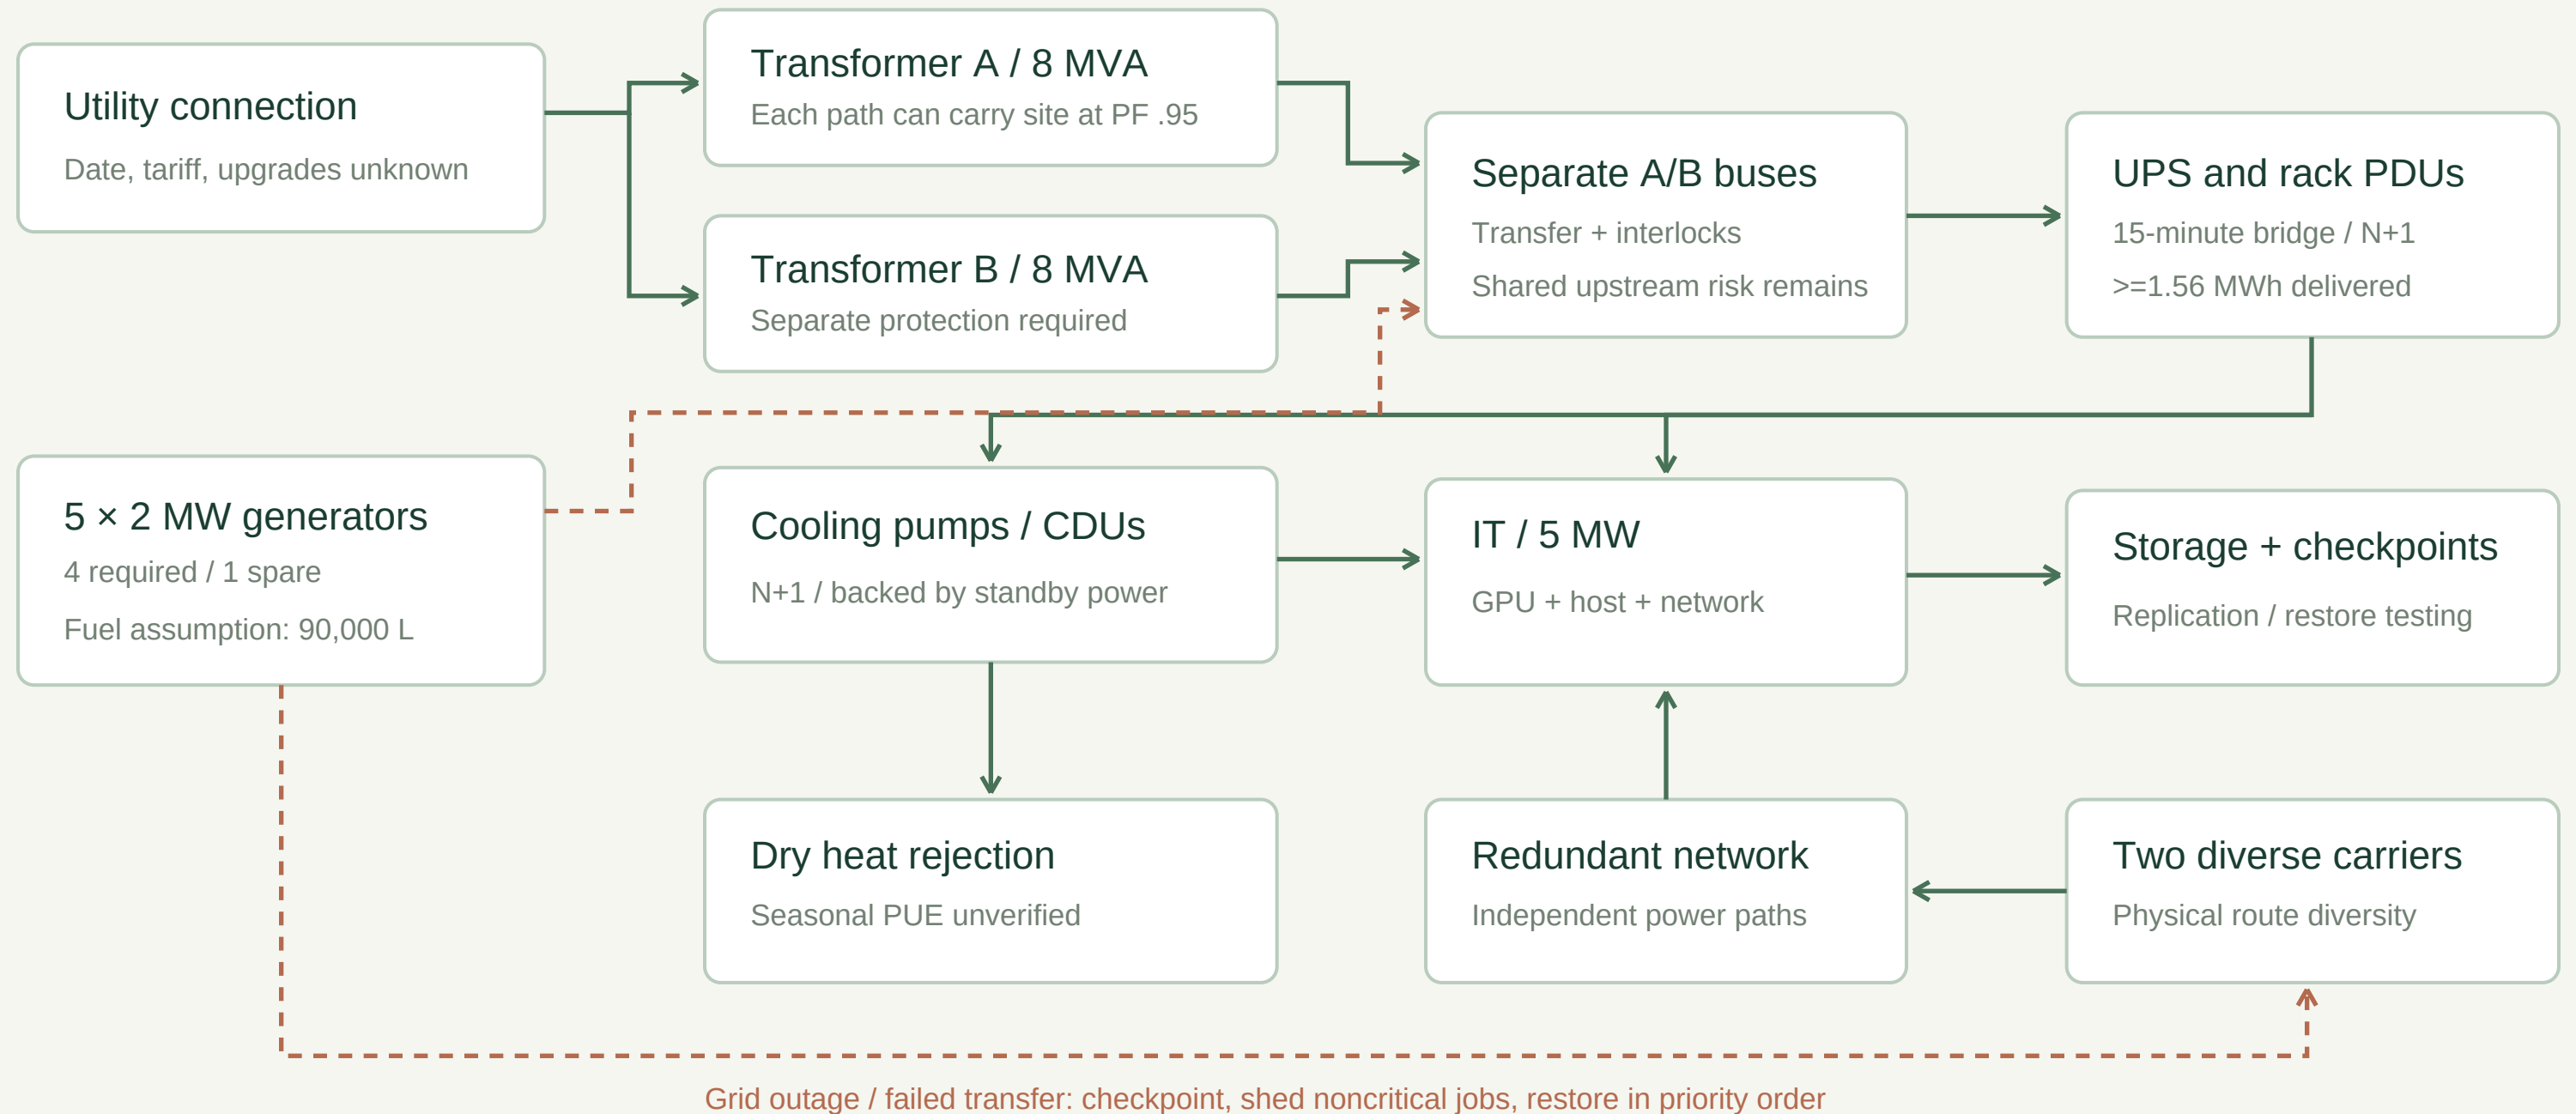

FAILURE CASE 1

Loss of one transformer: remaining 8 MVA path must carry 6.25 MW without overload.

FAILURE CASE 2

48-hour outage: 300 MWh, fuel logistics, cooling and black-start tests required. Uptime unverified.