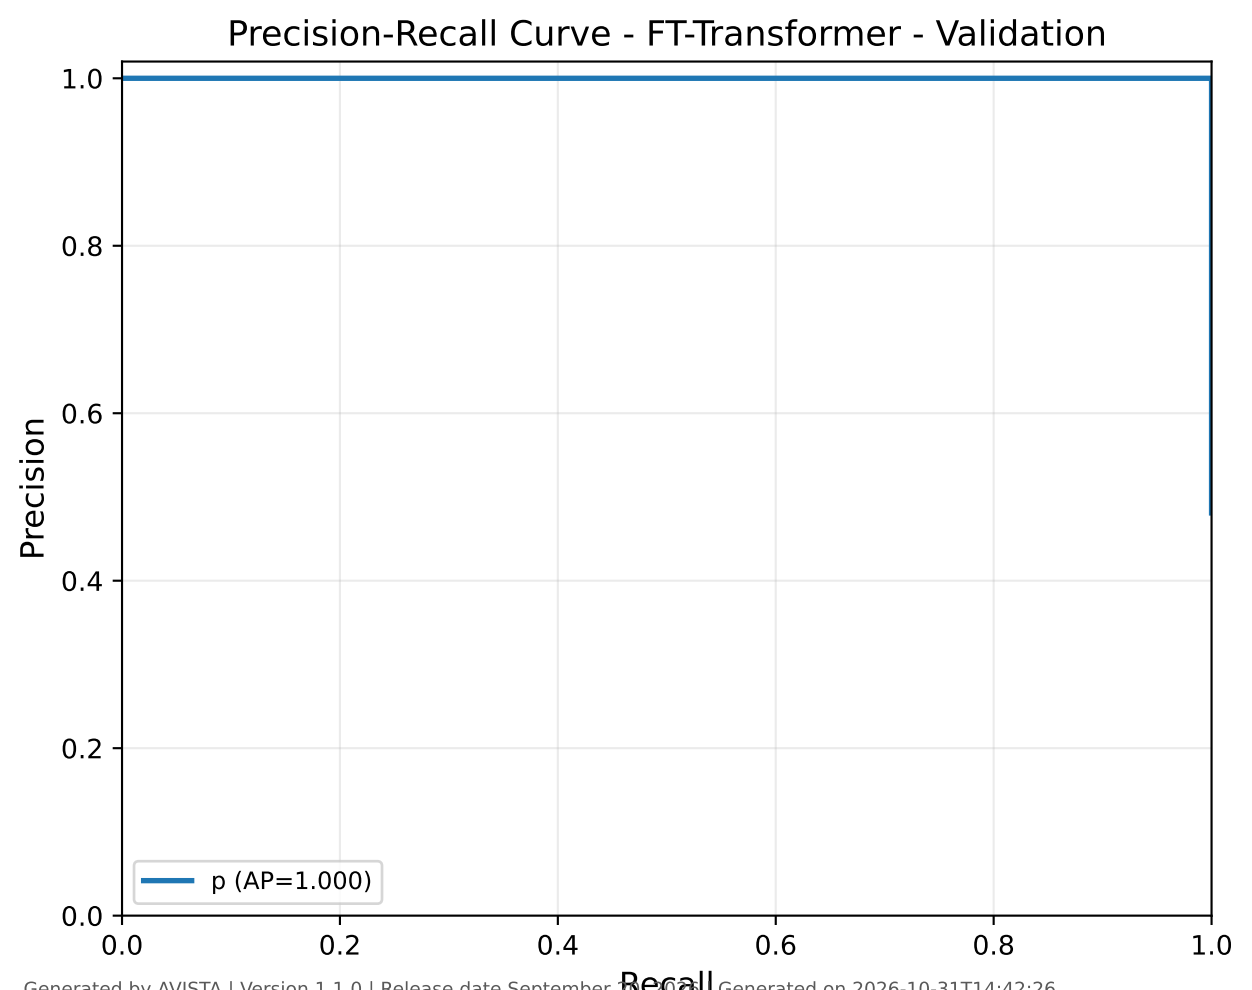
Precision-Recall Curve - FT-Transformer - Validation
Precision
Recall
p (AP=1.000)
1.0
0.8
0.6
0.4
0.2
0.0
0.0
0.2
0.4
0.6
0.8
1.0
Generated by AVISTA | Version 1.1.0 | Release date September 2025 | Generated on 2026-10-31T14:42:26