


Power delivery path: TVA generation to JEA customer, with cross-ties

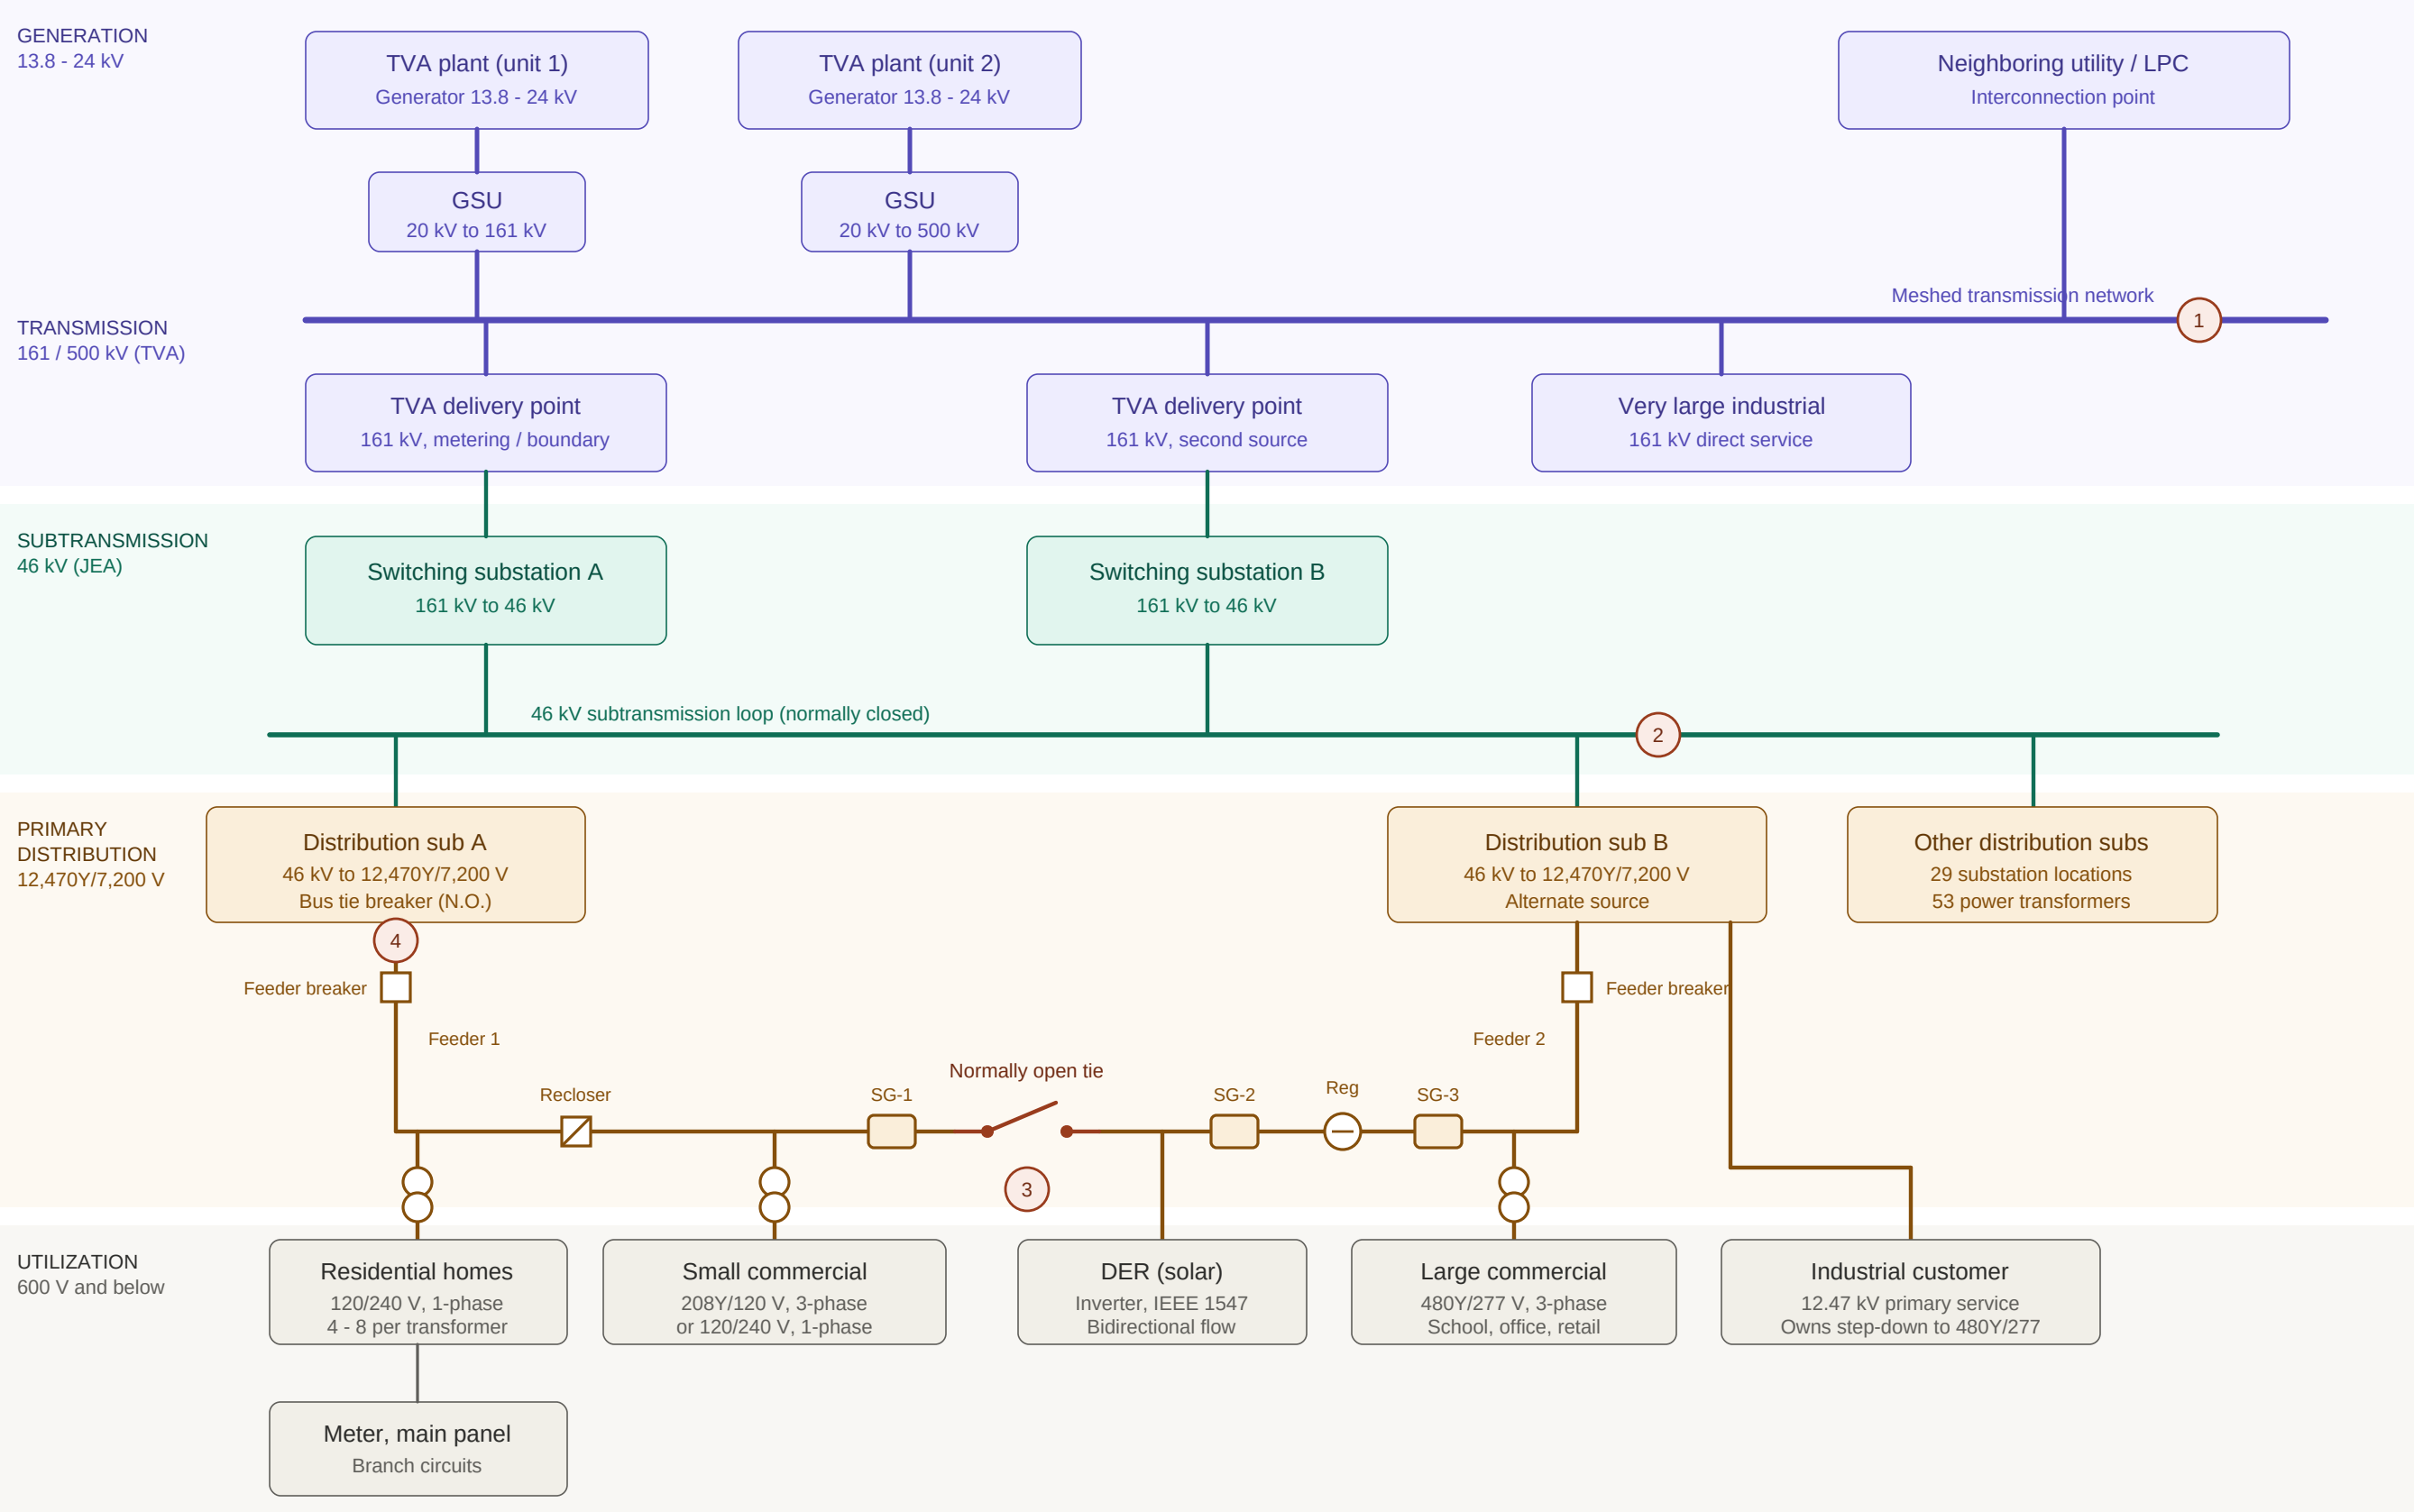

SYMBOLS

 Circuit breaker

 Recloser (Viper ST)

 Pad-mount switchgear

 Voltage regulator

 Distribution transformer

 Open tie switch

CROSS-TIES

1 - Transmission interconnection: TVA network is a mesh, tied to neighboring utilities and LPCs.

2 - 46 kV subtransmission loop tie, normally closed. Two sources feed one loop.

3 - Distribution feeder tie, normally OPEN. This is the FLISR restoration path.

4 - Substation bus tie breaker, normally open. Backs up a failed transformer in the same sub.