


REV B-ES1: CLASSIC ROOM SENSOR ENGINEERING SAMPLE

WARNING: validate KTY and 0-10 V interfaces on dummy loads before IDM connection

24 V Input protection and passive KTY path

Local humidity acquisition and 0-10 V output

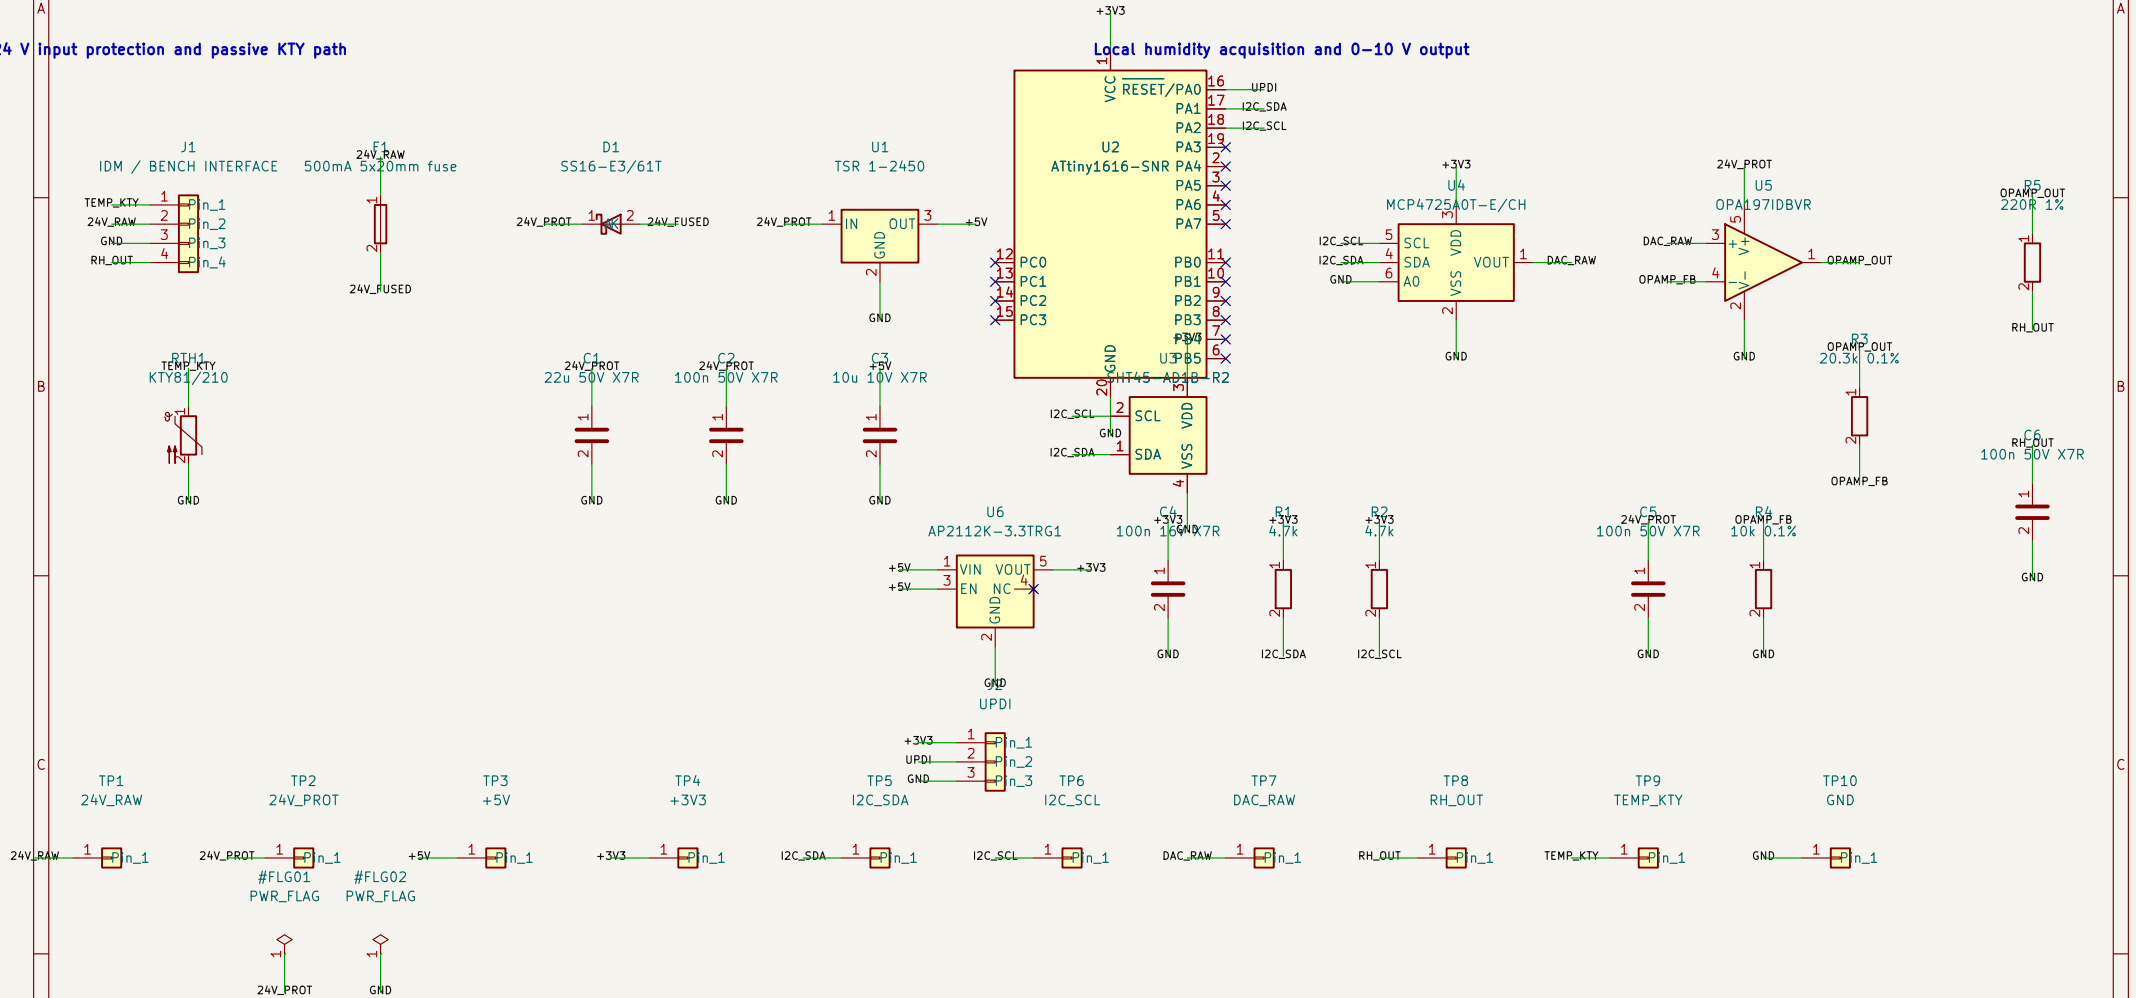

24 V nominal engineering sample
KTY81/210 passive temperature path; 0-10 V active humidity path
BENCH TEST FIRST - IDM CONNECTION ONLY AFTER INTERFACE VALIDATION
IDM Smart Climate Platform

Sheet: /
File: IDM-RoomSensor-Classic-B-ES1.kicad_sch

Title: IDM Room Sensor Classic - engineering sample

Size: A4 Date: 2026-08-07

KiCad E.D.A. 10.0.5

Rev: B-ES1

Id: 1/1