Fig S Chamber-reversal panel size sensitivity grid (MAG_HEALTHY × MAG_AF × MIN_COHORTS)

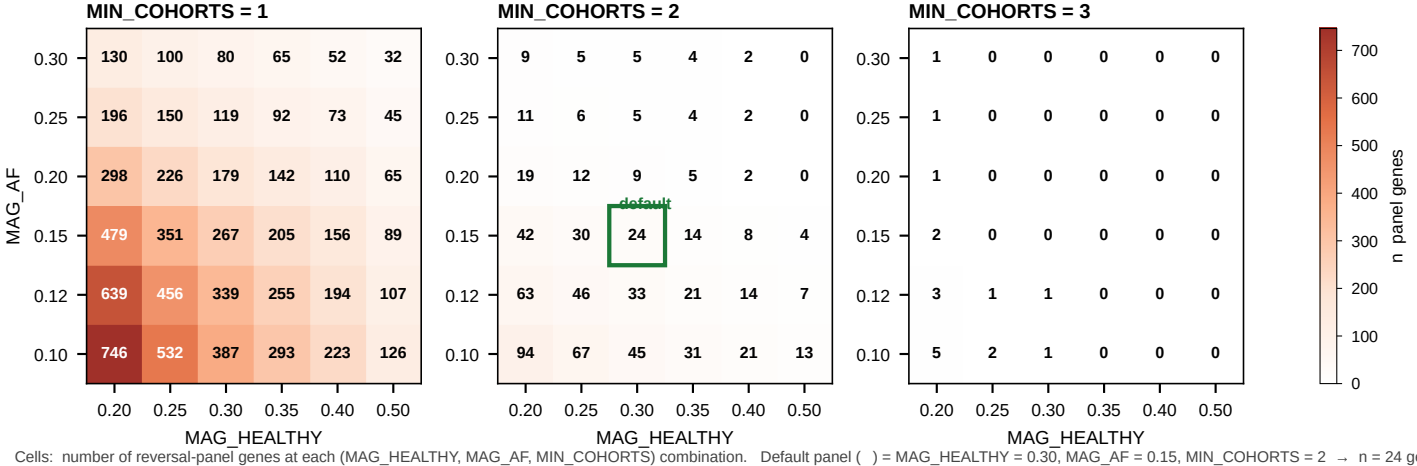

Cells: number of reversal-panel genes at each (MAG_HEALTHY, MAG_AF, MIN_COHORTS) combination. Default panel ( ) = MAG_HEALTHY = 0.30, MAG_AF = 0.15, MIN_COHORTS = 2 → n = 24 ge