


Unit-equal improvement $100[1 - \exp(r)]$ in hourly RMS, 95% unit-and-month bootstrap intervals; filled = interval excludes zero, red = ANKYRA worse.
 Above the dashed line: the five baselines given ANKYRA's information set. Below: foundation models and statistical models on load only.

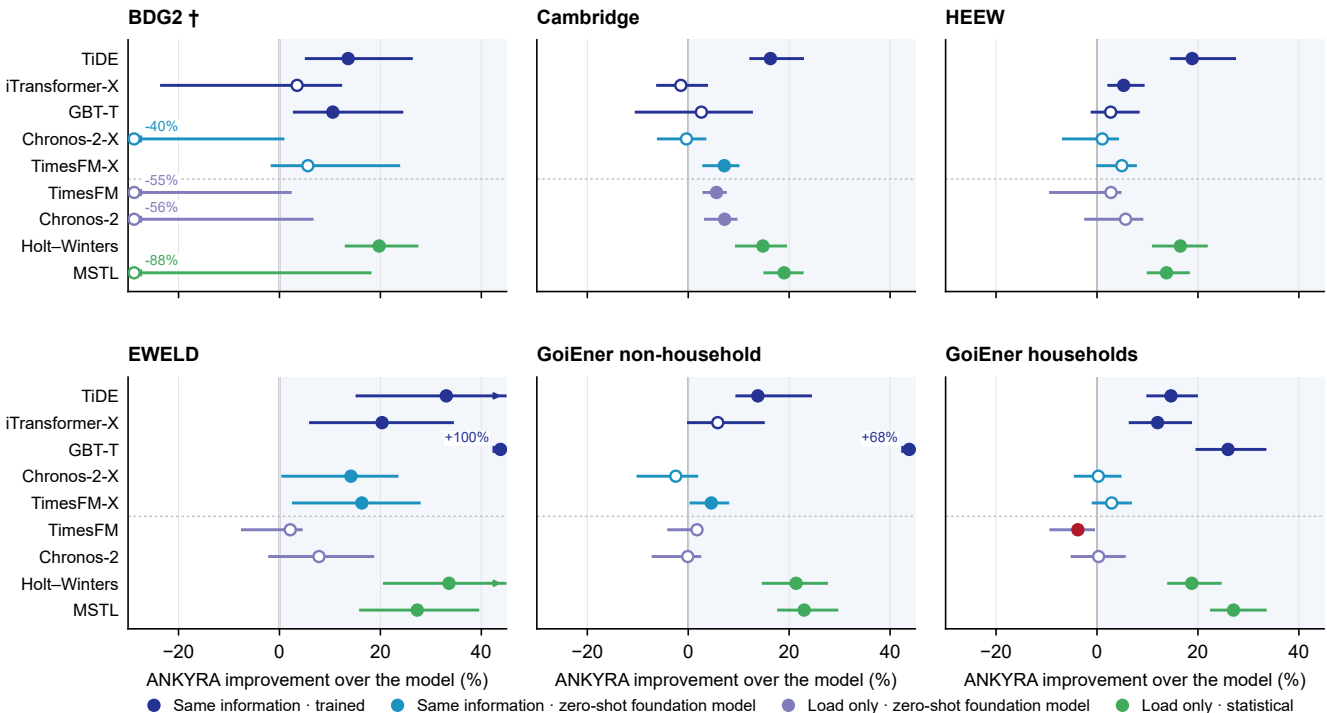

† The BDG2 unit mean is pulled by three meters reading ≈ 0.0002 kW (above the off-state threshold). Against all nine models the median unit favours ANKYRA (59–92% of units).