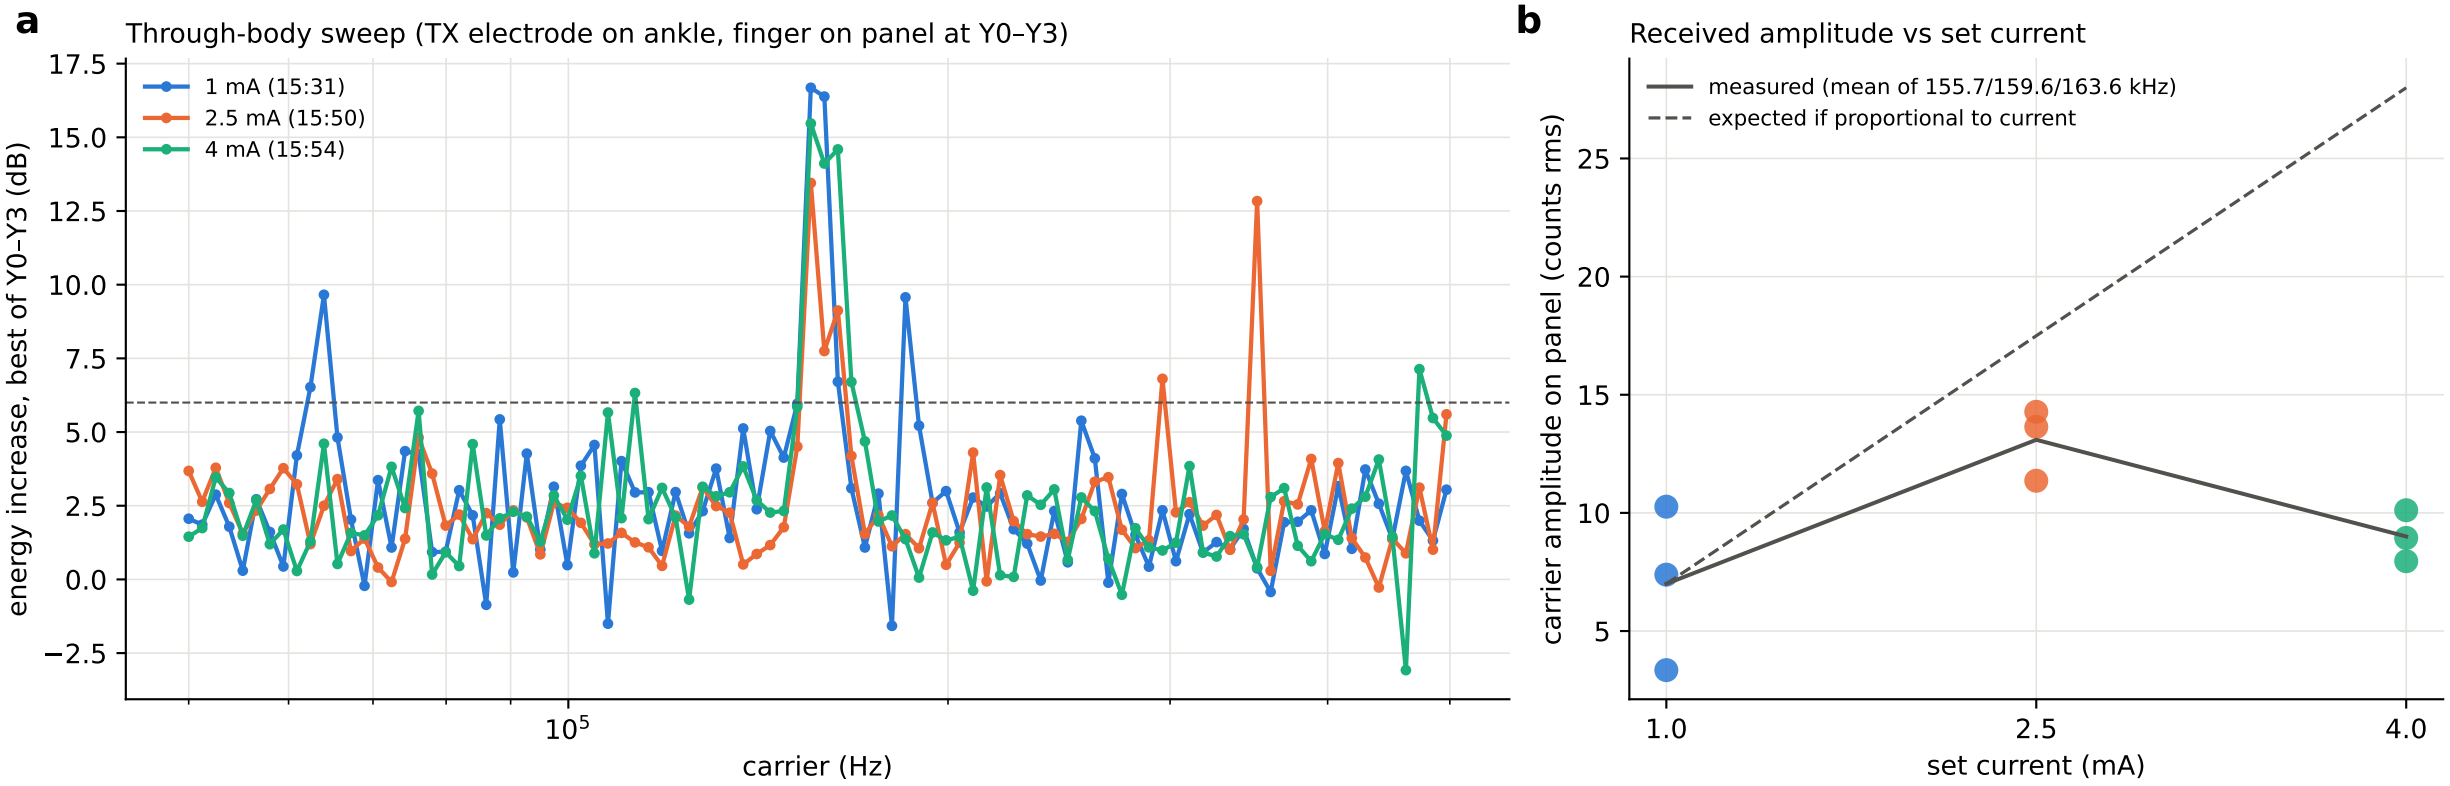
a
Through-body sweep (TX electrode on ankle, finger on panel at Y0–Y3)
1 mA (15:31)
2.5 mA (15:50)
4 mA (15:54)
energy increase, best of Y0–Y3 (dB)
17.5
15.0
12.5
10.0
7.5
5.0
2.5
0.0
−2.5
10^5
carrier (Hz)
b
Received amplitude vs set current
measured (mean of 155.7/159.6/163.6 kHz)
expected if proportional to current
carrier amplitude on panel (counts rms)
25
20
15
10
5
1.0
2.5
4.0
set current (mA)