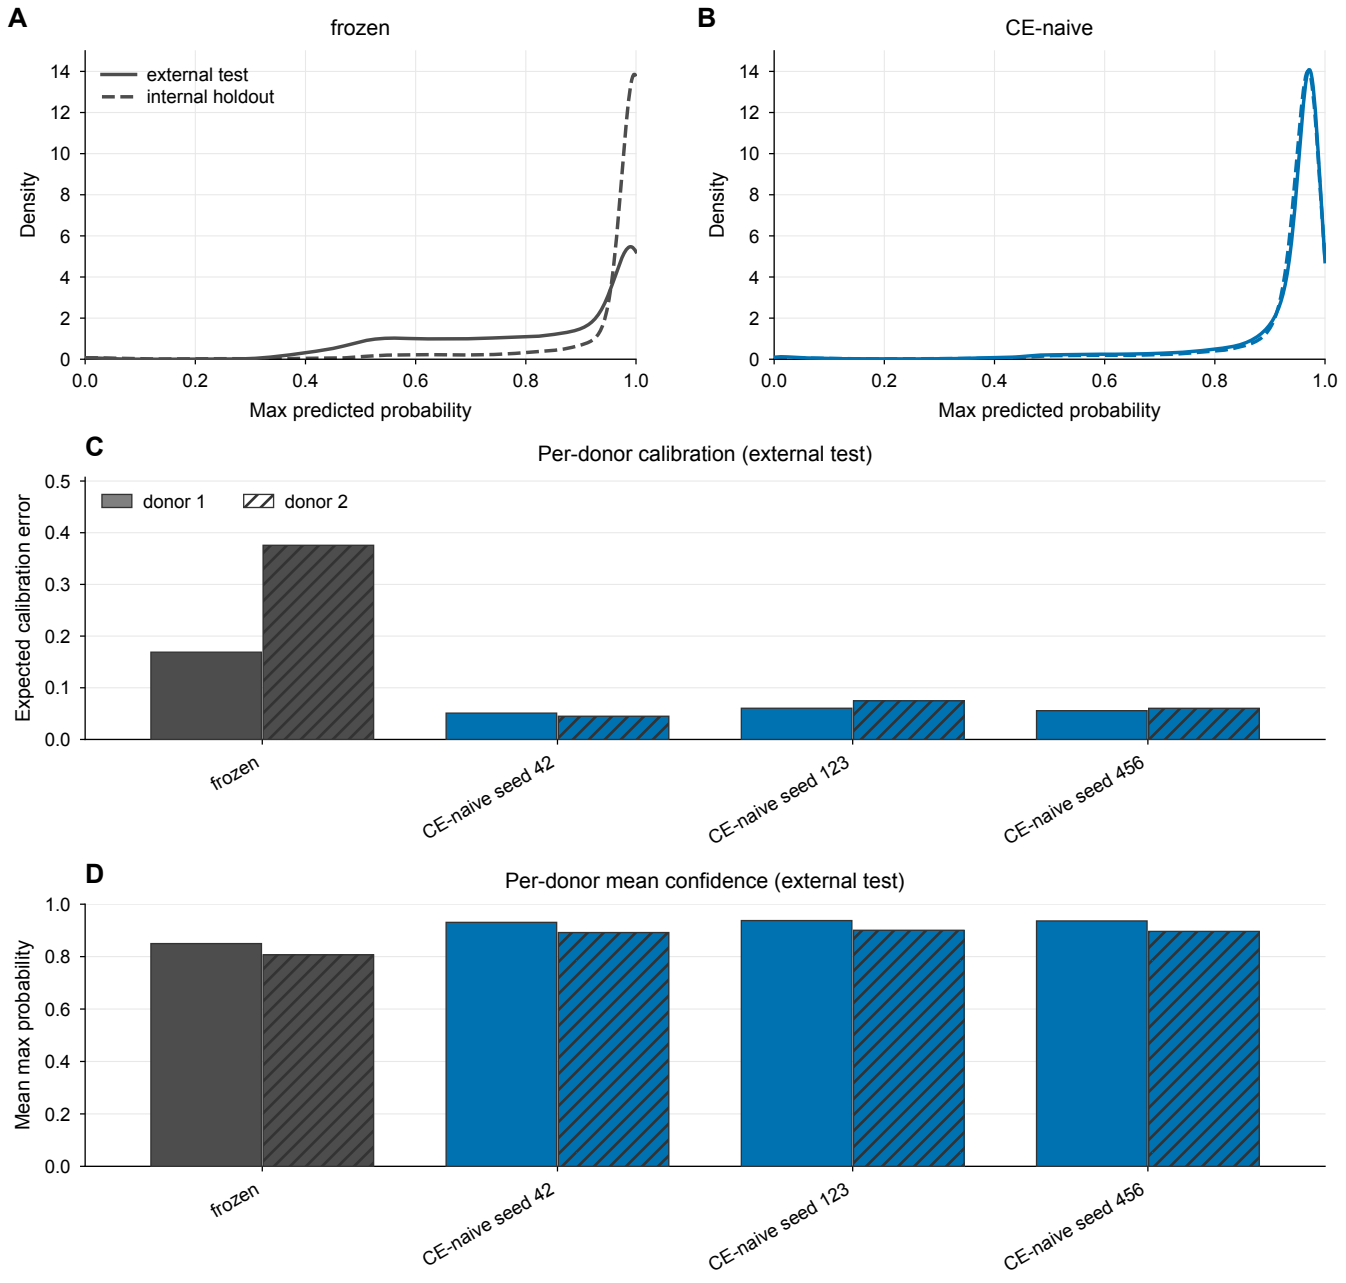
A
frozen
external test
internal holdout
Density
Max predicted probability
B
CE-naive
Density
Max predicted probability
C
Per-donor calibration (external test)
donor 1
donor 2
Expected calibration error
frozen
CE-naive seed 42
CE-naive seed 123
CE-naive seed 456
D
Per-donor mean confidence (external test)
Mean max probability
frozen
CE-naive seed 42
CE-naive seed 123
CE-naive seed 456