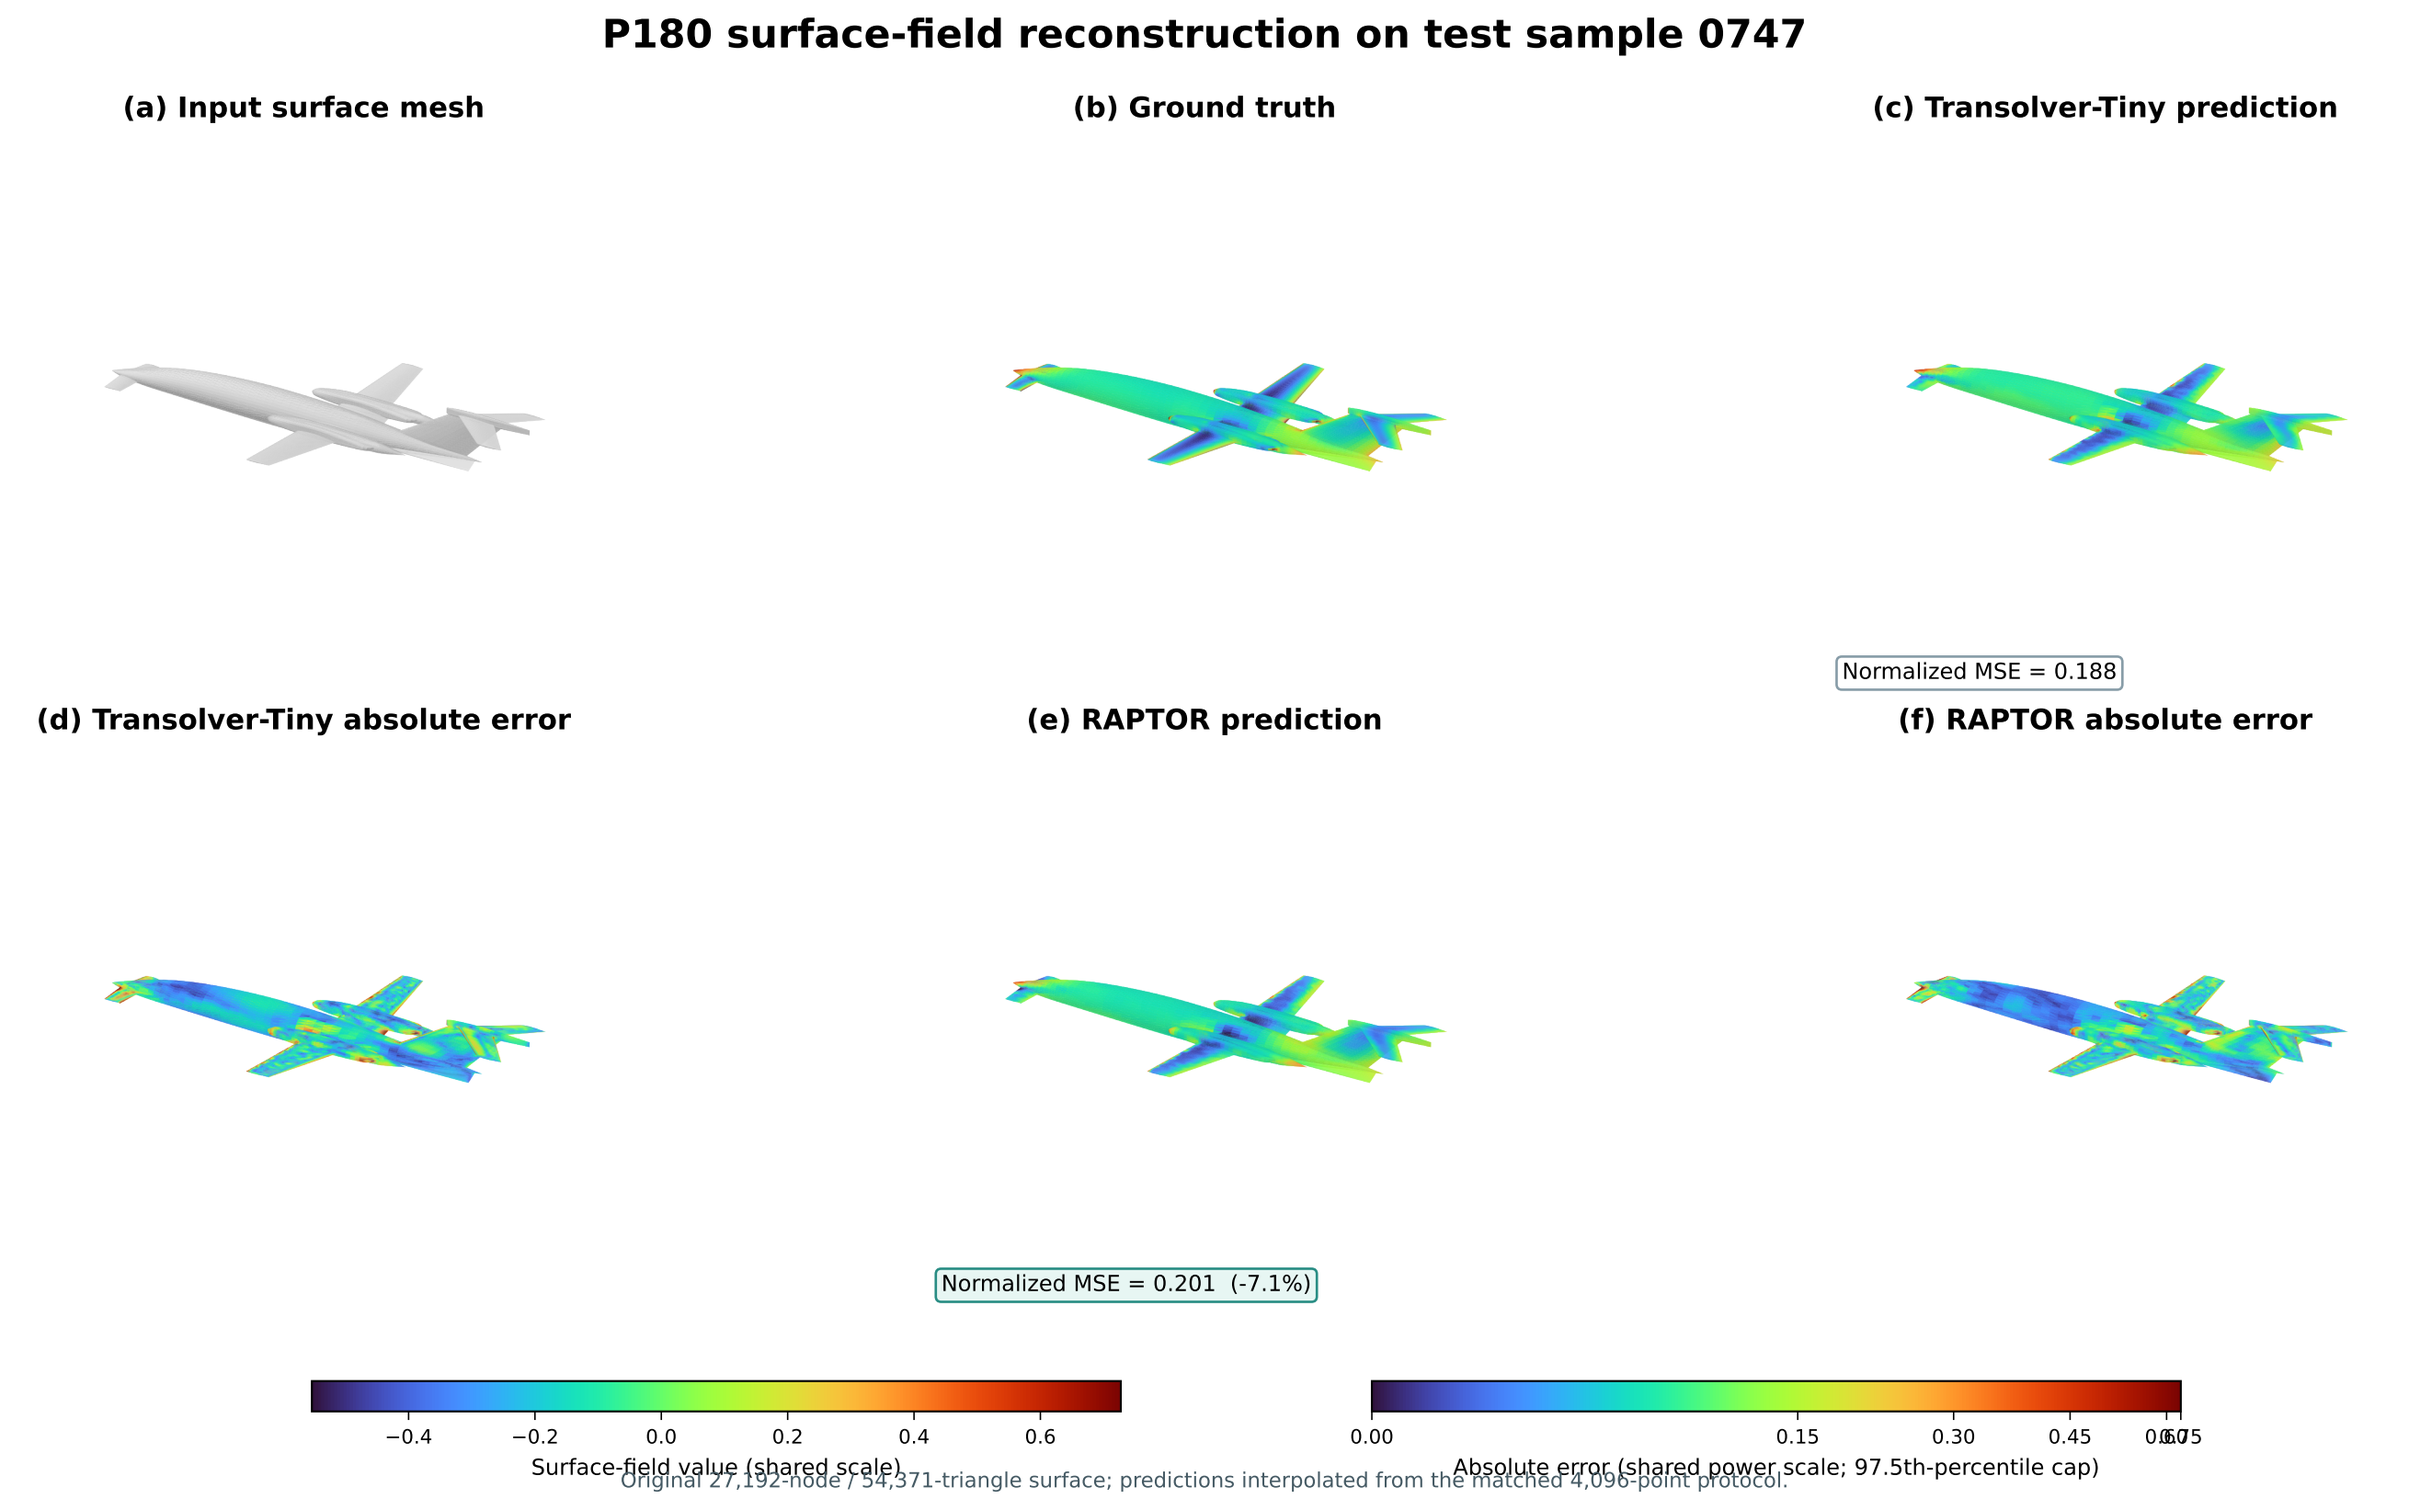

P180 surface-field reconstruction on test sample 0747
(a) Input surface mesh
(b) Ground truth
(c) Transolver-Tiny prediction
Normalized MSE = 0.188
(d) Transolver-Tiny absolute error
(e) RAPTOR prediction
(f) RAPTOR absolute error
Normalized MSE = 0.201 (-7.1%)
−0.4
−0.2
0.0
0.2
0.4
0.6
Surface-field value (shared scale)
0.00
0.15
0.30
0.45
0.60
0.75
Absolute error (shared power scale; 97.5th-percentile cap)
Original 27,192-node / 54,371-triangle surface; predictions interpolated from the matched 4,096-point protocol.