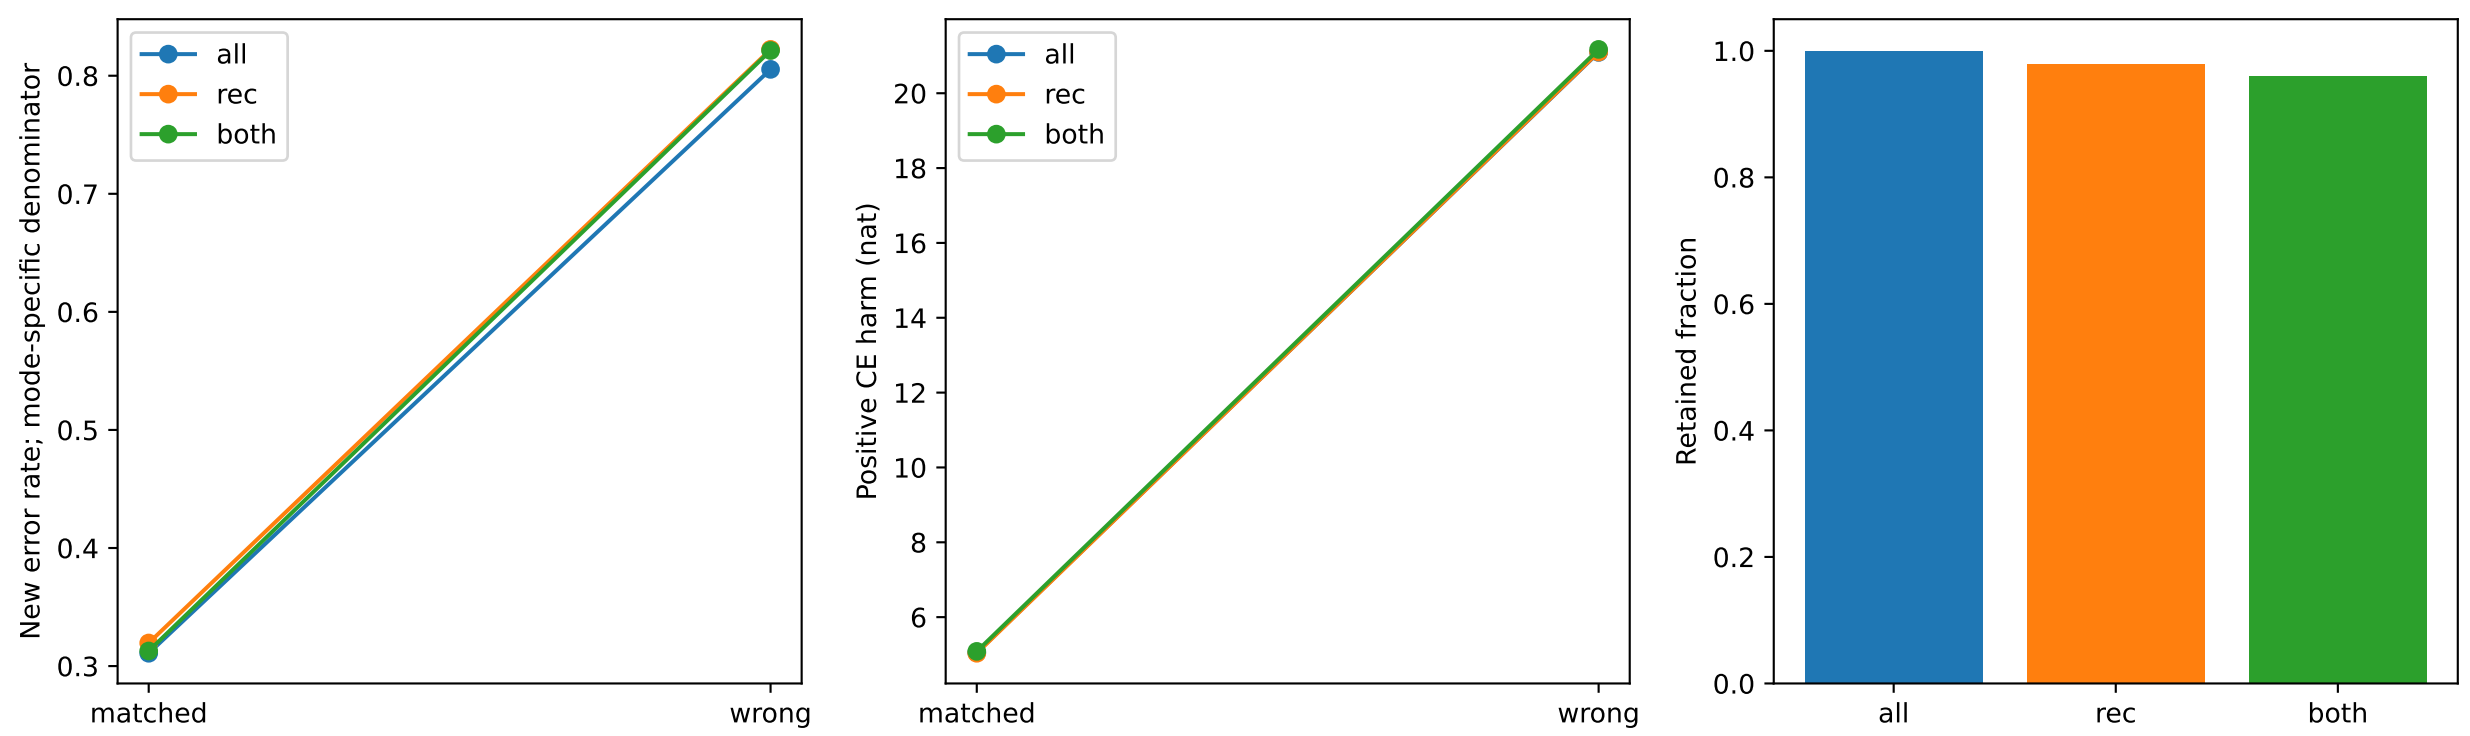
New error rate; mode-specific denominator
0.3
0.4
0.5
0.6
0.7
0.8
all
rec
both
matched
wrong
Positive CE harm (nat)
6
8
10
12
14
16
18
20
all
rec
both
matched
wrong
Retained fraction
0.0
0.2
0.4
0.6
0.8
1.0
all
rec
both