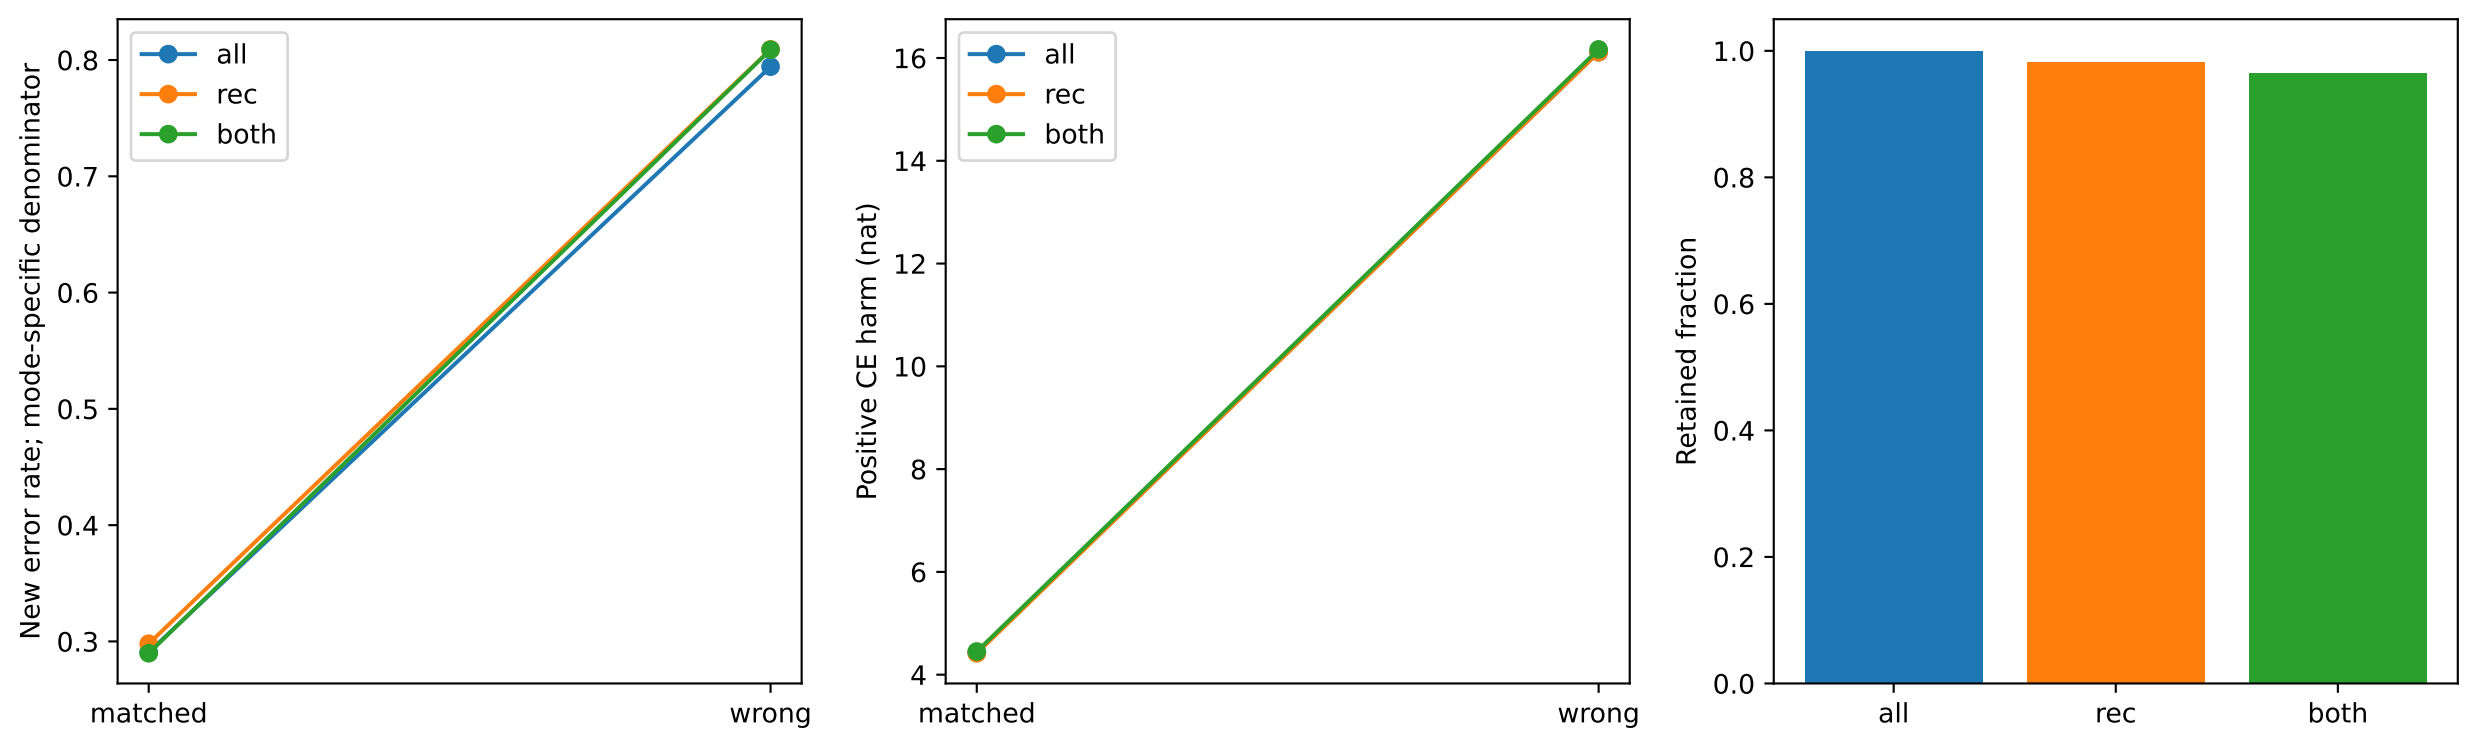
New error rate; mode-specific denominator
0.8
0.7
0.6
0.5
0.4
0.3
all
rec
both
matched
wrong
Positive CE harm (nat)
16
14
12
10
8
6
4
all
rec
both
matched
wrong
Retained fraction
1.0
0.8
0.6
0.4
0.2
0.0
all
rec
both