


(a) First-order certificate: 0/1,584 pairs certified

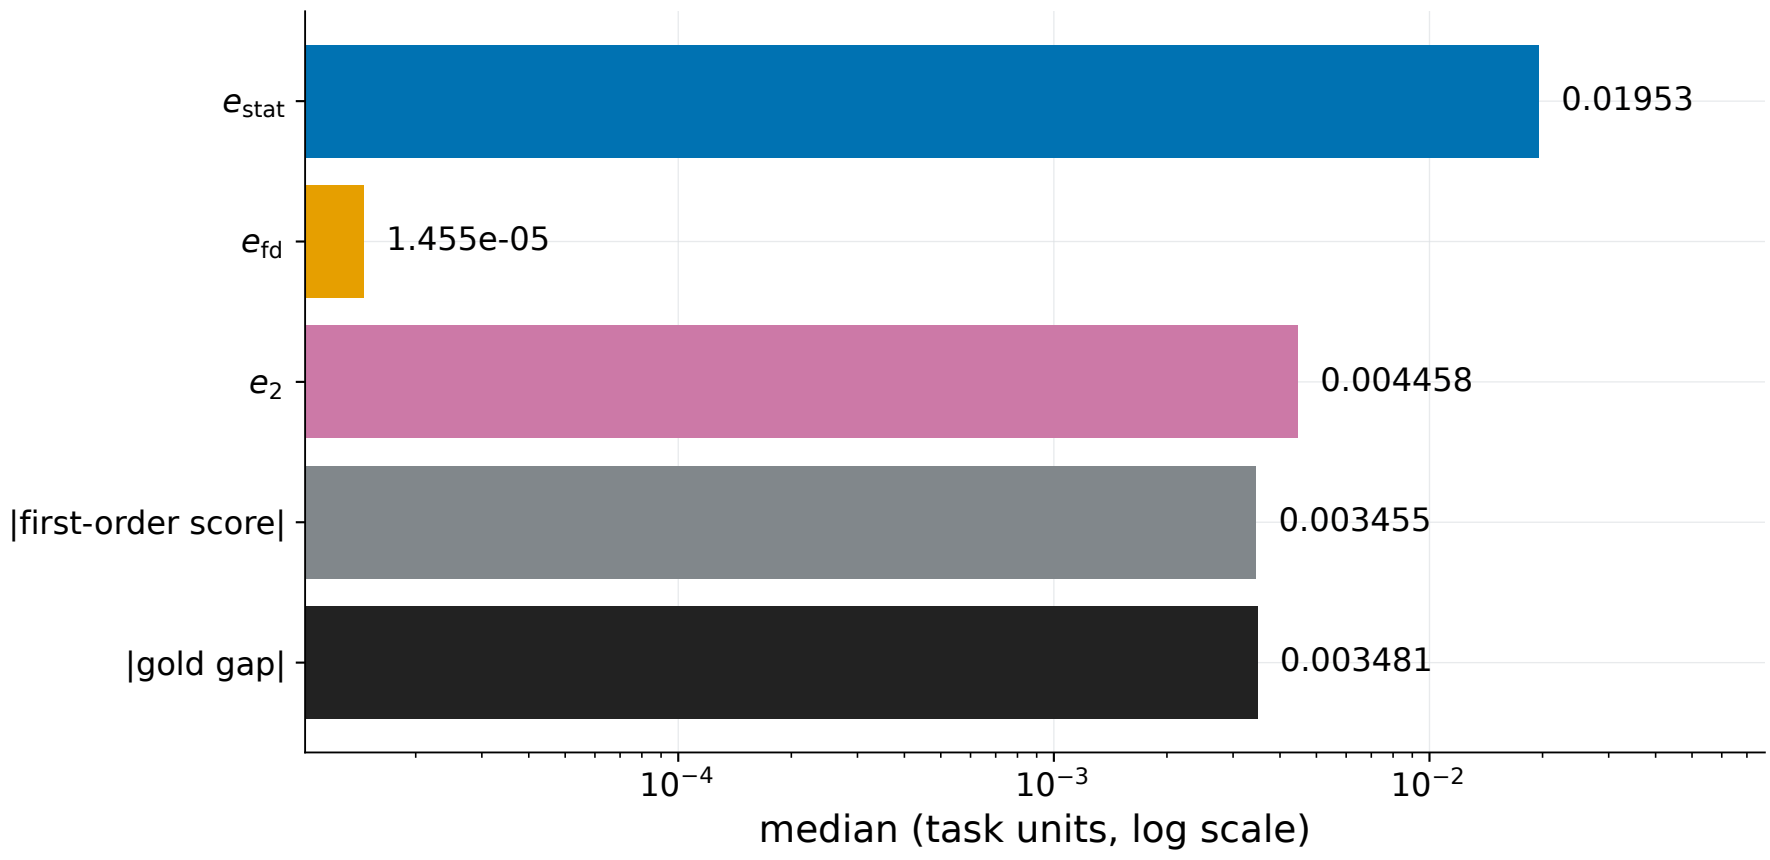


(b) Finite replacements: strict vs diagnostic coverage

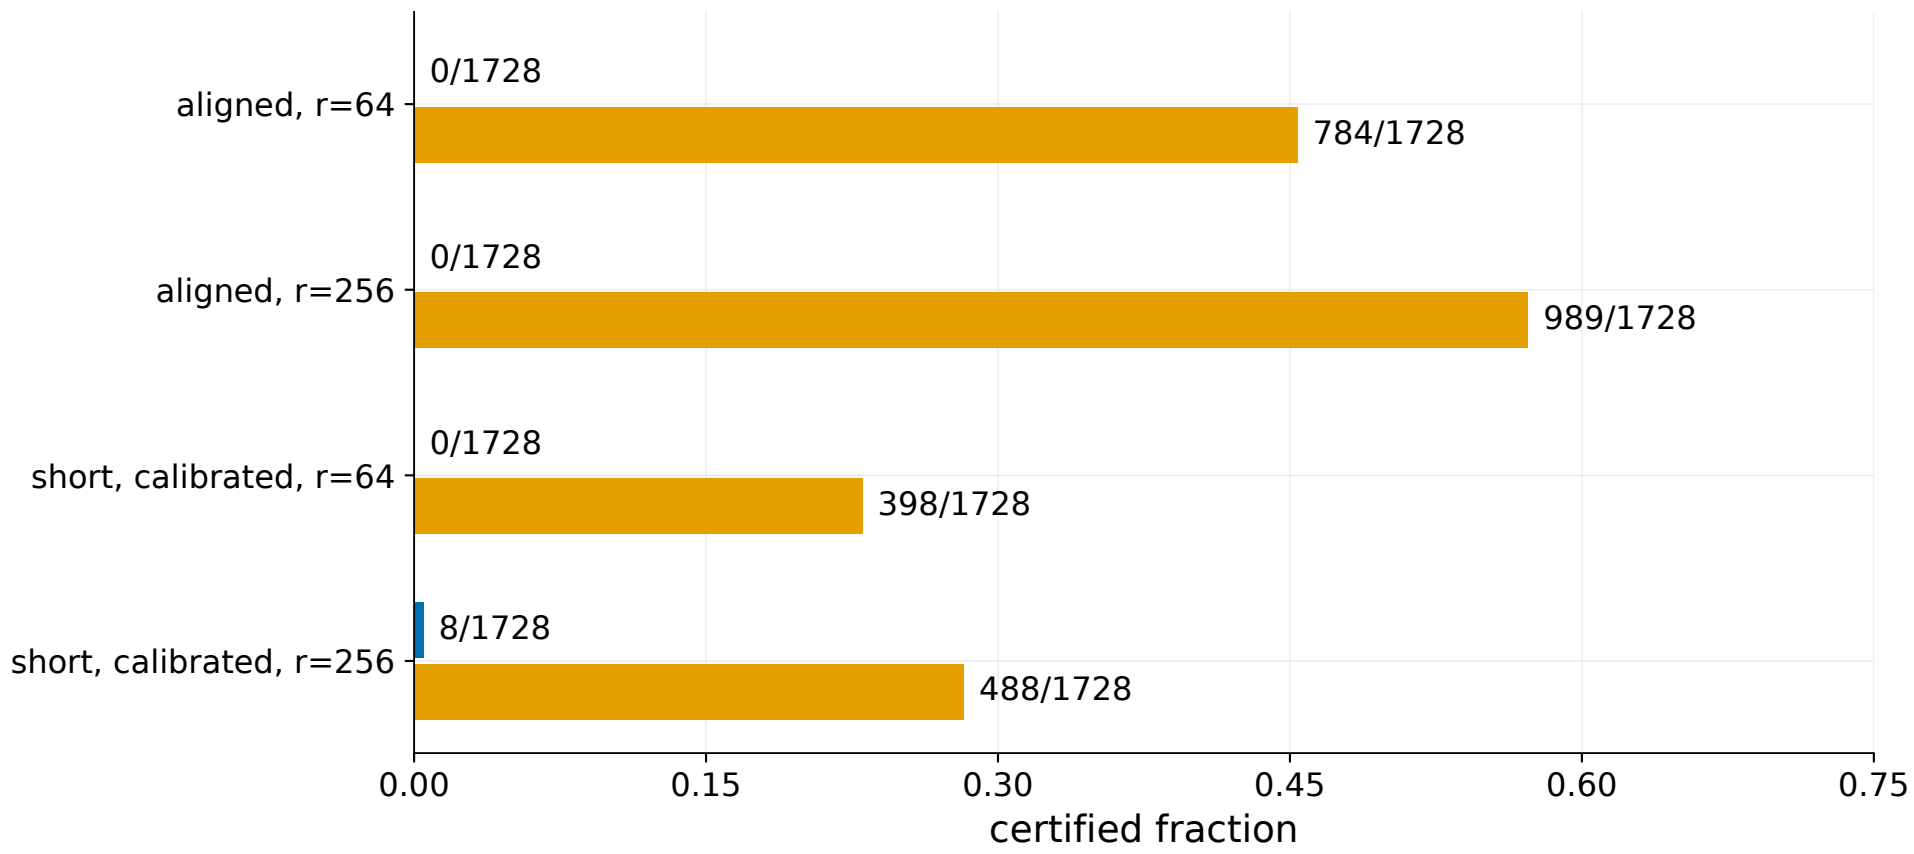


(c) Calibration transfer can fail

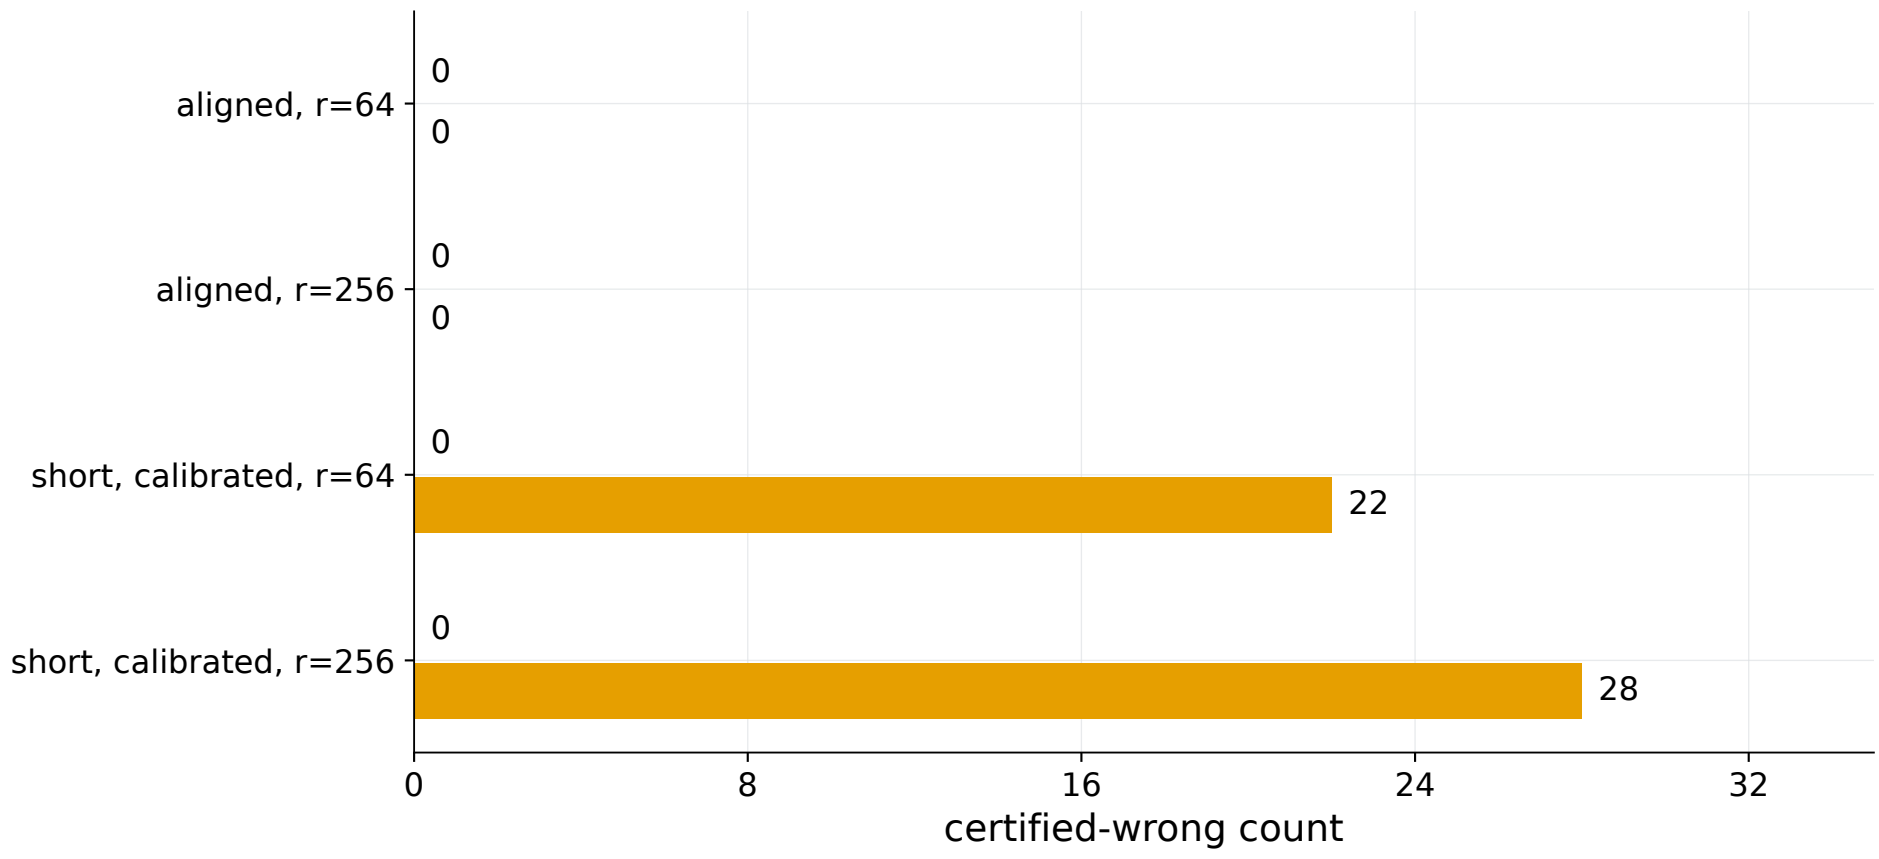

(d) CRN variance ratio distribution

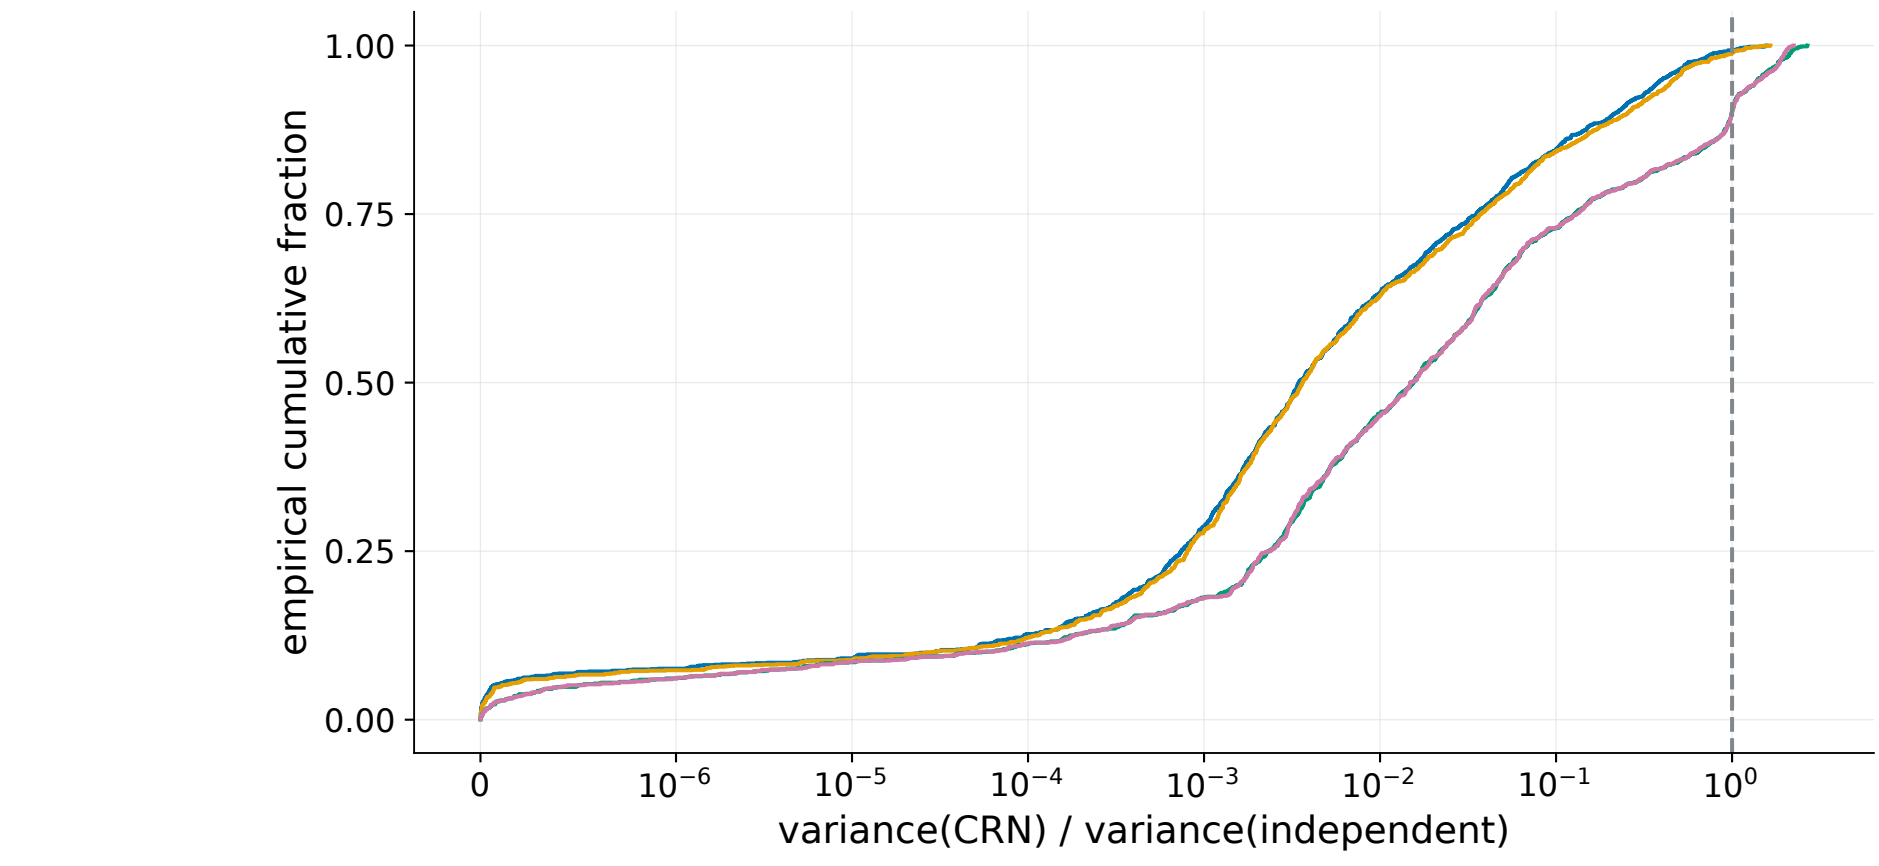

(e) Measurement cost includes curvature and calibration

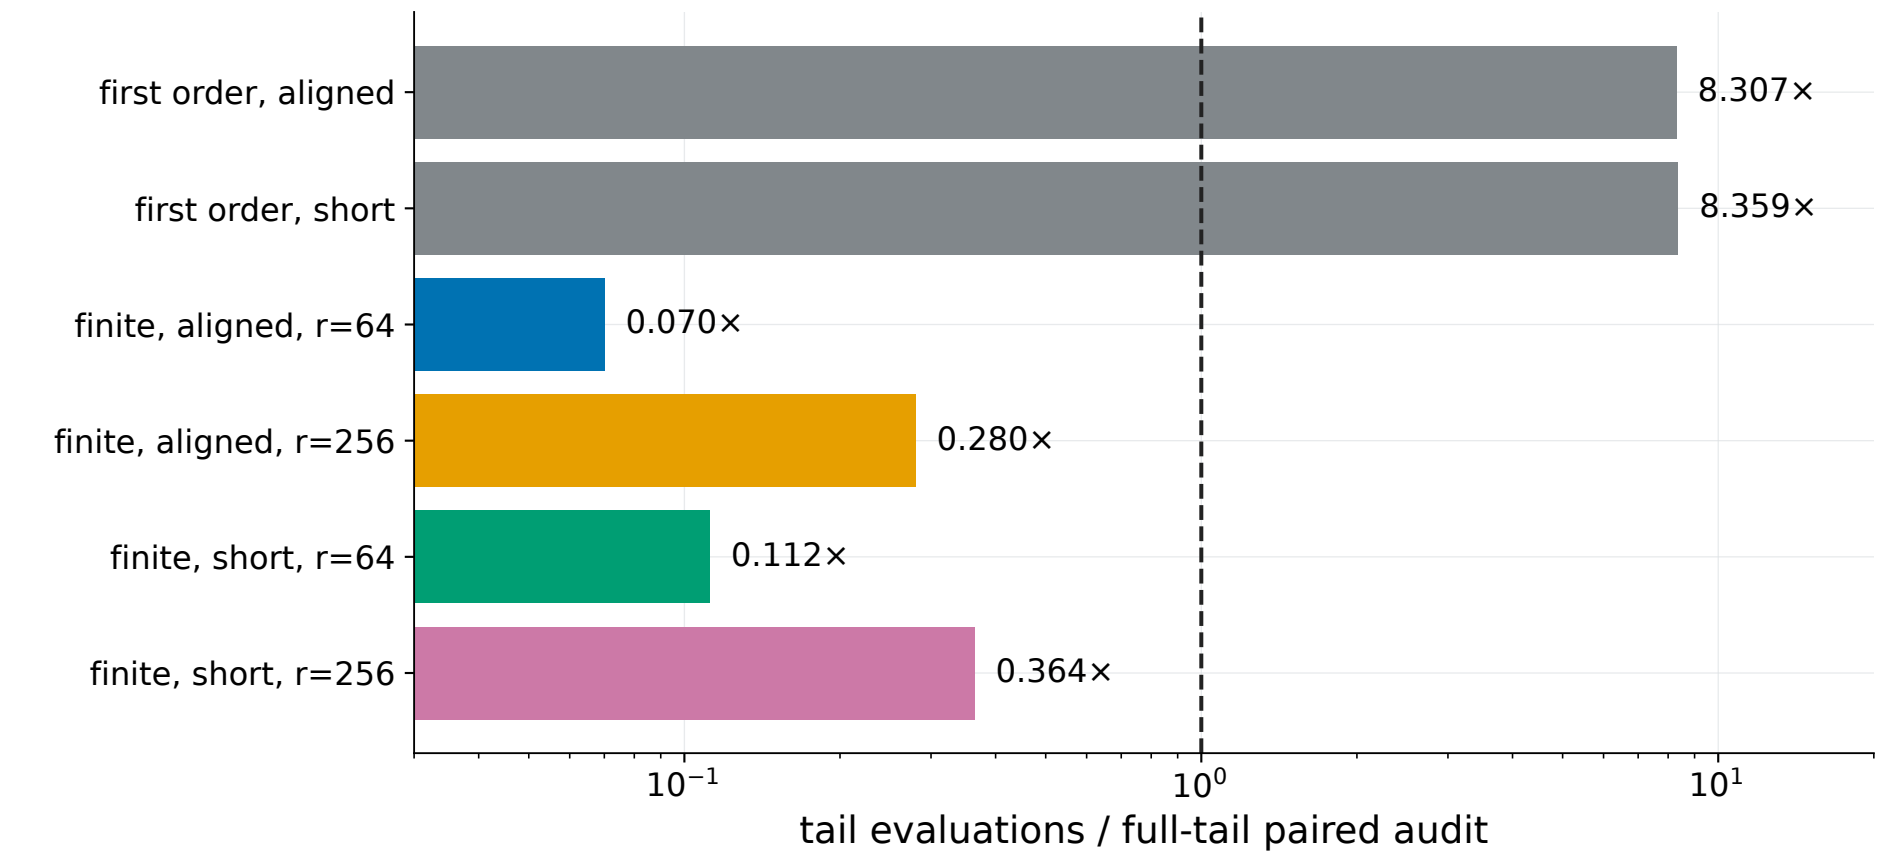

Strict range B=2; observed-range results are diagnostic only. Short-surrogate transfer is an assumption.