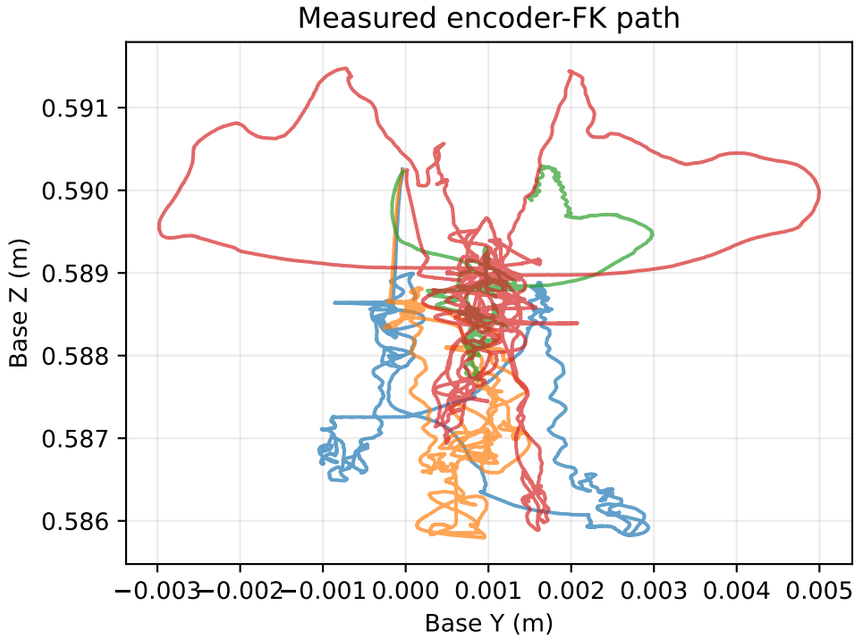
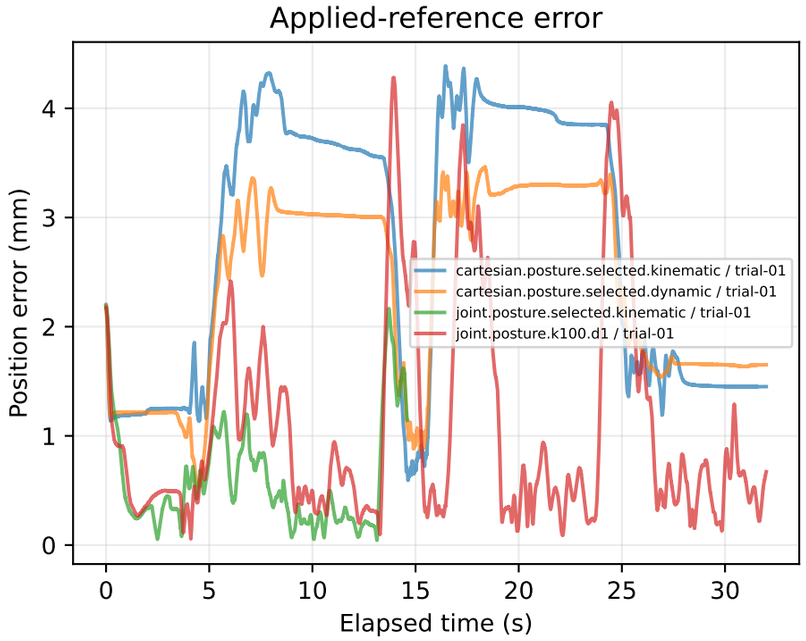
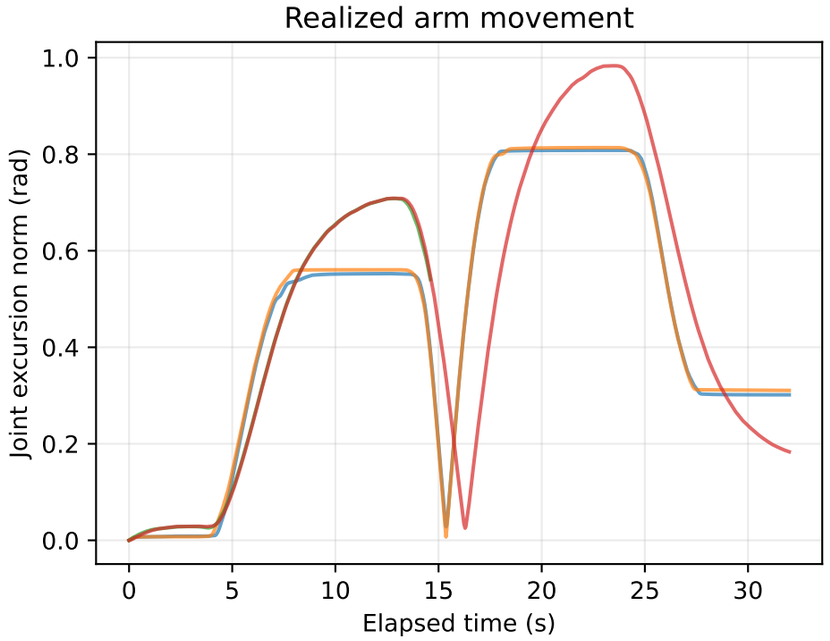

Measured encoder-FK path
Base Z (m)
0.591
0.590
0.589
0.588
0.587
0.586
−0.003
−0.002
−0.001
0.000
0.001
0.002
0.003
0.004
0.005
Base Y (m)


Applied-reference error
Position error (mm)
0
1
2
3
4
0
5
10
15
20
25
30
Elapsed time (s)
cartesian.posture.selected.kinematic / trial-01
cartesian.posture.selected.dynamic / trial-01
joint.posture.selected.kinematic / trial-01
joint.posture.k100.d1 / trial-01


Realized arm movement
Joint excursion norm (rad)
0.0
0.2
0.4
0.6
0.8
1.0
0
5
10
15
20
25
30
Elapsed time (s)