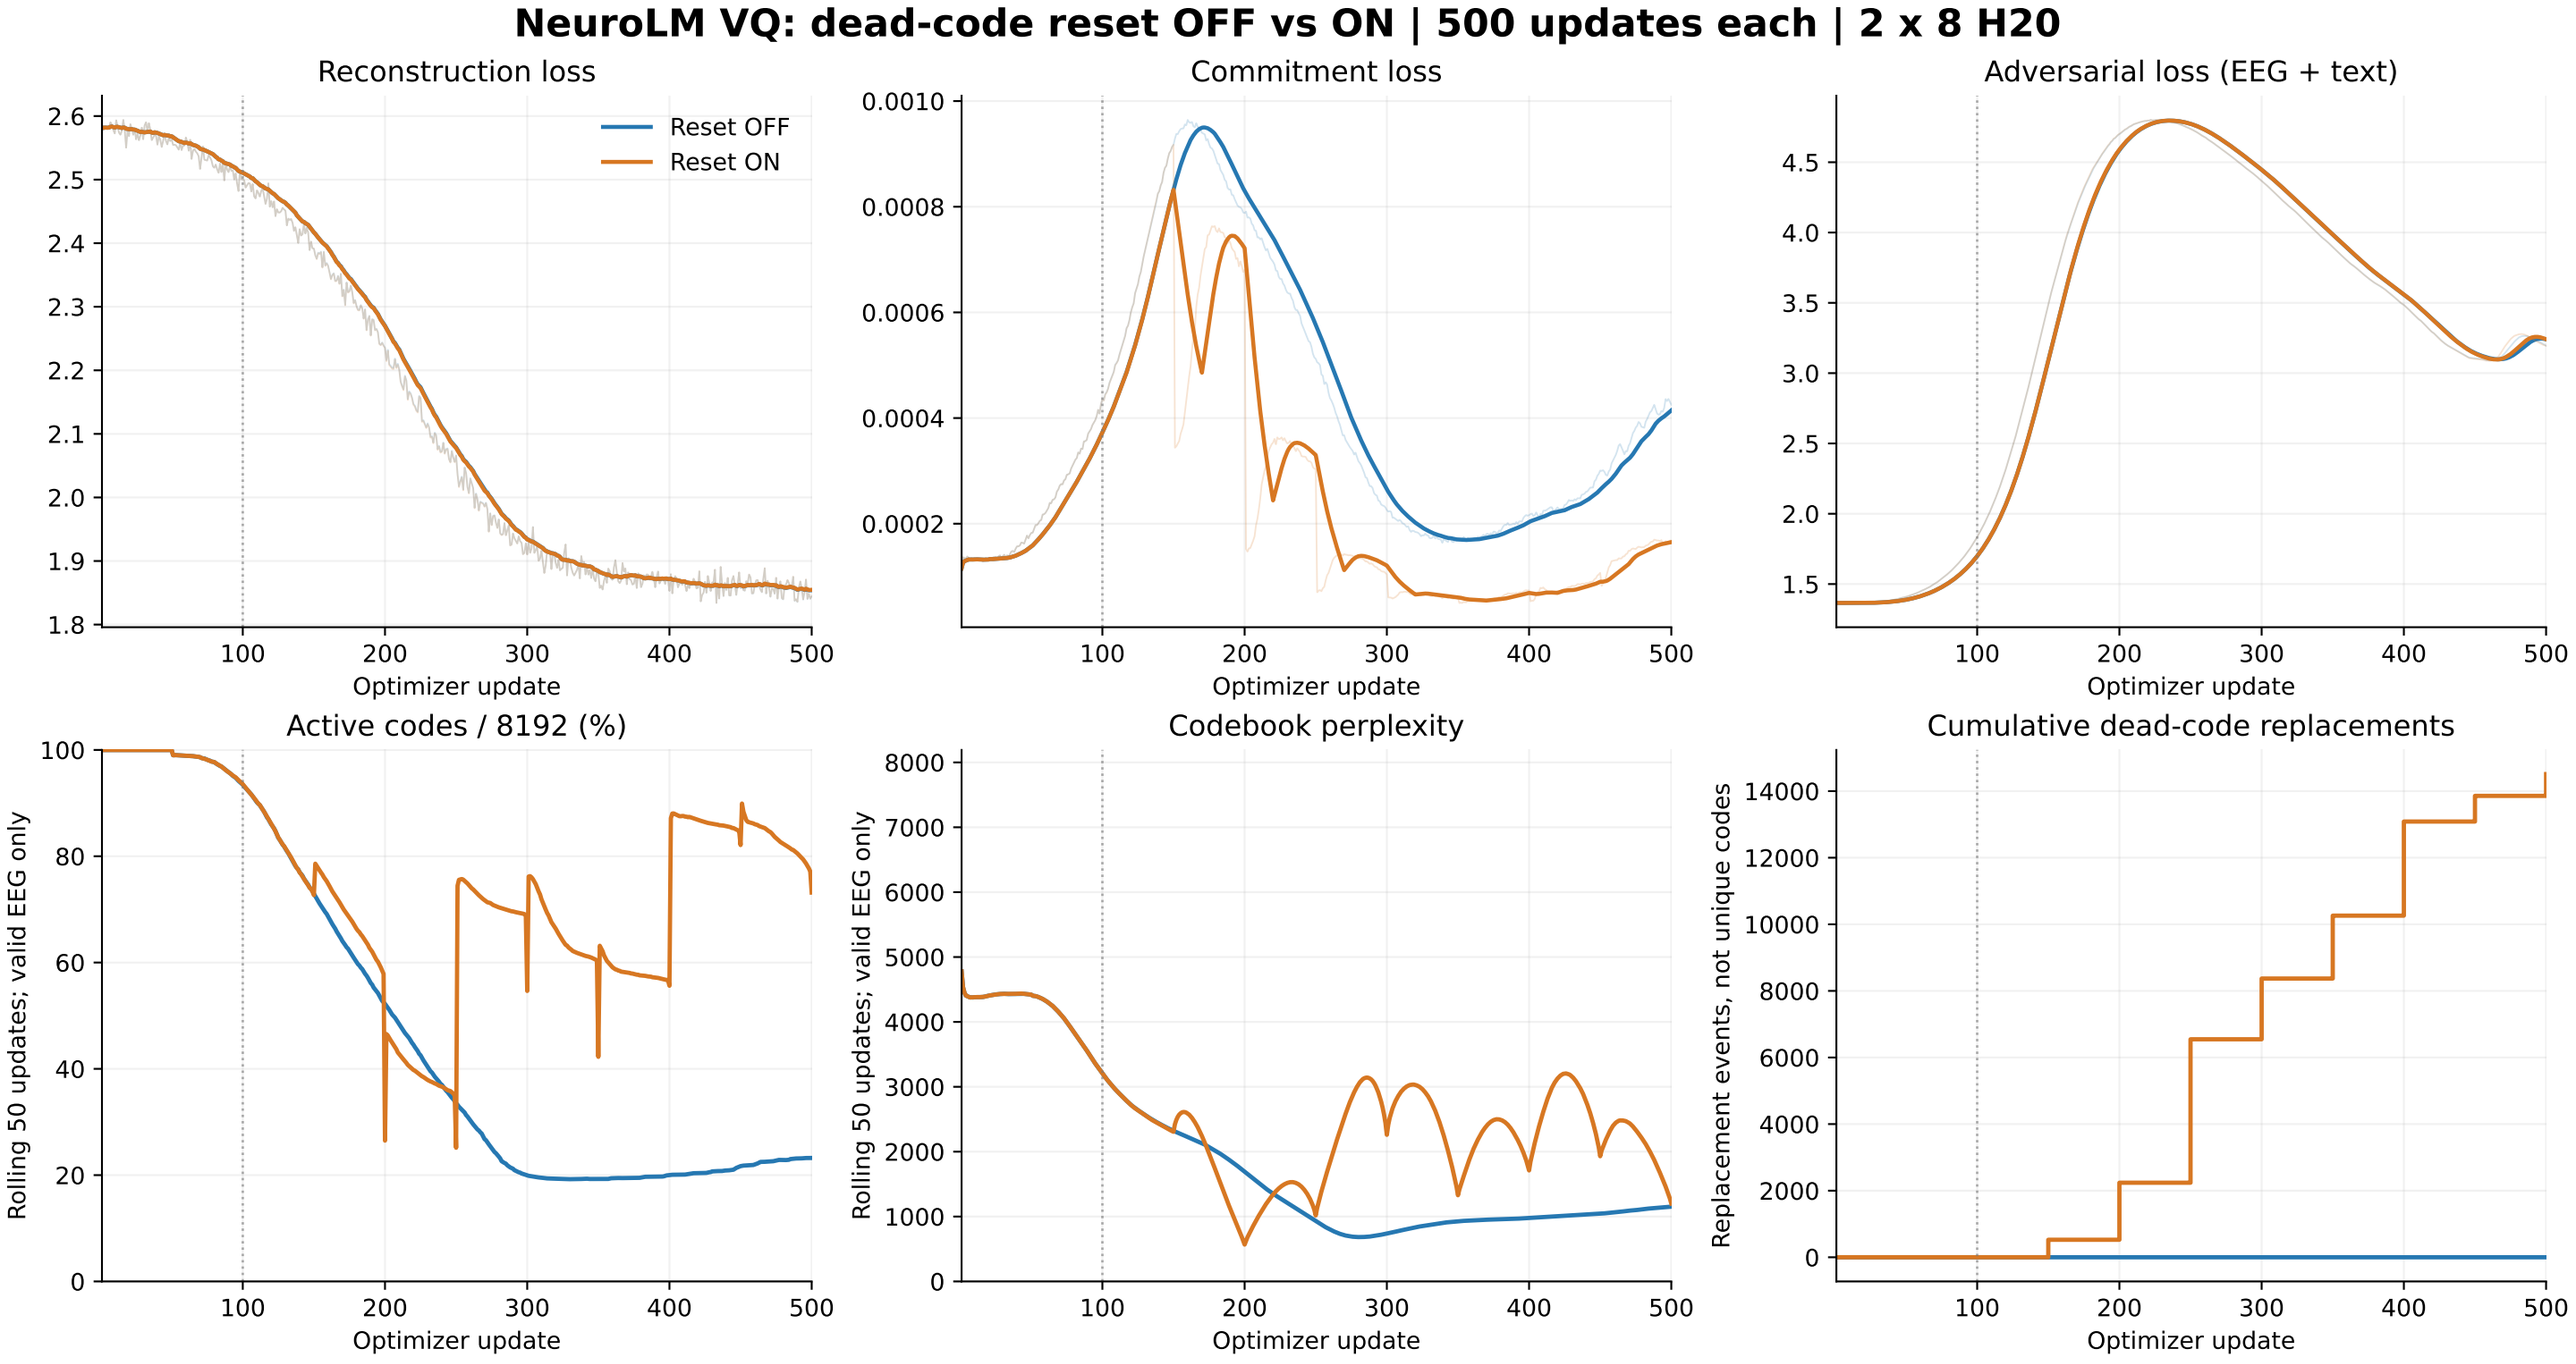

NeuroLM VQ: dead-code reset OFF vs ON | 500 updates each | 2 x 8 H20
Reconstruction loss
Reset OFF
Reset ON
Commitment loss
Adversarial loss (EEG + text)
Active codes / 8192 (%)
Codebook perplexity
Cumulative dead-code replacements
Rolling 50 updates; valid EEG only
Replacement events, not unique codes
Optimizer update
Same initialization, EEG order and text stream. Loss: valid-element mean; bold = trailing 20-step mean.
Original 50-epoch schedule retained: these 500 updates are within warmup. Dotted line: first reset eligibility.