


JOHNSTON BOILER CO.



AUSTRAL GROUP SAA, PERU
SO 11377-01
PFTS2000-3HG150S

**Johnston Boiler Company
Customer Order Data Sheet**



Johnston S.O. # (Rev) (Date): 11377-01 9/14/17 Rev 1

Purchaser Name and Address: Centro Empresarial Real
Av Victor Andres Belaunde 147
Lima Peru 27

Purchase Order Number: 3000239

Job Name: Austral Group SAA

Job Location: Chimbote Peru

Ship to Address: TBD

TBD

Boiler Model: PFTS2000-3HG150S

Quantity: One

Main Electrical Power: 460/3/60

Insurance Requirements: FM, IRI, NFPA, CSD-1

Job Site Altitude: At sea level

Main Steam Nozzle Size: 14" 300# flanged

Boiler Operating Pressure/Temperature: 125 psig

Safety/Relief Valve Setting: 150 psig

Fuel(s): Natural Gas; #6 Oil

Type of Gas/Supply Pressure: Natural Gas @ 30 psig to inlet of Johnston Boiler Company supplied
main natural gas pressure regulating valve.

Type of Oil: #6

Paint System/Color: Green

Special Notes: LP Pilot 5-10 PSIG

Johnston Boiler Company

Submittal

Sales Order: 11377-01

Revision Level: 0

20-Sep-17

Drawings

Dwg #	Rev	Description	Qty*	Notes
1137730001	0	Dimensional Diagram	5	
DOD72074	0	Fan Detail Drawing	5	** By New York Blower Co. **
1137733401	0	Typical Shipping Breakdown	5	
1137732301	0	Boiler P&ID	5	
1137736301	0	Burner Control Layout	5	
315A0013	0	Pilot Fuel Train Schematic	5	
1137731601	0	Gas Train Schematic	5	
1137731801	0	Oil Train Schematic	5	
1137733201	0	Control Panel Layout	5	
1137735701	0	Power Panel Layout	5	
1137730801	0	Wiring Schematic	5	
176U8480	C	VFD Submittal Data	5	
354B0013	A	Legend	5	
				** Plus (1) Electronic copy for all **

Bills of Material

Assy #	Rev	Description	Qty*	Notes
11377J1	0	Boiler Controls & Piping	5	
11377K1	0	Burner Mounted Controls	5	
038425	0	Pilot Fuel Train	5	
11377F1	0	Gas Train	5	
11377G1	0	Oil Train	5	
11377D1	0	Control Panel	5	
11377D2	0	Power Panel	5	
11377X1	0	Ship Loose Items	5	
				** Plus (1) Electronic copy for all **

Supporting Data

Document #	Rev	Description	Qty*	Notes
-	-	Stack Design Sheet	5	
-	-	Customer Order Data Sheet	E	
IM-100	-	Fan Mounting Instructions	E	** Excerpt from New York Blower O&M **

*If quantity is listed as "E," only electronic submittals are being sent (no hard copies are provided).

Job Information

Customer Name Austral Group SAA
Job Location Chimbote, Peru
Representative Vaportec SAC
Rep. Address Av Dos de Mayo 744, Of. 101
 Miraflores
 Lima, Peru
Rep. Phone 011-51-1-447-5686

Model No. PFTS2000-3HG150S
Output 66,950,000 Btu/hr
Steam Capacity 69,000 lbs/hr (from & at 212°F)
Heating Surface 9,926 sq ft
Dry Weight 128,100 lbs
Water Content 93,400 lbs (flooded)
Insurance Codes FM, NFPA, CSD-1
Electrical Supply 460V-3ph-60Hz



Submitted for Information.
 Manufacturing is proceeding based on
 equipment and arrangement as shown.

Shipped Via _____ Date _____ By _____
 Company _____ Attn. _____

- NOTES:
- 1) BLOWER MOTOR VARIABLE SPEED DRIVE SHIPS SEPARATE IN NEMA 12 CABINET FOR FIELD MOUNTING AND WIRING BY CONTRACTOR. SEE VFD DIMENSIONAL DATA SHEET PROVIDED.
 - 2) FEEDWATER CONTROL VALVE AND BOTTOM BLOWOFF VALVE SHIP LOOSE FOR FIELD INSTALLATION BY CONTRACTOR.
 - 3) ALL MOTORS TEFC.
 - 4) COMBUSTION AIR BLOWER ASSEMBLY AND TRANSITION DUCT SHIP SEPARATE. SEE MANUFACTURER'S INSTALLATION INSTRUCTIONS INCLUDED.
 - 5) BOILER REMOVED FROM BASE ASSEMBLY AT FLANGE SHOWN FOR SHIPPING. RE-ASSEMBLY ON SITE BY CONTRACTOR.
 - 6) PARTIAL CRATING FOR EXPORT SHIPMENT.

CONNECTION SCHEDULE			
CONN.	DESCRIPTION	SIZE	TYPE
A	FEEDWATER INLET	3.00	FNPT
B	AUX. FEEDWATER INLET (CAPPED)	3.00	FNPT
C	FLUE OUTLET	46.00	ID
D	MAIN STEAM OUTLET	14.00	300#RF
F	CONTINUOUS BLOWOFF OUTLET	1.00	FNPT
G	SAFETY VALVE OUTLET	4.00	FNPT
H	BOTTOM BLOWOFF OUTLET	2.00	FNPT
I	MAIN GAS INLET	4.00	125#FF
J	MAIN GAS VENT VALVE OUTLET	2.00	FNPT
L*	PILOT GAS VENT VALVE OUTLET*	0.38	FNPT
M	OIL INLET	1.50	FNPT
N	OIL RETURN	1.00	FNPT

*NOT SHOWN.

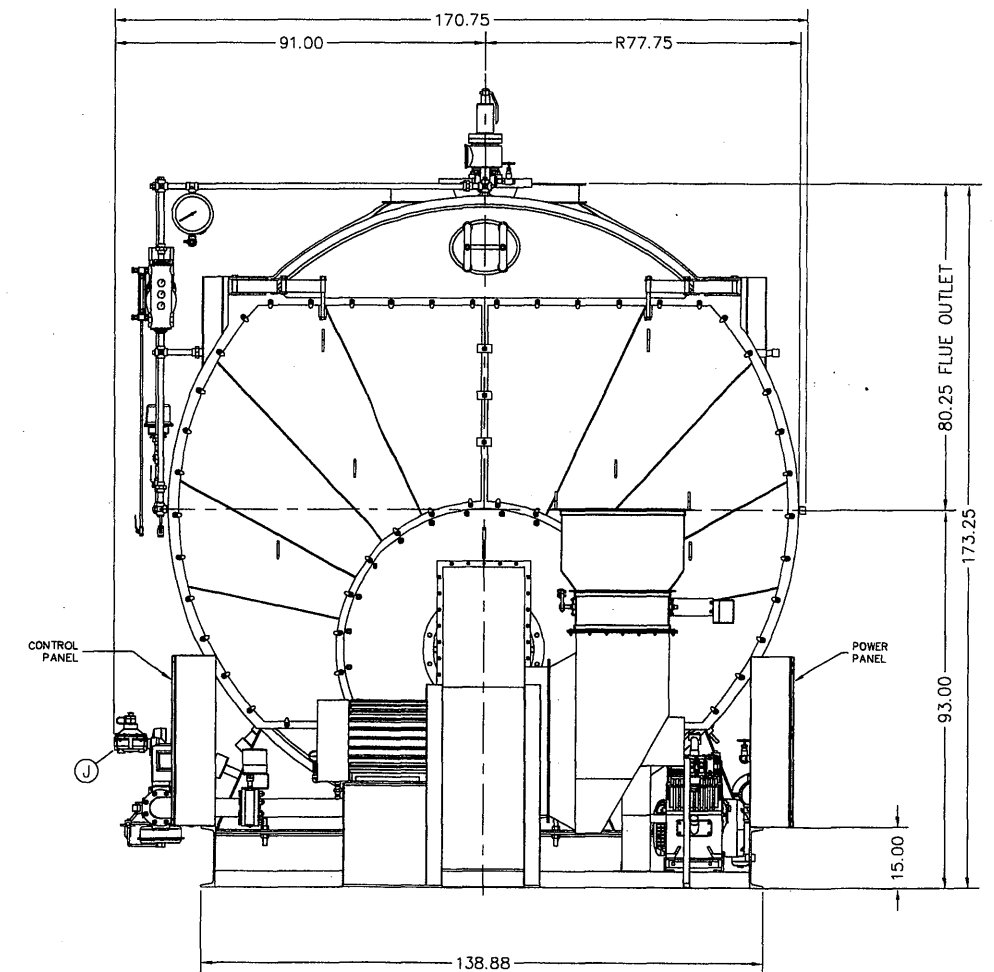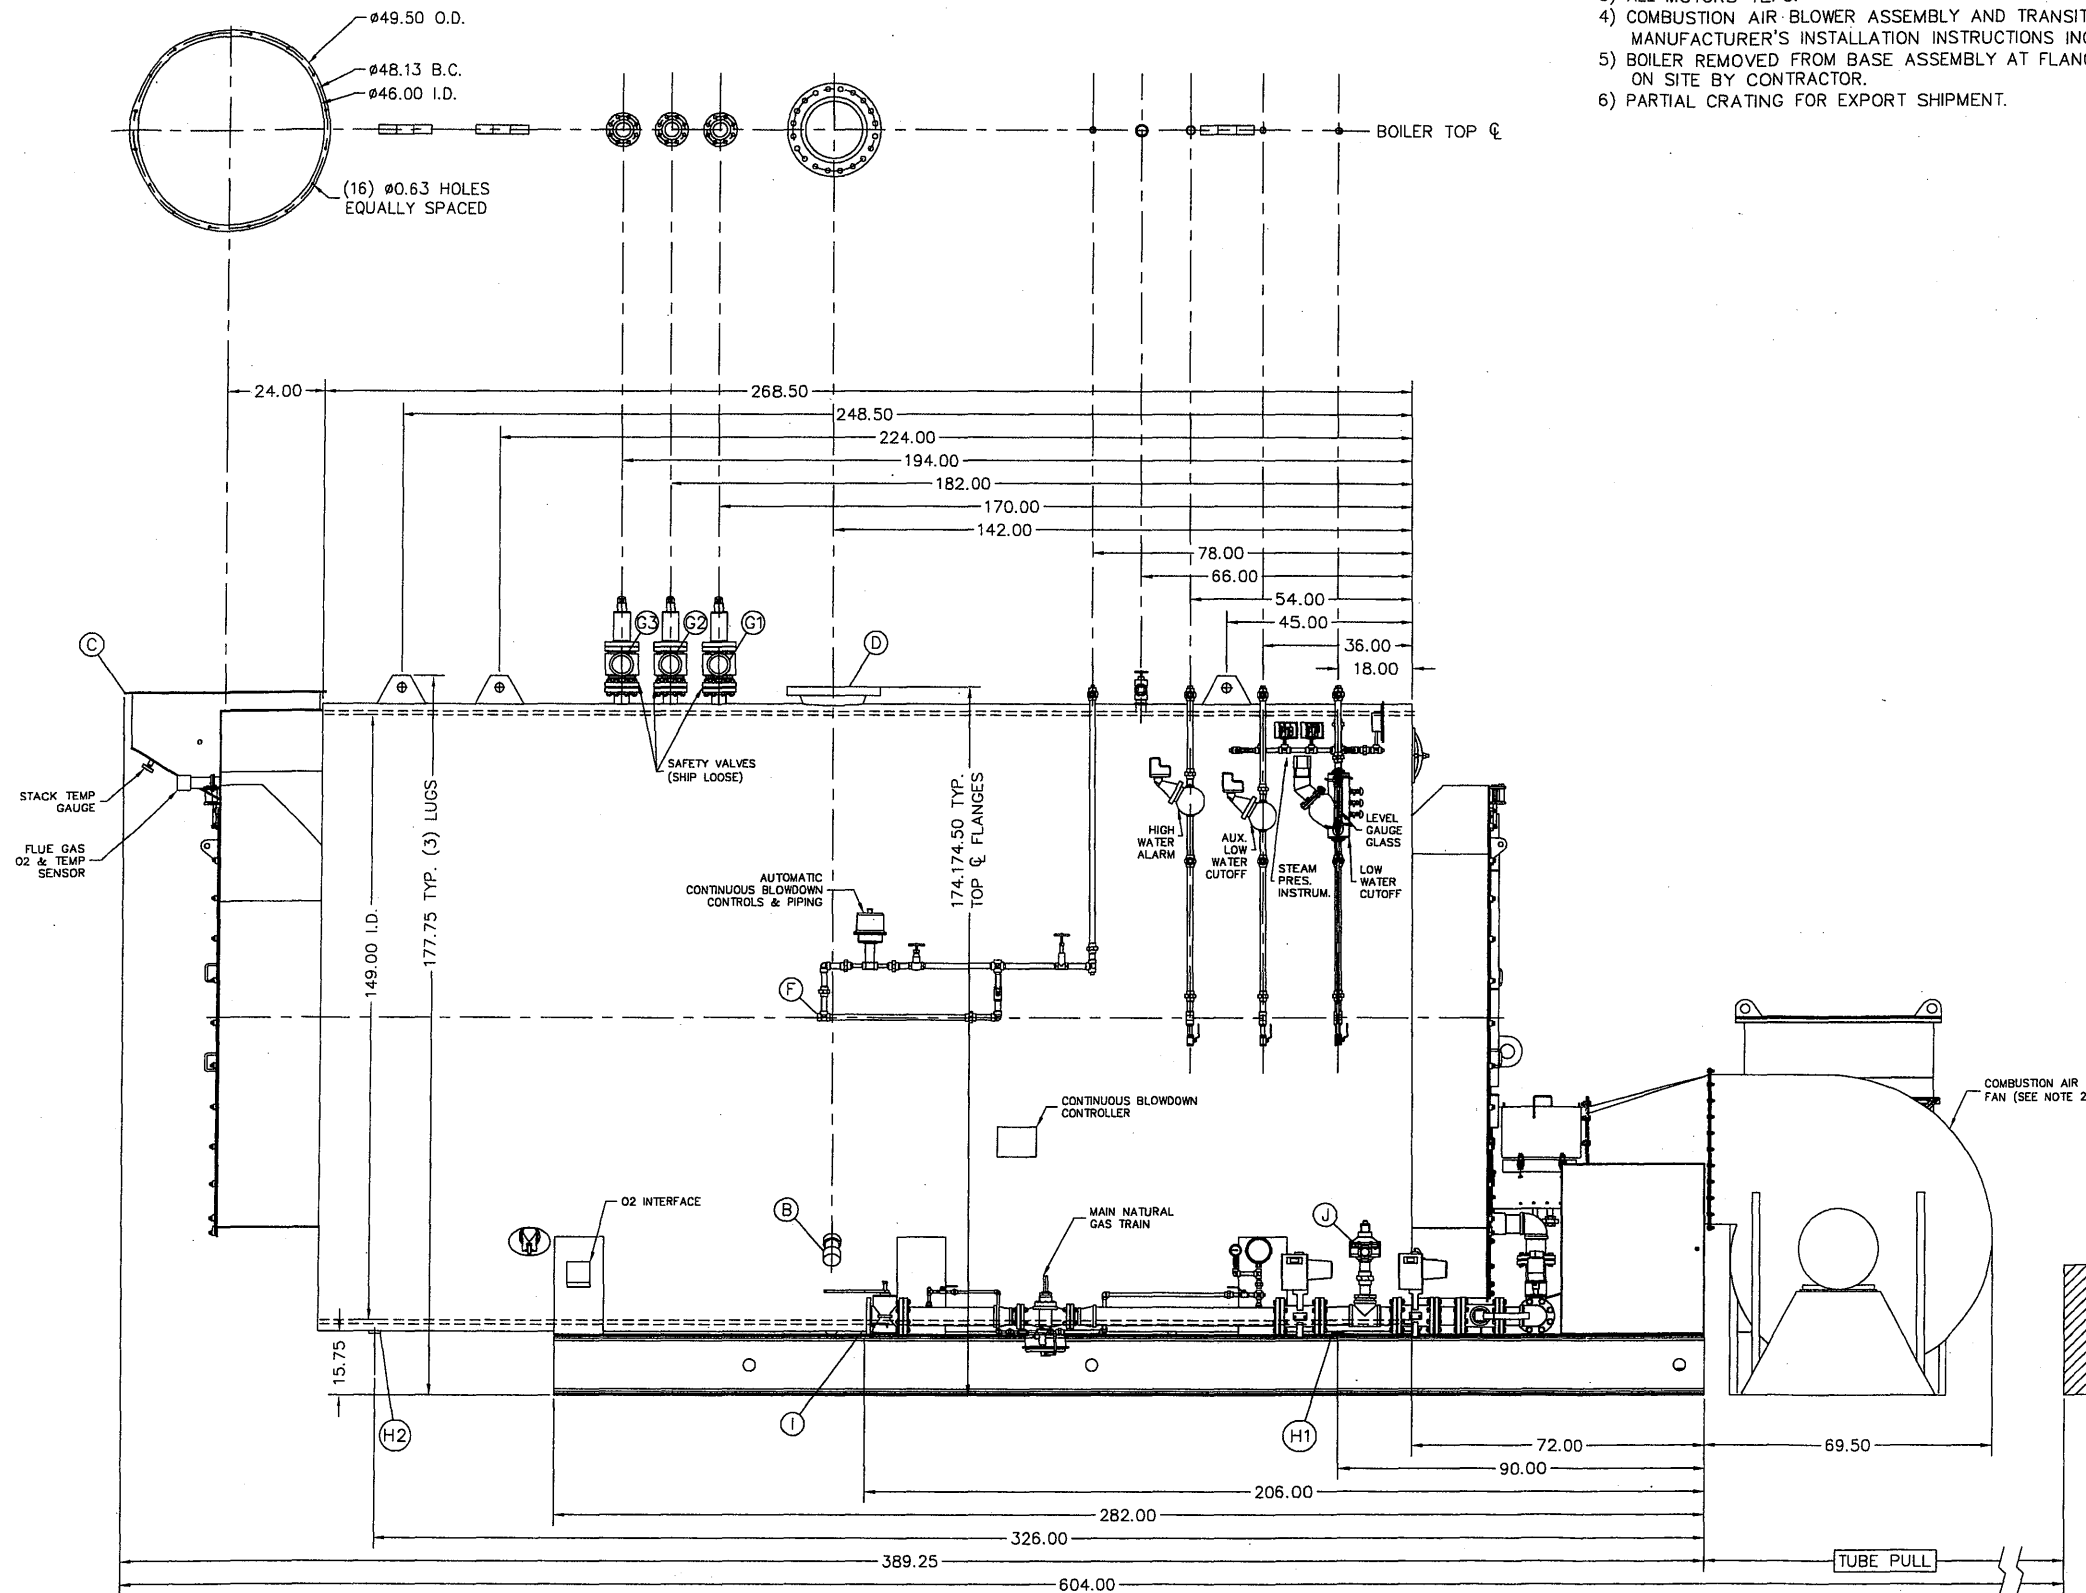

NOTES: THIS DRAWING IS FOR DIMENSIONAL DATA ONLY. SEE PIPING & INSTRUMENT DRAWINGS FOR ACTUAL TRIM & INSTRUMENTATION PROVIDED. ALL DIMENSIONS IN INCHES UNLESS OTHERWISE NOTED. MINIMUM BOILER SIDE & REAR AISLE CLEARANCE: 36.00. ELECTRICAL PANEL LOCATIONS SHOWN ARE APPROXIMATE; CONSULT FACTORY IF PLACEMENT IS CRITICAL. REFER TO NATIONAL ELECTRICAL CODE (NFPA-70) FOR REQUIRED WORKING CLEARANCE ABOUT PANELS; CONSULT LOCAL CODES WHICH MAY SUPERCEDE THESE REQUIREMENTS. BOILER COMPLETELY COVERED WITH 2" INSULATION & NONCORRODING STEEL JACKET.

DWG NO. 1137730001

REVISIONS

PROJECT NAME: AUSTRAL GROUP SAA
PROJECT LOCATION: CHIMBOTE, PERU



THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.


SCALE NONE
DATE 9-11-17
DRAWN MTN
CHECKED
APPROVED mm

JOHNSTON BOILER COMPANY
FERRYSBURG, MICHIGAN 49409

DIMENSIONAL DIAGRAM - 509
PFTS2000-3HG150S

DWG. NO. 1137730001

(SHEET 1 OF 2)

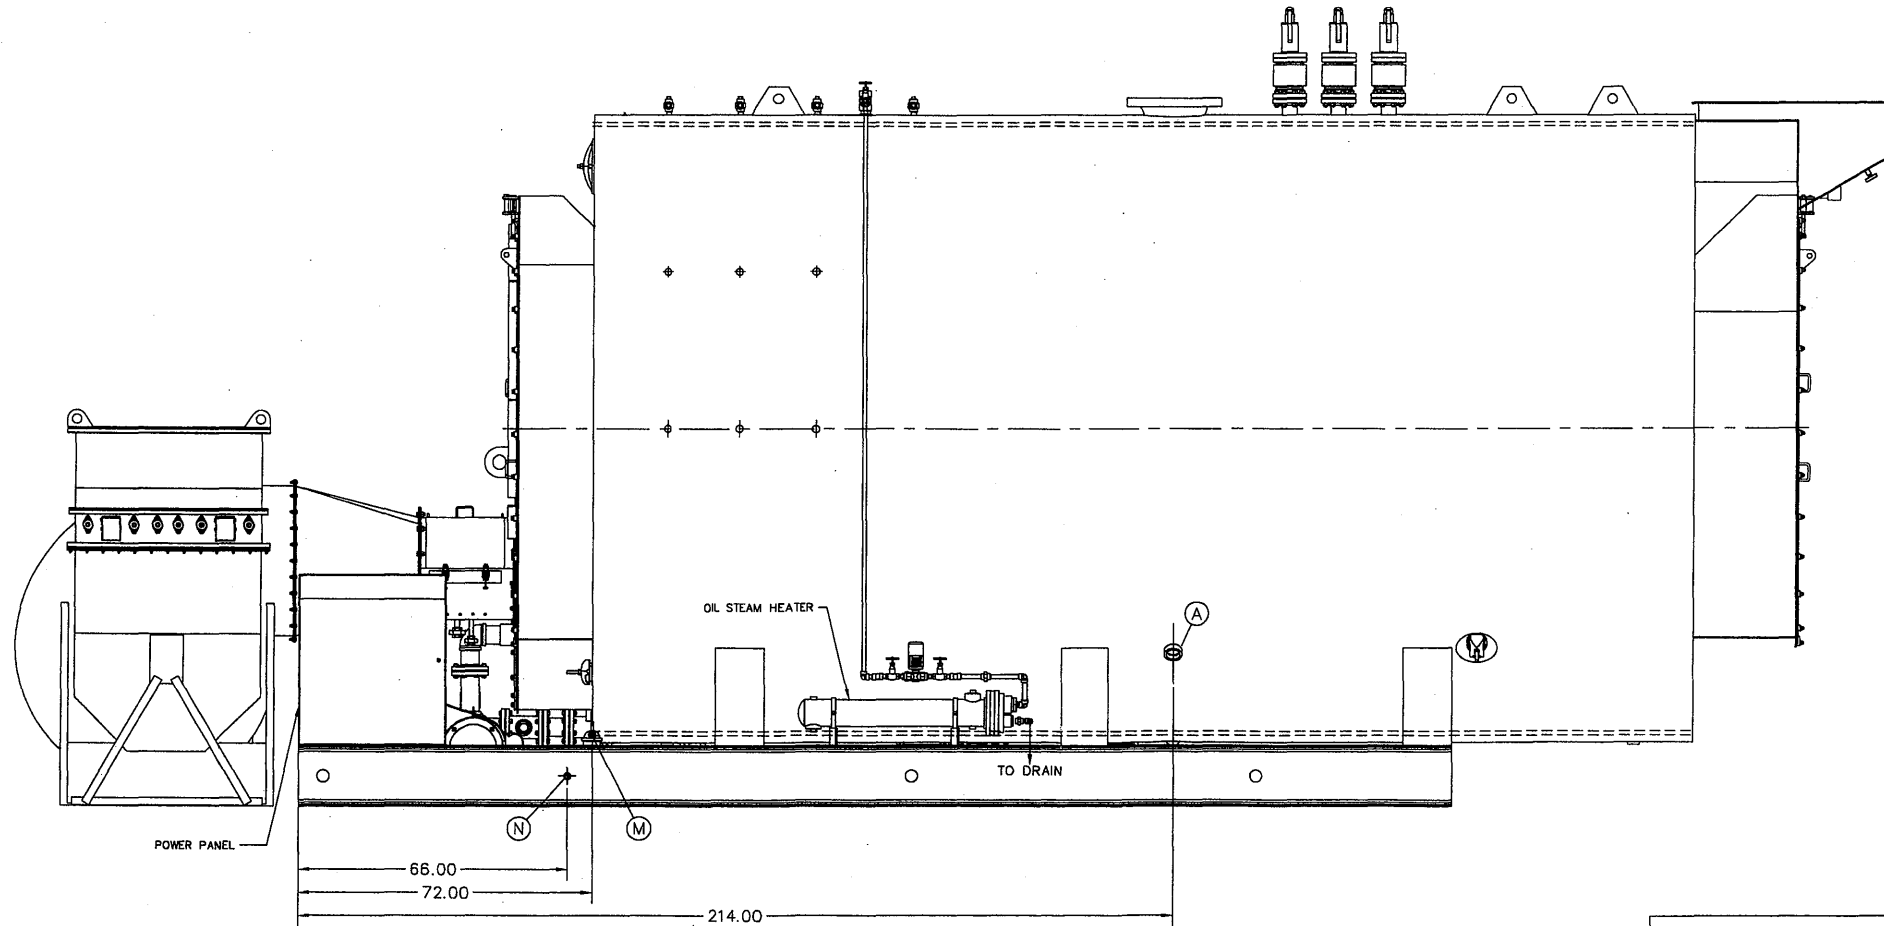

NOTES: THIS DRAWING IS FOR DIMENSIONAL DATA ONLY. SEE PIPING & INSTRUMENT DRAWINGS FOR ACTUAL TRIM & INSTRUMENTATION PROVIDED. ALL DIMENSIONS IN INCHES UNLESS OTHERWISE NOTED. MINIMUM BOILER SIDE & REAR AISLE CLEARANCE: 36.00. ELECTRICAL PANEL LOCATIONS SHOWN ARE APPROXIMATE; CONSULT FACTORY IF PLACEMENT IS CRITICAL. REFER TO NATIONAL ELECTRICAL CODE (NFPA-70) FOR REQUIRED WORKING CLEARANCE ABOUT PANELS; CONSULT LOCAL CODES WHICH MAY SUPERCEDE THESE REQUIREMENTS. BOILER COMPLETELY COVERED WITH 2" INSULATION & NONCORRODING STEEL JACKET.

DWG NO.
1137730001

REVISIONS

PROJECT NAME: AUSTRAL GROUP SAA
PROJECT LOCATION: CHIMBOTE, PERU










THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

SCALE
NONE
DATE
9-11-17
DRAWN
MTN
CHECKED
APPROVED
mm

JOHNSTON BOILER COMPANY
FERRYSBURG, MICHIGAN 49409

DIMENSIONAL DIAGRAM — 509
PFTS2000-3HG150S

DWG. NO. 1137730001 (SHEET 2 OF 2) REV

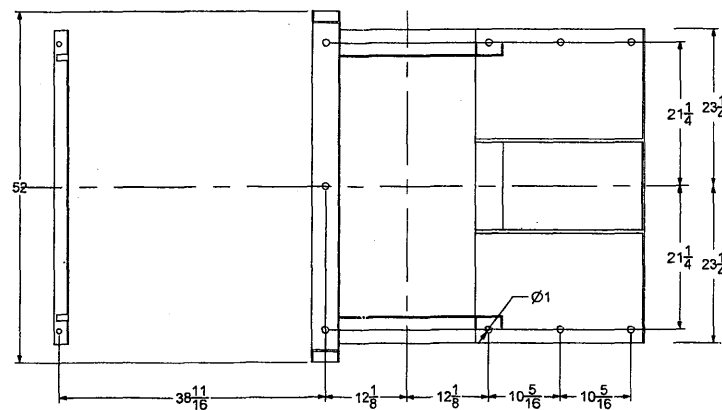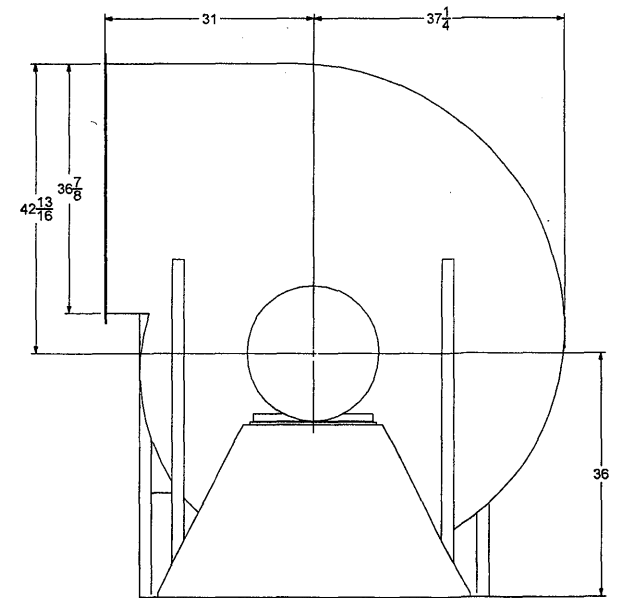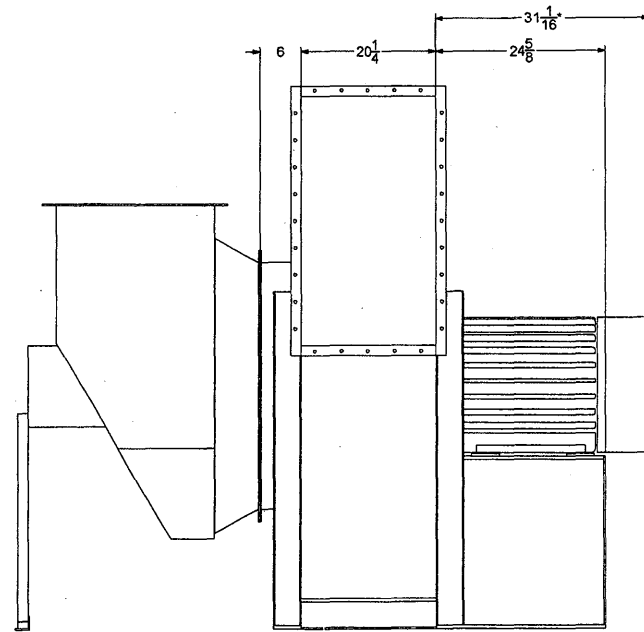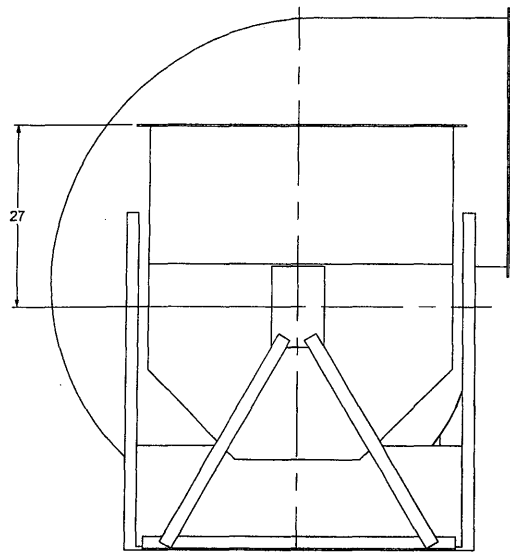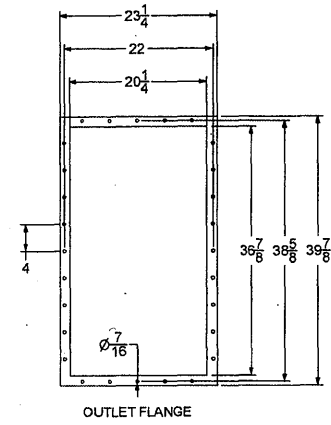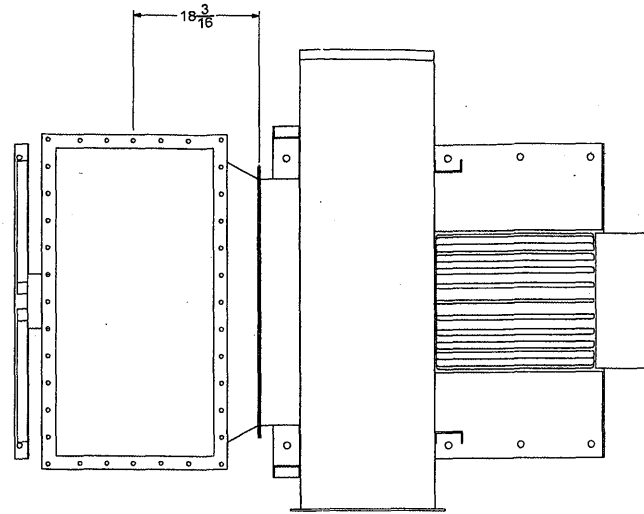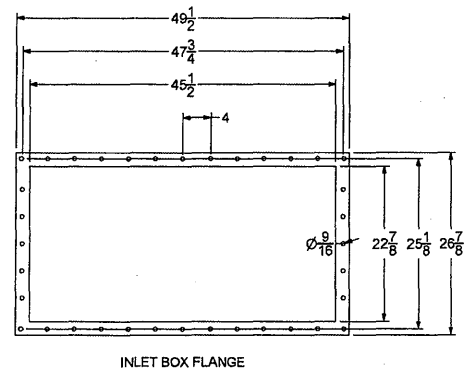

EST FAN SHIPPING WEIGHT 4388#
EST SHIPPING DIM 92 W X 117 L X 92 H

CUSTOMER Johnston Boiler
CUSTOMER'S NO _____
FILE NO. DOD72074
TAGGING _____

NOTICE: This drawing is the property of THE NEW YORK BLOWER CO. and is loaned subject to the condition that it shall not be reproduced, copied, loaned or submitted to outside parties without our consent.

40 AF-THIRTY
CCW TH
Arrangement 4


59% WIDTH

DRAWN DOD DATE 9/18/2017

nycb THE NEW YORK BLOWER COMPANY
1760 Quincy Street
Hoffmanville, IL 60527-4510
Visit us on the Web: <http://www.nyb.com>
Phone: (800) 205-7618 Email: nyb@nyb.com
DRAWING NUMBER
DOD72074

*VARIES SLIGHTLY WITH MOTORS OF DIFFERENT MANUFACTURE.

- NOTES:
- 1) BREAKDOWN IS APPROXIMATE. FINAL DISCONNECT POINTS TO BE DETERMINED AT TIME OF PREPARATION FOR SHIPPING. ALL RE-ASSEMBLY ON SITE IS BY CONTRACTOR.
 - 2) ALL FASTENERS FOR RE-ASSEMBLY ARE SHIPPED WITH THE UNIT.
 - 3) ALL PIPING JOINTS ARE MARKED WITH COLORED TAPE TO AID IN RE-ASSEMBLY ON SITE.
 - 4) ALL OPENINGS ON BOILER AND BASE PROTECTED BY SHRINK WRAP.
 - 5) TYPICAL SHIPMENT REQUIRES (3) TRUCKS PER BOILER:
 - BOILER
 - BASE/SKID
 - FAN, PIPING, & ACCESSORIES

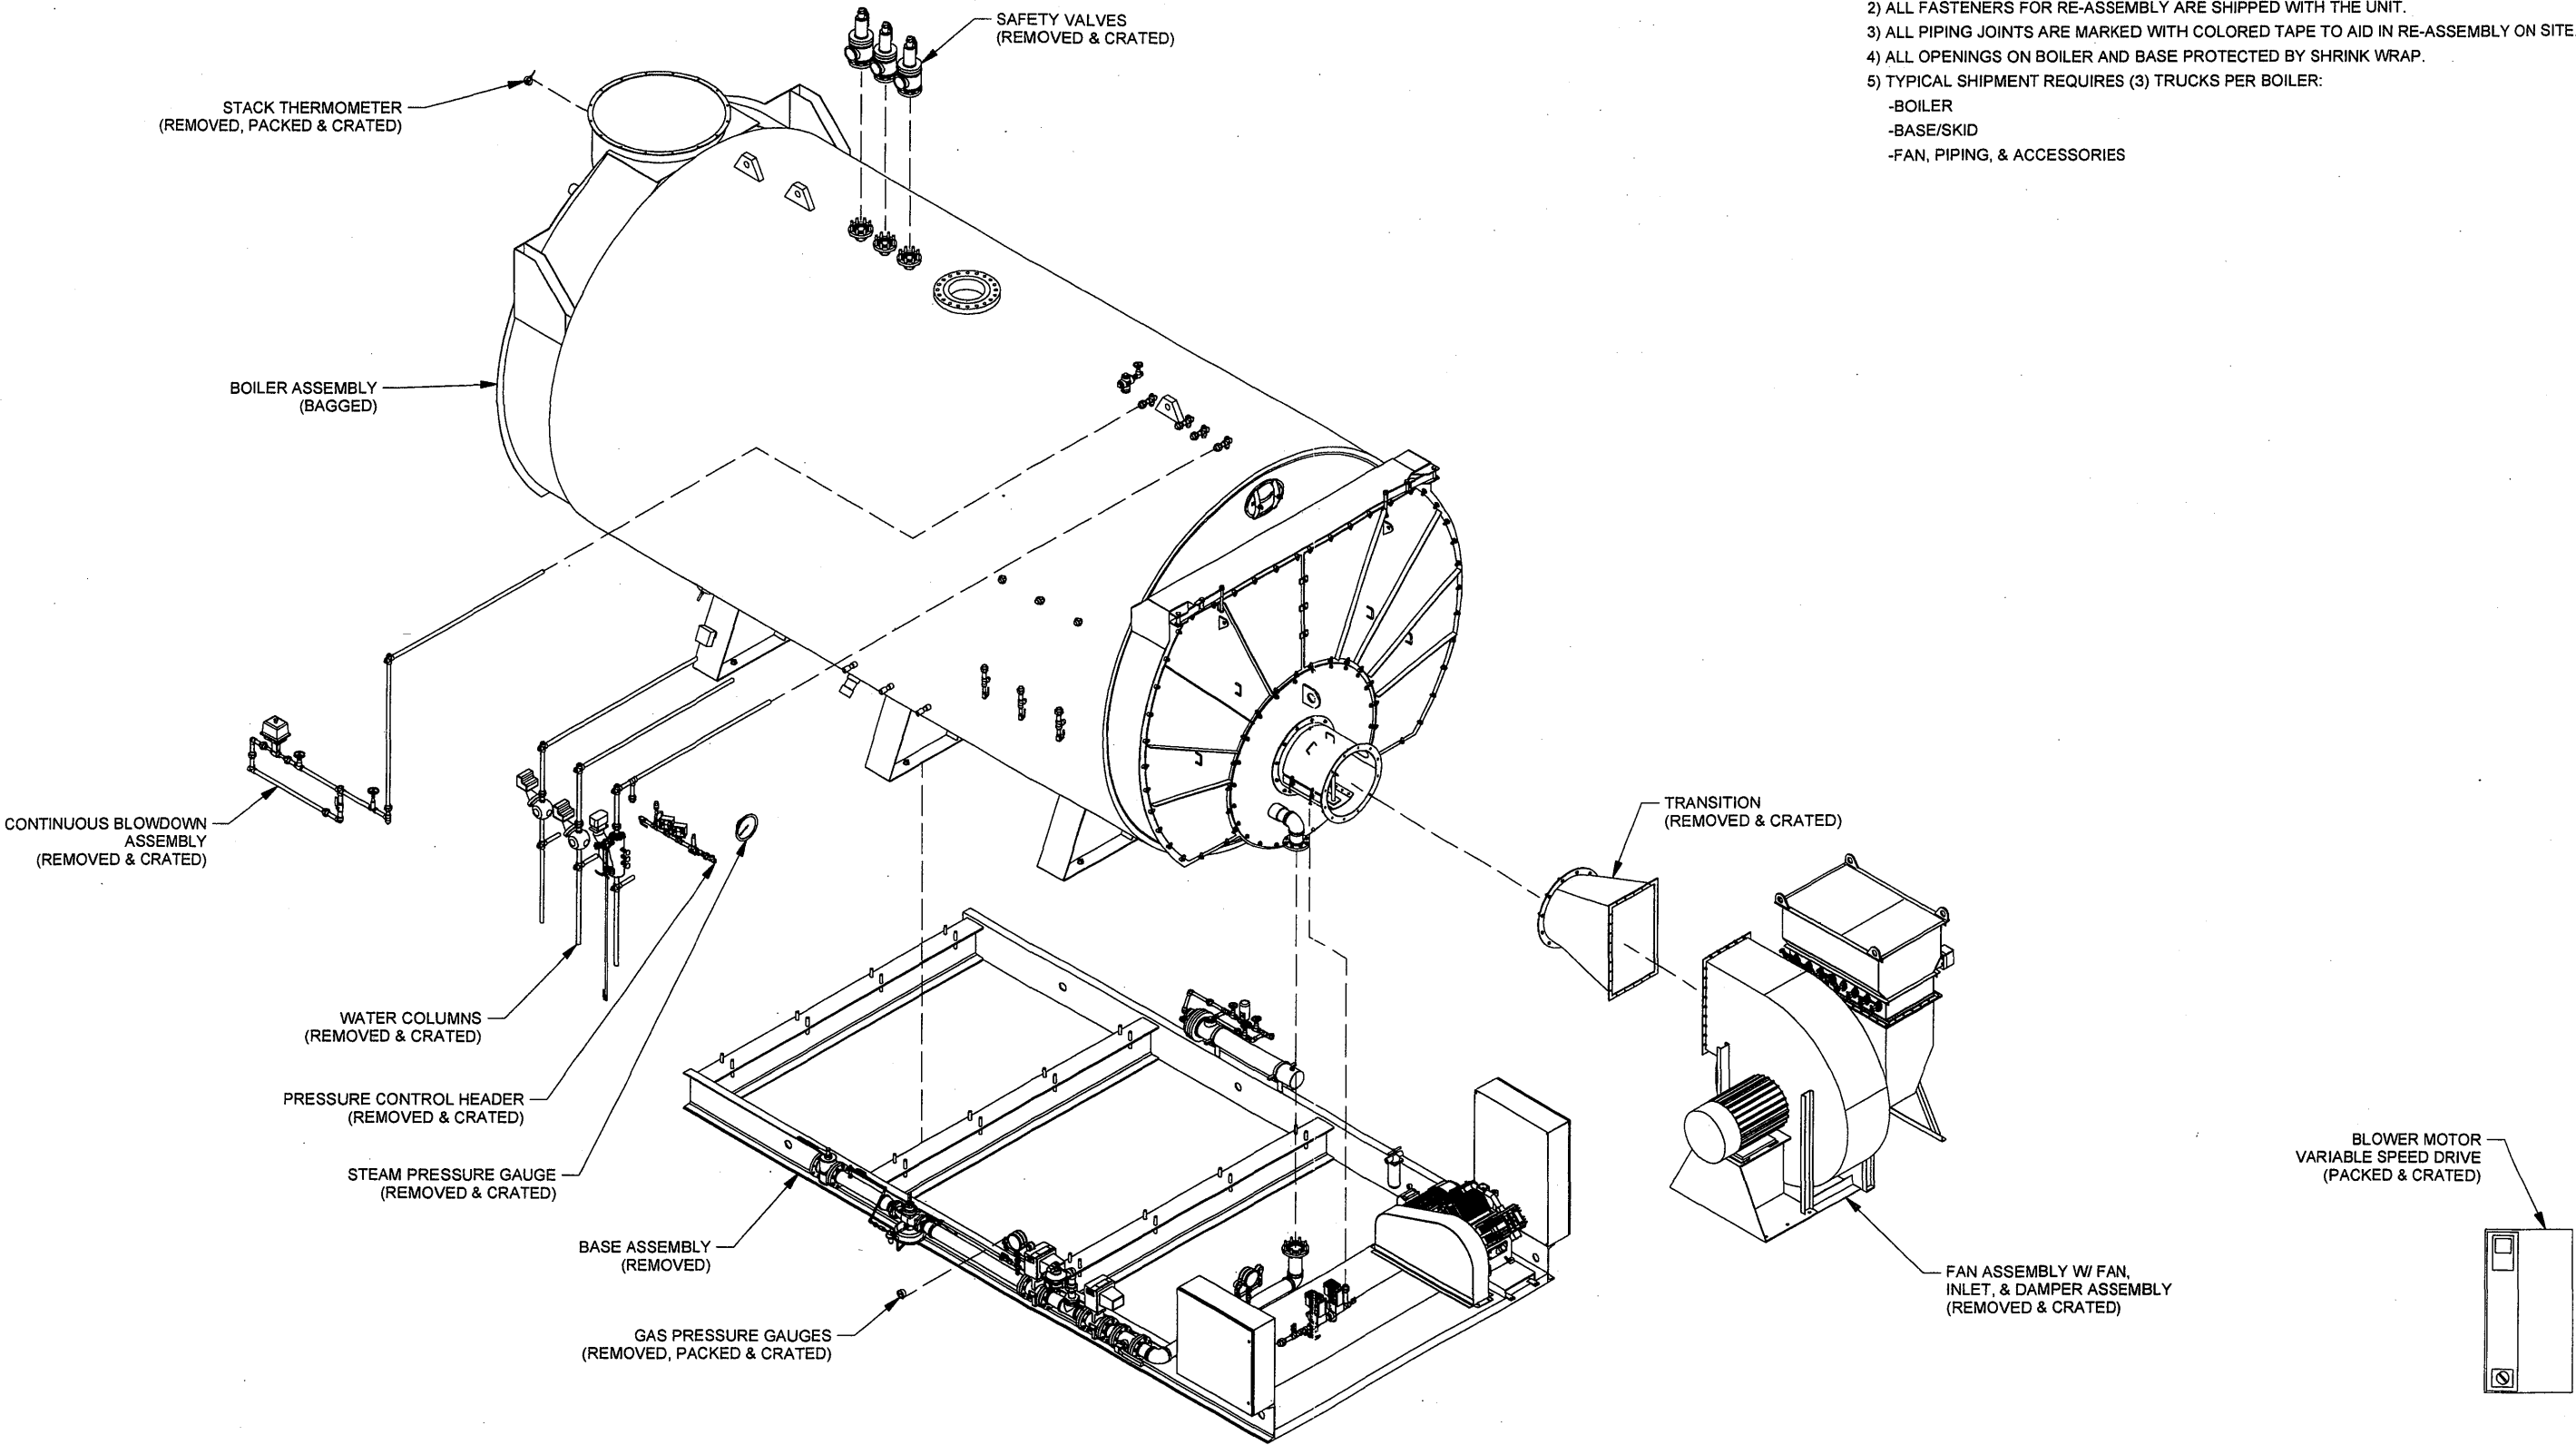

DWG NO.
1137733401

REVISIONS



JOHNSTON
BOILER
COMPANY

THIS DRAWING IS THE PROPERTY
OF THE JOHNSTON BOILER
COMPANY. THE DISCLOSURES
CONTAINED ON THIS DRAWING
ARE MADE WITH THE
UNDERSTANDING THAT THEY ARE
CONFIDENTIAL AND WILL NOT BE
USED IN ANY WAY DETRIMENTAL
TO THIS COMPANY'S INTEREST.

SCALE NONE	JOHNSTON BOILER COMPANY FERRYSBURG, MICHIGAN 49409	SO#
DATE 9/13/17		
DRAWN MTN	TYPICAL SHIPPING BREAKDOWN PFTS2000-3HG150S	REV
CHECKED		
APPROVED mn	DWG. NO. 1137733401	

Johnston Boiler Company

Bill of Material

Assembly P/N: 11377J1

Description: Boiler Controls & Piping

Dwg. No: 1137732301

Tag No.	Qty.	Service	Rev.	JBC	Name	Specification	Comment
PI-602	1	Steam Pressure Gauge			See Ship Loose List		
HV-604	1	Gauge Shutoff Valve		012664	VALVE BALL 0.750 NPT BRONZE	APOLLO 70-104-13 150#STM 600#WOG	
PSH-606	1	Operating Limit Pressure Switch		011986	SWITCH PRESSURE 10-150#	HONEYWELL L404F1102 SPDT (SNAP TYPE)	
PSHH-608	1	High Limit Steam Pressure Switch		033957	SWITCH PRESSURE 10-150# MR	HONEYWELL L4079B1041 BRK ON RISE (SNAP)	
PT-610	1	Steam Pressure Sensor		035820	SENSOR STEAM PRESSURE 0-200PSI	FIREYE PXMS-200K PPC5000/6000 0.25IN NPT	
-	1	Steam Siphon Loop		021483	SIPHON LOOP 0.25 BLK IRON	HONEYWELL 14026	
-	1	Reducing Bushing		010353	BUSHING 0.750 X 0.250 3000# FS	SA105 MUST COMPLY W/ASME B16.11-CURRENT	
HV-612	1	Ball Valve		012664	VALVE BALL 0.750 NPT BRONZE	APOLLO 70-104-13 150#STM 600#WOG	
TSL-614	1	Low Fire Hold Temperature Switch		013064	SWITCH TEMPERATURE LW FIRE HLD	UNITED ELECTRIC E-100-3BC-90036 100-400F	
TW-615	1	Thermowell		012924	THERMOWELL 0.500 NPT BRASS	UNITED ELECTRIC SD6225-75 W075 4IN LONG	
-	1	Pres. Control Pipe & Fitting Assembly		033336	PRESSURE INSTRUMENT PIPING	SENSOR W/OPERATING CONTROL	Refer to dwg# 420A0254 for mounting.
LG-618	1	Gauge Glass		013410	GLASS GAGE 0.625 X 9.625	RED LINE	
"	1	Gauge Glass Valve Set		025454	VALVE SET GAGE GLASS 0.500 NPT	CONBRACO 24-651-10	
"	4	Gauge Glass Rods		013060	ROD GAGE GLASS 13.50 LG	BRASS	
"	10'	Gauge Glass Valve Chains		010418	CHAIN SASH #8		
LC/LSL-622	1	Low Water Cutoff/Feedwater Controller		010723	CONTROL WATER LEVEL	MCDONNELL MILLER 194-7B	Casing Mark to be 50.13" above CL
HV-630	1	Gauge Glass Drain Valve		012663	VALVE BALL 0.250 NPT BRONZE	APOLLO 70-101-13 150#STM 600#WOG	
HV-632	1	Water Column Drain Valve		012664	VALVE BALL 0.750 NPT BRONZE	APOLLO 70-104-13 150#STM 600#WOG	
HV-640	3	Try Cock Set		010475	COCK GAGE 0.500 NPT BRASS	CONBRACO 26-305-28	
-	1	Gauge Glass Pipe & Fitting Assembly		033740	GAGE GLASS ASSY RED LINE STD	DRAIN PIPE & FITTINGS 0.25CONN/0.25	Refer to dwg# 441A0008 for mounting.
-	1	Water Column Pipe & Fitting Assembly		033067	WATER COLUMN ASSY STM COL 1.0	TOP/BOTTOM/NO DRAIN W/GLASS, RAI	Refer to dwg# 401A0749 for mounting.
LSLL-624	1	Aux. Low Water Cutoff		016636	CONTROL WATER LEVEL	MCDONNELL MILLER 150SM (SNAP SW)	Casing Mark to be 49.38" above CL
HV-634	1	Water Column Drain Valve		012664	VALVE BALL 0.750 NPT BRONZE	APOLLO 70-104-13 150#STM 600#WOG	
-	1	Water Column Pipe & Fitting Assembly		032486	WATER COLUMN ASSY STM NCOL 1.0	TOP/BOTTOM/NO DRAIN - RAISED	Refer to dwg# 401A0743 for mounting.
LSH-626	1	High Water Alarm		010719	CONTROL WATER LEVEL	MCDONNELL MILLER 150S (SNAP SWIT	Casing Mark to be 53.13" above CL
HV-638	1	Water Column Drain Valve		012664	VALVE BALL 0.750 NPT BRONZE	APOLLO 70-104-13 150#STM 600#WOG	
-	1	Water Column Pipe & Fitting Assembly		035747	WATER COLUMN ASSY STM NCOL 1.5	TOP/BOTTOM/NO DRAIN - RAISED/RED	Refer to dwg# 401A0776 for mounting.
BE/TE-643	1	Oxygen Sampling Probe Kit		035880	PROBE KIT OXYGEN 12-40IN STACK	FIREYE NXO2PK4 FOR PPC6000/NX6100 W/AMB.	
UY-643	1	Oxygen Sampling Probe Interface Unit		035874	MODULE EXPANSION O2 TRIM/FLUE	FIREYE NXO2INT - USE W/PPC6000/NX6100	
TI-644	1	Stack Thermometer			See Ship Loose List		
BG-646	1	Rear Burner Sight Port		013781	PEEPSIGHT COVER ASSEMBLY		
PSV-650	3	Safety Valves			See Ship Loose List		
HV-674	1	Continuous Blowoff Stop Valve		030504	VALVE GATE 1.000 NPT	CRANE #424 CLASS 200 FULL PORT	
HV-676	1	Continuous Blowoff Metering Valve		014001	VALVE GLOBE/METERING 1.000 NPT	TASCO 4445 150#STM 300#WOG BRONZE	
HV-688	1	Continuous Blowoff Sensor Drain Valve		030923	VALVE BALL 1.000 NPT BRONZE	APOLLO 70-105-13 150#STM 600#WOG	
CC/CE-690	1	Continuous Blowoff Controller/Probe		036933	CONTROLLER CONT BLOWOFF	PULSAFEEDER MICROVISION MVBXCHXS010-XXX	
CV-692	1	Continuous Blowoff Control Valve		028514	VALVE FLOW CONTROL 0.500	WORCESTER B4446PMSE W/1075 120VAC	
-	1	Continuous Blowoff Pipe & Fitting Ass'y		037209	PIPE CONT BLOW - PULSATROL	1.00 COUPLING - 1.00 METER - 0.50 VAL	Refer to dwg# 411B0092 for mounting.
-	1	Aux. Steam Pipe & Fitting Assembly		026823	AUX. STEAM POWER PIPING	0.75 STANDARD - #6 OIL W/STEAM HEA	Refer to dwg# 442A0001 for mounting
-	1	Boiler Package Label		036915	NAMEPLATE CODE DESIGN - NFPA85	JOHNSTON BOILER COMPANY 2.5X6.0	Note: Install on base saddle plate.

Johnston Boiler Company



Bill of Material


Assembly P/N: 11377J1

Description: Boiler Controls & Piping

Dwg. No: 1137732301

Notes

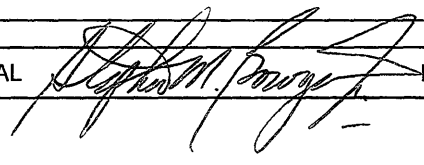Rev Data	No.	Date	By	Chk.	Description	Data Entry
	0	13-Sep-17	TJN			
ENGR APPROVAL			DATE	9/20/17	QC APPROVAL	
					DATE	09/20/17
					SO#	11377-01

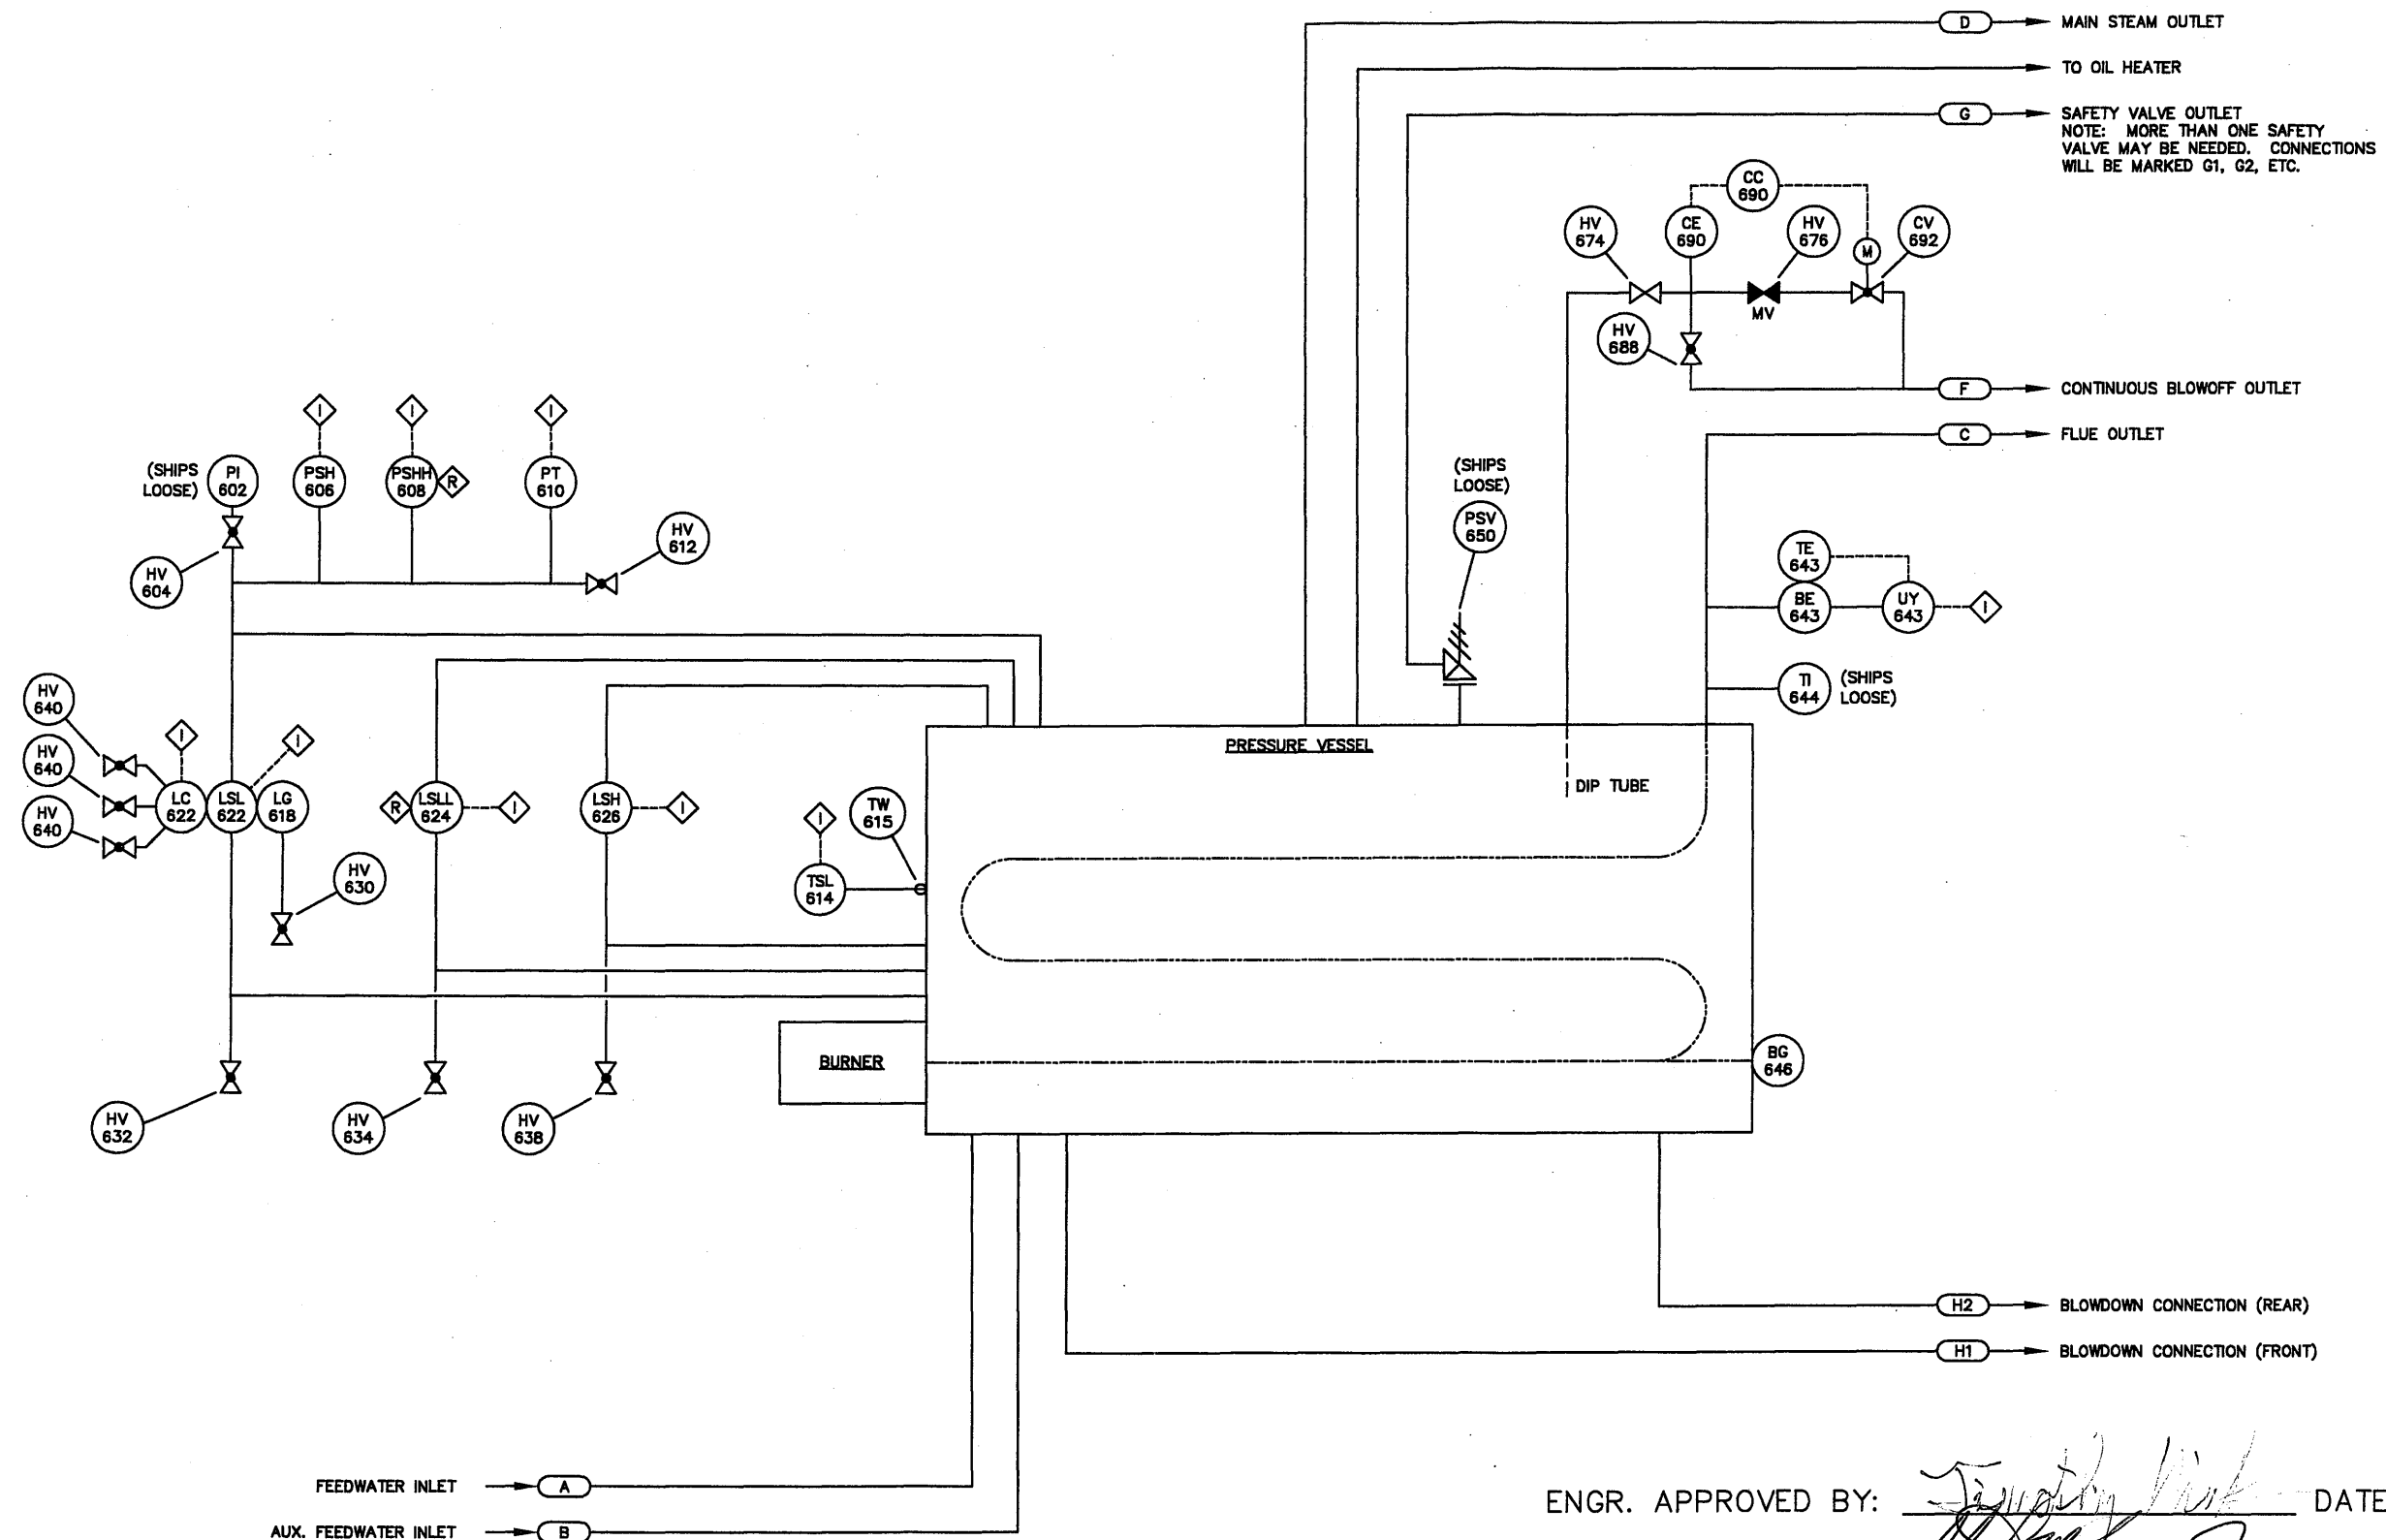

ENGR. APPROVED BY: T. Nink DATE: 9/22/17
 Q.C. APPROVED BY: Debra M. Jorgensen DATE: 09-21-17
 S.O. #: 11377-01

DWG NO.
1137732301

REVISIONS



THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

SCALE
NONE
DATE
9-13-17
DRAWN
T. NINK
CHECKED
APPROVED
TJN

JOHNSTON BOILER COMPANY
FERRYSBURG, MICHIGAN 49409
PIPING & INSTRUMENT DIAGRAM
BOILER
DWG. NO. 1137732301
REV