

Simulation of measured values

In this menu item, you can simulate any level or pressure values via the Profibus PA output. The value set in „Channel“ is simulated as linearised percentage value.

This is how you start the simulation:

→ Push [OK]




The simulation runs, the PA value is outputted acc. to the simulation value.

To terminate the simulation:

→ Push [ESC]



10 min. after the last pressing of a key, the simulation is automatically terminated.

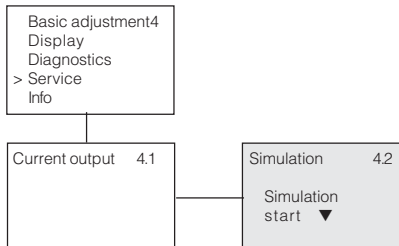

6 Dismounting

6.1 Dismounting procedure

Take note of chapter 4 „Mounting“ and carry out the listed steps in reverse order.

6.2 Disposal

PLICSCOM consists of materials which can be recycled by specialised recycling companies. We have purposely designed the electronics modules to be easily separable. Mark the instrument as scrap and dispose of it according to government regulations (electronic scrap ordinance, ...).

Materials: see technical data


If you cannot dispose of the instrument properly, please contact us about disposal methods or return.

Supplement

Technical data

Instrument name	Indication and adjustment module PLICSCOM
Power supply and data transmission	via the sensor through sliding contacts (I ² C-Bus)
Display	LC display in full dot matrix
Adjustment elements	4 keys
Automatic reset to measured value display	after approx. 10 min
Protection	IP 20 (mounted: IP 40)
Materials	
– housing	PE
– inspection window	Polyester foil
Weight	approx. 150 g
Ambient temperature	-15 ... +70°C
Storage and transport temperature	-40 ... +80°C

Dimensions

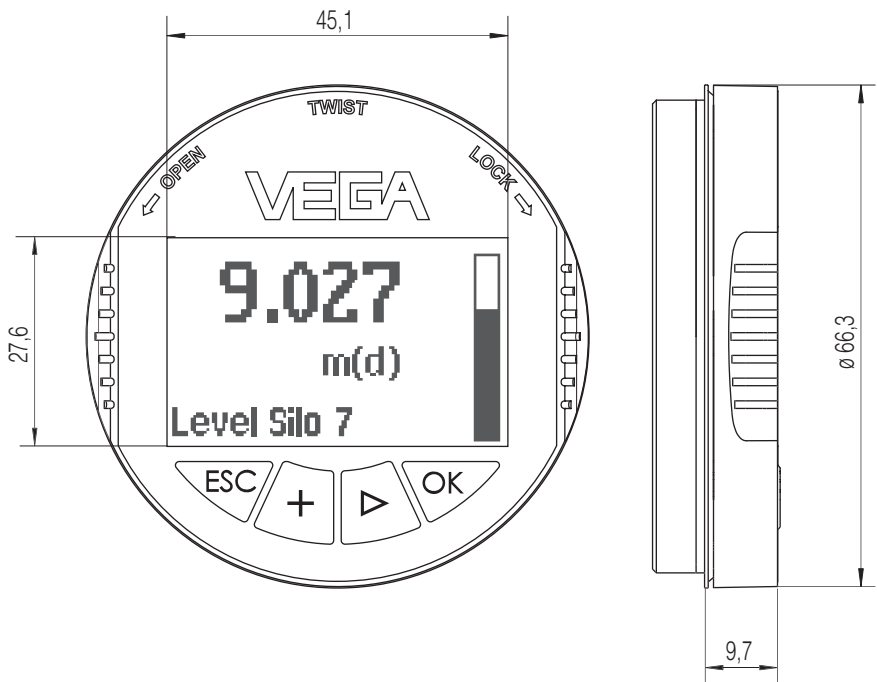



VEGA Grieshaber KG
Am Hohenstein 113
77761 Schiltach
Germany
Phone (07836) 50-0
Fax (07836) 50-201
E-Mail info@de.vega.com
www.vega.com



All statements concerning scope of delivery, application, practical use and operating conditions of the sensors and processing systems correspond to the information available at the time of printing.