



ESKOM POWER SUPPLY VS DEMAND BALANCE

34.03K


Peak Residual of Demand

547.00K


Average Daily Generation

SeasonFinale	Day	Night	Total ▲
Summer	100 360 154.80	95 538 784.48	195 898 939.28
Spring	105 330 535.58	99 693 724.60	205 024 260.18
Autumn		116 873 966.85	242 555 994.27
Winter		117 614 487.19	245 940 680.86


ESKOM: Share of Renewable Energy Generation by Technology

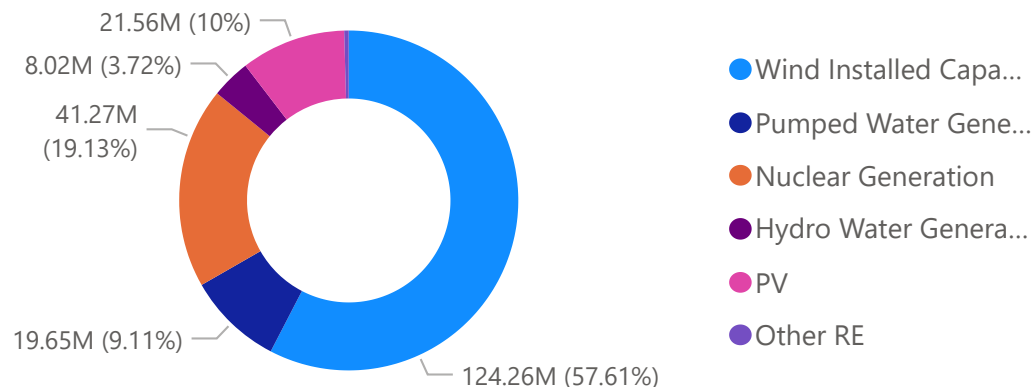

ESKOM Power Balance: Residual Demand vs Dispatchable Generation

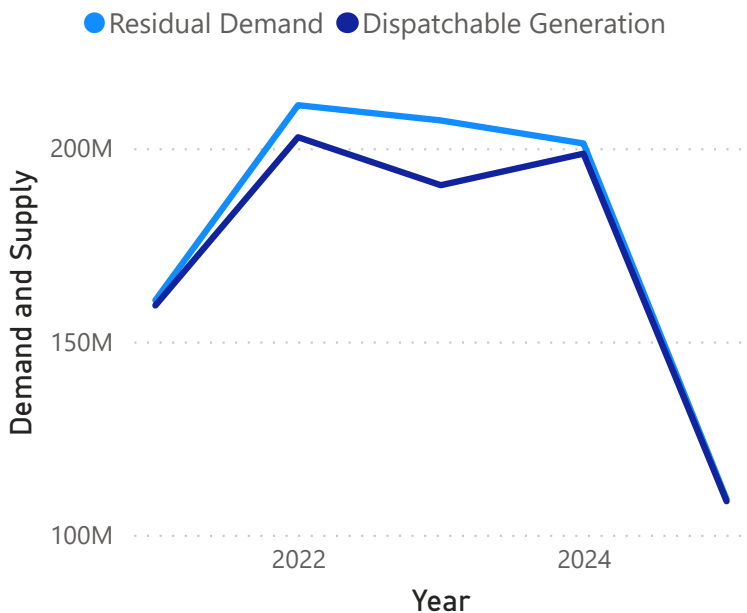

ESKOM: Yearly Residual Demand vs Dispatchable Generation Gap

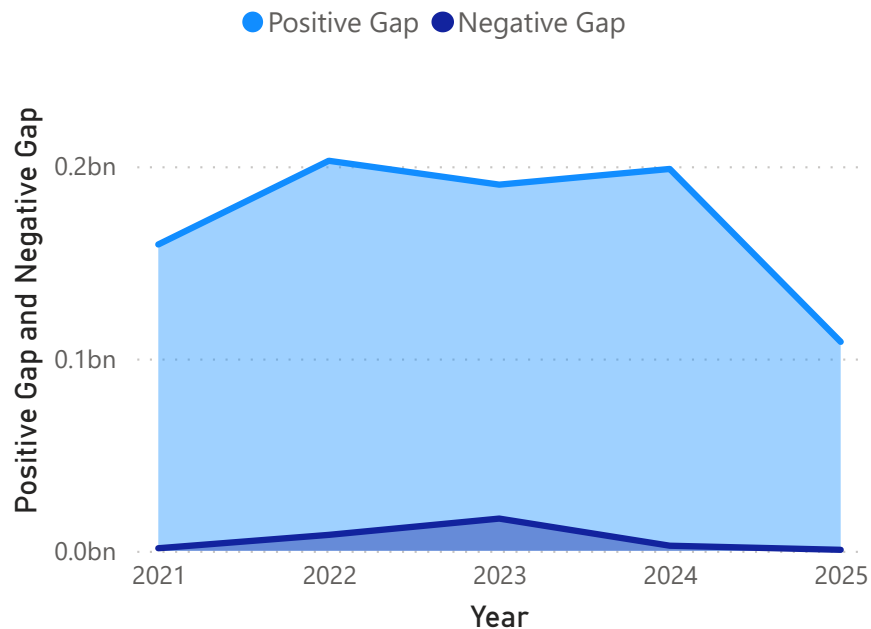

ESKOM: CSP Generation and Capacity Utilization Trends

