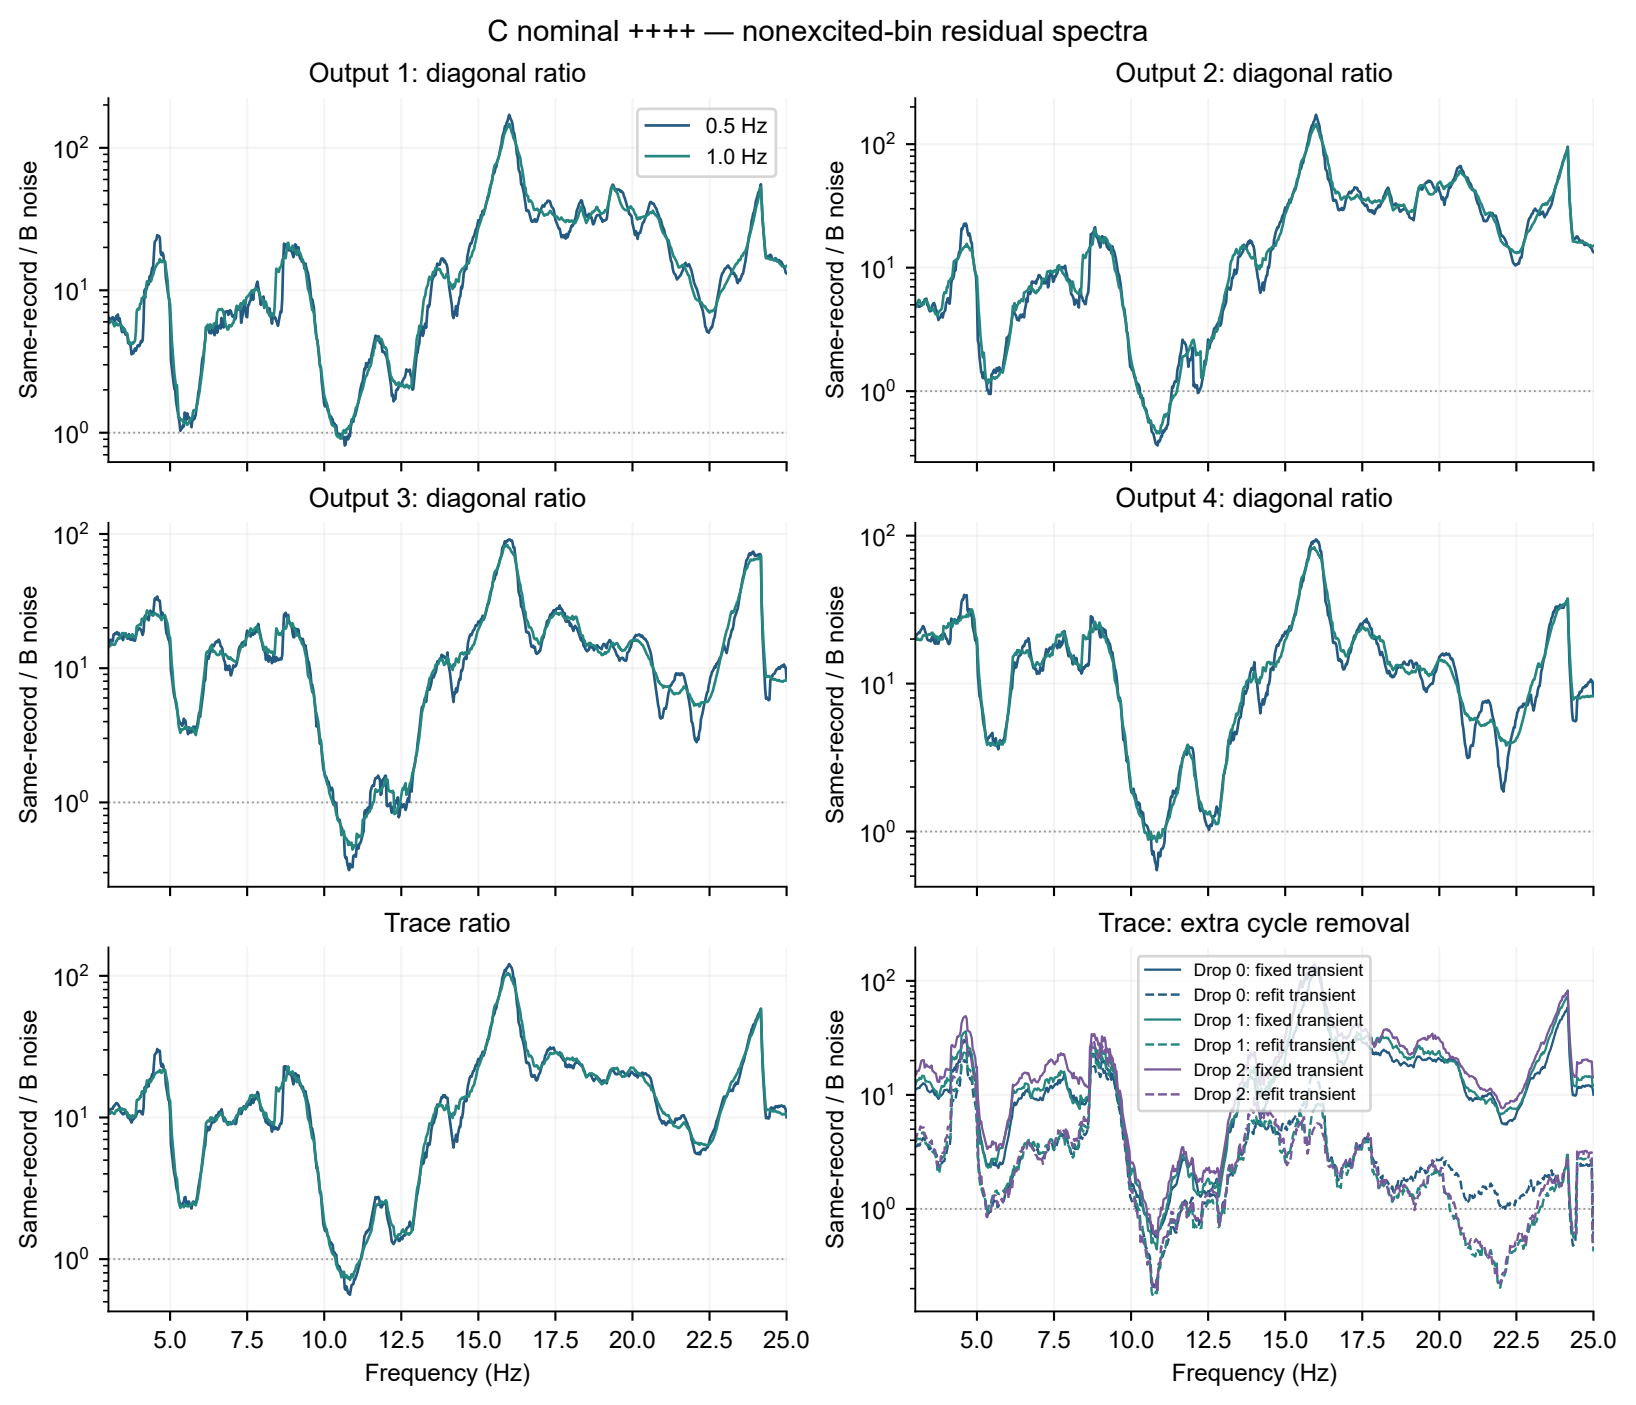

C nominal ++++ — nonexcited-bin residual spectra
Output 1: diagonal ratio
Output 2: diagonal ratio
Output 3: diagonal ratio
Output 4: diagonal ratio
Trace ratio
Trace: extra cycle removal
Same-record / B noise
Frequency (Hz)
0.5 Hz
1.0 Hz
Drop 0: fixed transient
Drop 0: refit transient
Drop 1: fixed transient
Drop 1: refit transient
Drop 2: fixed transient
Drop 2: refit transient