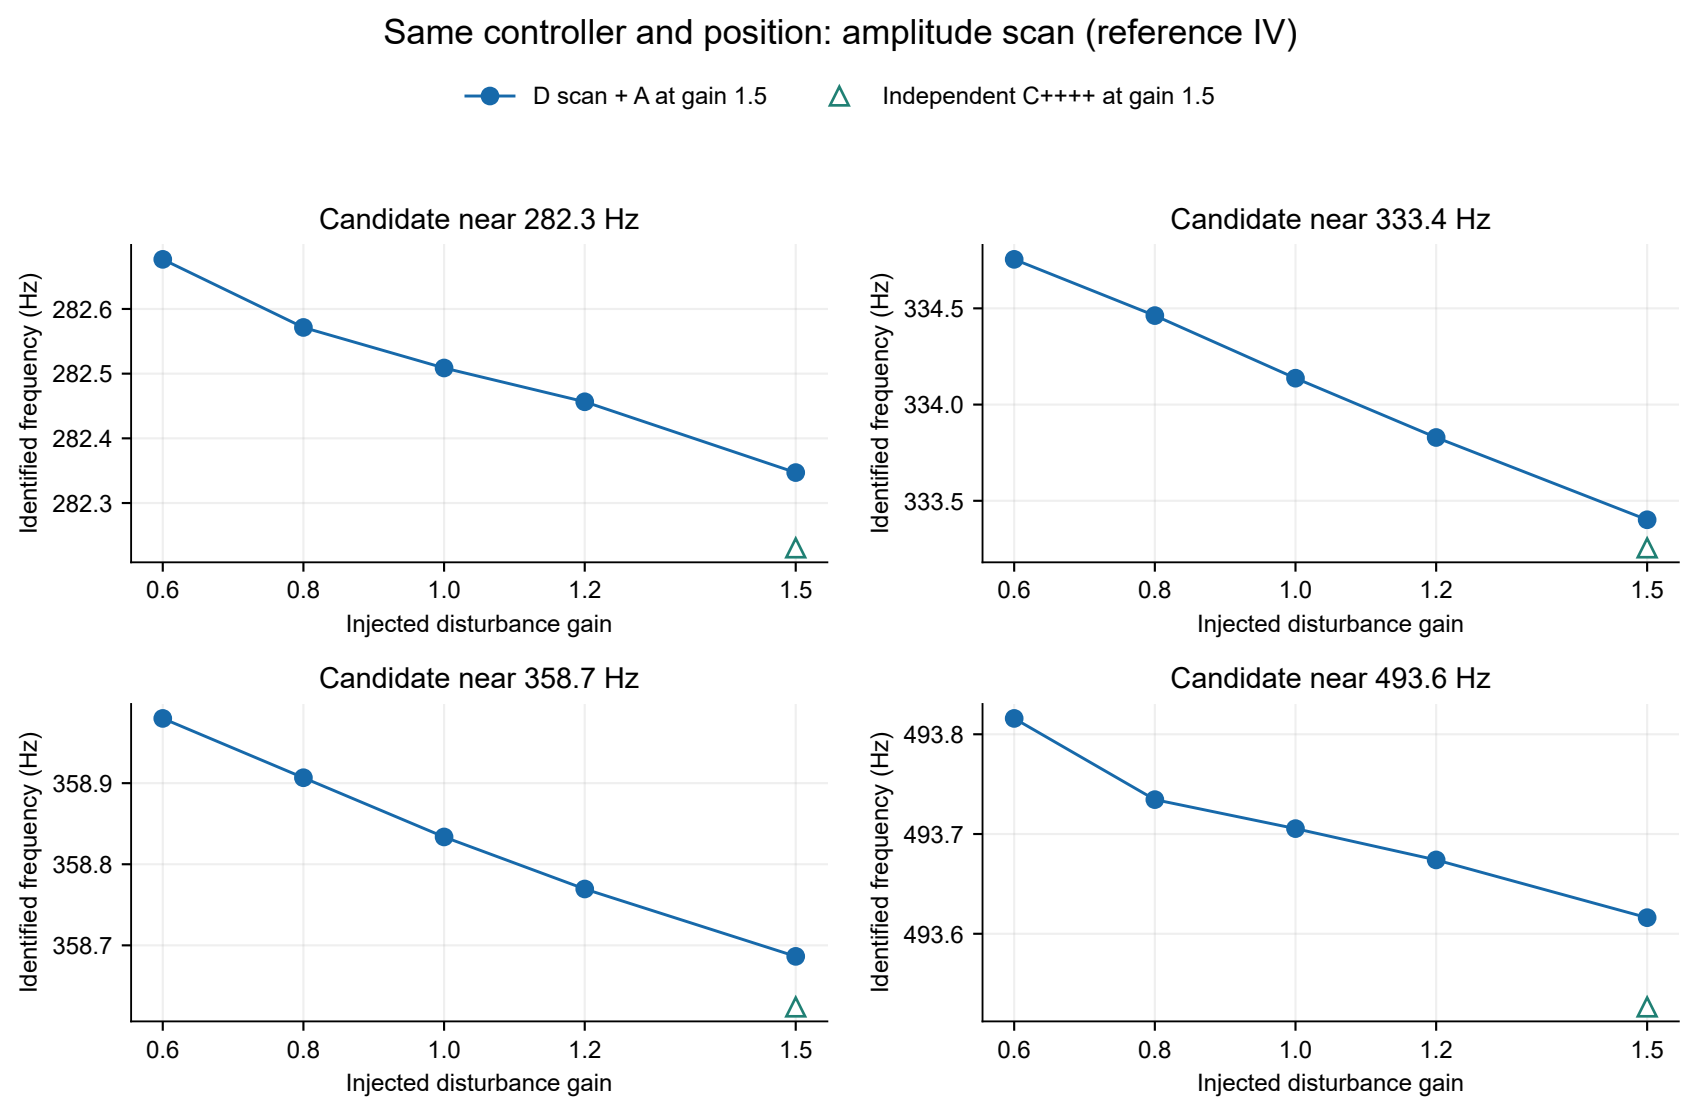
Same controller and position: amplitude scan (reference IV)
D scan + A at gain 1.5
Independent C++++ at gain 1.5
Candidate near 282.3 Hz
Candidate near 333.4 Hz
Candidate near 358.7 Hz
Candidate near 493.6 Hz
Identified frequency (Hz)
Injected disturbance gain
0.6
0.8
1.0
1.2
1.5
282.3
282.4
282.5
282.6
333.5
334.0
334.5
358.7
358.8
358.9
493.6
493.7
493.8
One record per gain; lines guide the eye. Trend does not by itself establish a physical nonlinear mechanism.