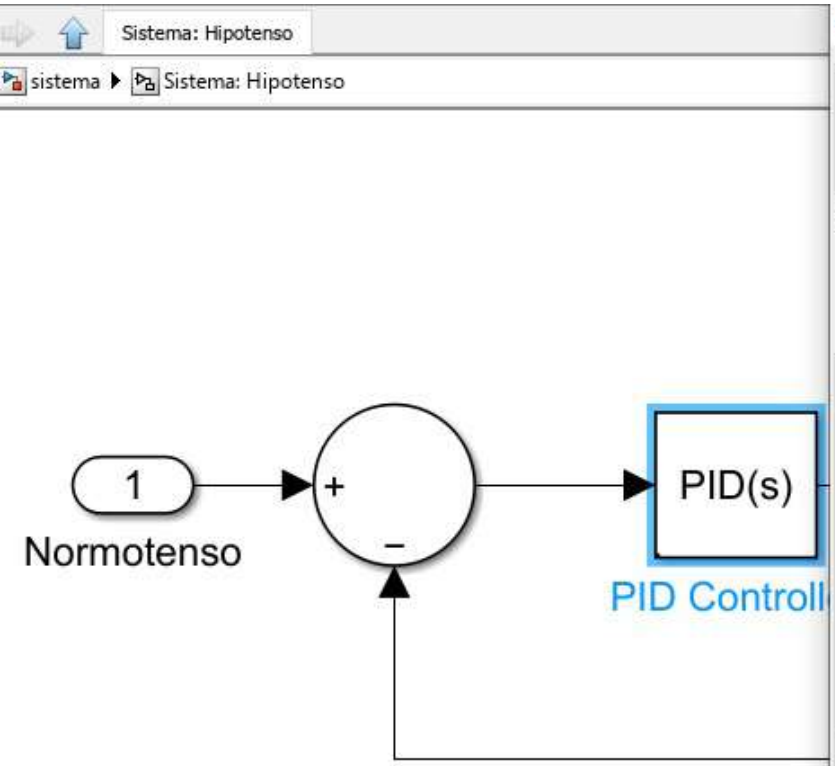

Block Parameters: PID Controller

Time domain:

- (•) Continuous-time
- ( ) Discrete-time

Discrete-time settings

Sample time (-1 for inherited): -1

▼ Compensator formula

$$P + I\frac{1}{s} + D\frac{N}{1 + N\frac{1}{s}}$$

Main | Initialization | Saturation | Data Types | State Attributes

Controller parameters

Source: internal

Proportional (P): 458.18412862009

Integral (I): 1110647.27603615 ☐ Use I*Ts (optimal for codegen)

Derivative (D): 0.00626708429767374

Filter coefficient (N): 50025.0214920577 ☑ Use filtered derivative

Automated tuning

Select tuning method: Transfer Function Based (PID Tuner App) Tune...

OK | Cancel | Help | Apply