
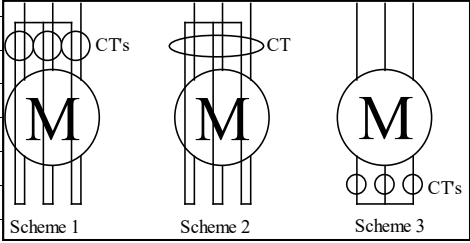


	Vendor Document Review Sheet (DECAL)						
PROJECT TITLE:		1000 KTA POLYVINYL CHLORIDE (PVC)					
VENDOR NAME:		KSB Limited					
DOCUMENT TITLE:		Pump Motor Datasheet for Recycled water pump (10kg/cm2g)					
VENDOR DOCUMENT NO:		9975714953-100-MDS					
VENDOR REVISION NO:		04					
VENDOR DOCUMENT REVIEW FEEDBACK							
Permission to proceed does not constitute acceptance or approval of Design Detail, Calculations, Analysis, Test Methods or Materials developed OR selected by Vendor, and does NOT relieve Vendor from FULL compliance with Contractual Obligations.							
☒ 1 Approved. ☐ 2 Approved with comments. Work may proceed. ☐ 3 Revise and Resubmit. Work Shall not proceed. ☐ 4 Retained for Information. ☐ 5 Cancelled / Superseded ☐ F Final Certified By: _____ Date: _____							
Discipline:	Mechanical		MOC Number:	NA		JI Number	N23P01
Equipment No.	MP-PP031-P600173A/B MP-PP031-P700173A/B						
MRQ Number	MT-N23P01-D11NPP-MPP001-TPD-Q-04						
Program No	MRP Number Excluding Discipline & Type		Unit No. (Plant WBS)	Cat. No	Seq. No.	Rev No	
NP3701	N23P01-D11NPP-MPP001-TPD-P-04		- 0 3 1 -	D 0 2 -	0 0 8 -	0 4	

VINYLS PROGRAM - 1000 KTA POLYVINYL CHLORIDE (PVC)					
Comment Resolution Sheet					
Document Identification Attributes					
Doc. Name	Pump Motor Datasheet for Recycled water pump (10kg/cm2g)	Tag No.	MP-PP031-M600173A/BMP-PP031-M700173A/B	Reliance Industries Limited KSB Solutions. For Life.	
Doc. No.	N23P01-D11NPP-MPP001-TPD-P-04-031-D02-008	Revision No.	4		
KSB S.O.No.	9975714953	Date	13-01-2026		
Contractor reply to Comments					
Sr No	Customer Comments	CG Reply			
1	2RX3CX240SQMM	Noted& Updated			
2	2RX3CX240SQMM. Why cable size has been changed?	Noted& Updated Noted			
END OF DOCUMENT					

CLIENT: Reliance Industries limited		EQUIPMENT NO.:  MP-PP031-M600173A/B				
PROJECT TITLE: VINYLs PROGRAM 1000 KTA POLYVINYL CHLORIDE (PVC)		M.R. NO.: MT-N23P01-D11NPP-MPP001-TPD-Q-04				
PROJECT LOCATION: NAGOTHANE, MH		Refer to Specification:- RPMS-ENGG-SPC-EL-004				
		Manufacturer:- CG Power and Industrial Solutions Limited				
REQUIREMENTS AND CONDITIONS (To Be Supplied By Buyer)						
Site Conditions		Basic Data (cont'd...)				
Altitude <1000 metres		Winding Temp. Monitoring: ☐ Yes ☒ No				
Ambient Temperature:		RTD's Required: ☐ Yes ☒ No				
MAX:- 43°C		Thermocouples Req.: ☐ Yes ☒ No				
MIN:- 3°C		No. per Winding ☐ Two ☒ Other				
DESIGN:- 43°C		Bearing Temp. Monitoring: ☐ Yes ☒ No				
Area Classification:- TEFC Safe Area		RTD's Required: ☐ Yes ☒ No				
Temperature Class:- NA		Thermocouples Req.: ☐ Yes ☒ No				
Gas Group:- NA		No. per bearing: ☐ One ☐ Two				
Type of Protection:- IP55 (NOTE 2.)		Differential CT's:				
Basic Data		Required ☐ Yes ☒ No				
Supply System: 415 V +/-10% 3 Ph. 50 Hz +/-5%		Ratio:-				
Neutral: ☐ Unearthed ☐ Resistance Earthed		Accuracy Class:-				
☒ Solidly Earthed						
Cooling method: * ☐ TENV ☒ TEFC ☐ TETC		CT Arrangement:				
(SEE SPEC. CLAUSE 4.1) ☐ TEAAC ☐ CACA ☐ CACW		☐ Scheme 1				
☐ TEWAC ☐ WPI ☐ WPPI		☐ Scheme 2				
Degree of Enclosure Protection:- IP55		☐ Scheme 3				
Continuous Rating:- 75 kW (NOTE 8.)						
Service Factor: ☒ 1 ☐ Other:-						
Synchronous Speed:- 3000 RPM						
Duty:- S1						
Insulation Class:- F		Cable Type: Motor:- 2R*3C,240sqmm				
Motor Duty:- S1		VFD driven motor application " Constant Power				
Motor Efficiency as per IS-12615:- IE2		" Constant Power				
VFD driven motor ☐ Thermister on stator winding Not Applicable		" Variable Torque				
Max. Permitted Temp Rise:- class 'B' 77 °C		Heater:- 2CX2.5Sq,mm				
Direction of Rotation:- * ☐ CW ☐ CCW ☒ Bi-Dir.		Winding RTD:- N/A				
(viewed from non-drive end) (NOTE 3.)		Bearing Sensor:- N/A				
Method of Starting:- ☒ DOL ☐ VFD ☐ Soft starter		CT:- N/A				
Winding Connection: ☐ Star ☒ Delta		Heater Terminal Box Entry: M20X1.5P				
Neutral Terminals req.: ☐ Yes ☒ No		RTD/Thermocouple Terminal Box Entry: NA				
(NOTE 4.)		CT Terminal Box Entry: N/A				
Shaft Orientation * ☒ Horizontal ☐ Vertical (NOTE 9)		Outline Drawing (V.P. No.) N23P01-D11NPP-MPP001-TPD-P-04-031-B02-018-02				
Mounting: * ☒ B3 ☐ Flange		Motor Starter Protective System:				
Slide Rails Required: * ☐ Yes ☒ No		(NOTE 6.) ☒ Fuses/Contactor ☐ Circuit Breaker				
Heater Required: (NOTE 5.) ☒ Yes ☐ No		☒ Overload ☒ Earth Fault (>22kW)				
Heater Voltage:- 240 Volts		☐ Undercurrent ☒ Phase Unbalance				
Drain Required: * ☒ Yes ☐ No		☐ Undervoltage ☒ Stall				
Breather Required: * ☐ Yes ☒ No		☐ Limit No. of Starts ☐ Overcurrent				
Maximum Noise Level: 85 dBA @ 1 m		Prospective System Fault Current:- 50kA (RMS SYM.)				
		Surge Protection Required: ☐ Yes ☒ No				
LOCATION OF TERMINAL BOX AND ENTRY (See Motor List)		MOTOR LIST				
		TAG NO.	TERMINAL BOX		CABLE SIZE	SERIAL NUMBER
			Position	Tapping		
		MP-PP031-M600173A/B	TOP	M63X1.5P		
ABBREVIATIONS		REMARKS				
DP - Drip Proof	Exd - Explosion Proof	* = MECH. EQUIPMENT SELLER TO SPECIFY				
SP - Screen Protected	ExN - Non Sparking	NOTE 1. Separate data sheet to be completed for each motor except for				
SPLP - Splash Proof	Exe - Increased Safety	motors which are identical in all respects.				
WPI - Weather Proof I	Exp - Pressurised	NOTE 2. Type of protection to be specified				
WPPI - Weather Proof II	FLP - Flame Proof	NOTE 3. Direction of rotation to be as required by driven equipment.				
TENV Totally Enclosed, Non-Ventilated		NOTE 4. All six ends of motor terminals shall be brought out to the				
TEFC Totally Enclosed, Fan Cooled		terminal box in the case of star connected motors.				
TETC Totally Enclosed, Tube Cooled		NOTE 5. Separate heater element shall be provided for motors rated 37kW				
TEAAC Totally Enclosed, Air to Air cooled		and above. Motors rated below 37kW shall employ				
CACA Totally Enclosed, Air circuit machine with air cooler		24V AC direct winding heating.				
CACW Totally Enclosed, Air circuit machine, water cooled air cooler		NOTE 6. Motors rated above 90kW are circuit breaker switched.				
		NOTE 7. Colour shall be light grey to RAL 7032.				
		NOTE 8. * Continuous rating of motor is dependent on driven equipment.				
		NOTE 9. * Shaft Orientation (Up or Down).				

[illegible]

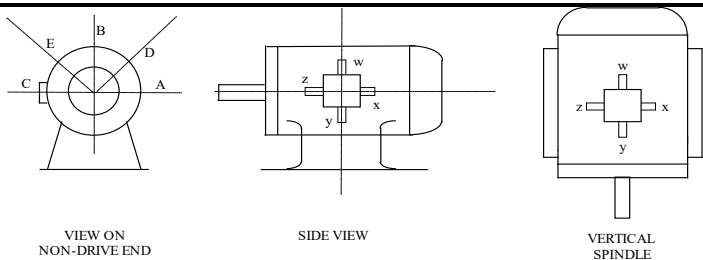

CG Power and Industrial Solutions Limited

LT Motors Division
Ahmednagar



Tag No-MP-PP031-M600173A/B
MP-PP031-M700173AB

DATA SHEET OF 3 PHASE INDUCTION MOTOR

Customer : Ksb Limited		Enquiry / INDENT NO : QNCI250551/700 (Dated: 04/05/2025)	
Project: 1000 KTA POLYVINYL CHLORIDE (PVC)		Client: Reliance Industries Ltd	
Frame	ND280S	Rated Output (kW)	75
Voltage (V)	415 +-10%	Rated Current (A)	124.00
Rated Speed (RPM)	2972	No of poles	2
Frequency (Hz)	50 +-5%	Duty	S1
Method of Cooling	IC411	Degree of Protection	IP55
Gas Group	Not applicable	Mounting	B3
Temp Class	NA		
Enclosure	TEFC Safe Area		
Load	100% Load	75% Load	50% Load
Efficiency	IE2 - 93.8 %	93.8 %	92 %
Power factor	0.90	0.88	0.85
AMB. Temp/Temp rise	50°C/70°C (By Resistance Method)		
Insulation class	F (Temp. rise limited to class 'B')		
Rated Torque (kg-m)	24.58		
Locked rotor current % FLC	700		
Starting torque % FLT	250		
Pull out torque % FLT	300		
Method of starting	Direct On Line		
Winding connections	Delta		
No of terminals	6		
Direction of rotation	Bidirectional		
Motor GD Sq. (kg-m²)	3.40		
Load GD Sq. (kg-m²)	3.40		
Starting time @100% V (Sec)	1.2		
Locked rotor Withstand time hot (Sec.)	15		
Locked rotor Withstand time cold (Sec.)	30		
Stator Thermal / Cooling time constant (min)	60 / 120		
Terminal box position	TOP		
Cable size	2*3C,240-sqmm & 2 Cable entries required Cable entries sealed by Metallic Plug		
Bearing DE/ODE	6314-C4 / 6314-C4		
Type of lubrication	Unirex-N3		
Shaft Material	EN8 OR C40	Stator Body Material	Cast Iron
Net Weight (Approx.) kg	600		
Paint shade	RAL7032 Epoxy Pebble grey		
Applicable standards	IS:12615,		
Accessories			
Additional nameplate(160 & up),DOR plate (160 & up),GI Canopy,SP Heater 65WX2 (250-315),Gel coat,C3M, Co planar soft foot,Full Gasket,Vertical Jacking hole,Metallic Plug ,One size Higher TB			
Customer specific requirement if any:			
All performance data is subject to tolerance as per IS/IEC 60034			
Issued By :		Suraj Pawar	
Date : 04/05/2025			

R4

R3