

FBI & EPA ALERT I-073026-PSA 30 JULY 2026

TAKE THE PLCs OFF THE INTERNET. THEN SOLVE WHAT PUT THEM THERE.

Nobody wires a controller to a cellular modem for fun. Somebody needed data out of an unstaffed site, and that was the only way to get it. **Remove the modem and the requirement is still there.** That requirement is the one we solve — permanently, and in hardware.

THREE YEARS · THE SAME DIGITAL WEAKNESS

2026 JUL**SEVEN STATES & COUNTING**

Allen-Bradley controllers reached remotely, addresses and passwords changed, operators locked out. Loss of pressure and flooding reported.

2024 JAN**MULESHOE, TEXAS**

Attackers manipulated a system until a storage tank overflowed.

2023 NOV**ALIQUIPPA, PENNSYLVANIA**

A water authority lost control of a booster station and reverted to manual operation.

THE PART MOST VENDORS LEAVE OUT

“After remotely accessing internet-facing devices, the actors changed the IP addresses and passwords, resulting in a loss of monitoring and control functionality.”

FBI & EPA Public Service Announcement I-073026-PSA, 30 July 2026

Not one of these crossed from IT into OT. Every one was a device sitting on the public internet — so a boundary gateway would not have been in the attack path, and we are not going to tell you otherwise. Removing that exposure comes first. That is the FBI and EPA's advice. It is also ours.

AS REPORTED

CISA: Over 100 Internet-Exposed Water Systems Targeted in July Cyberattacks

SecurityWeek · 26 August 2026

More than 100 water systems were hit in July cyberattacks

The Register · 26 August 2026

SO ASK THE QUESTION NOBODY ASKS: WHY WAS IT EXPOSED?

Because the SOC needed alarms. Because the state wanted compliance data on a schedule. Because somebody had to read a tank level at 2 a.m. without driving forty miles. CISA's guidance is to work out which exposures are truly necessary and remove the rest — **and every one of those needs is a one-way requirement.** You still need the data out. You do not need a way back in.

100+

internet-exposed water and wastewater systems targeted in July 2026 alone.

CISA · AUGUST 2026

12

states reached by the campaign, commonly via PLCs wired straight to a cellular modem.

CISA · AUGUST 2026

70%+

of inspected water systems not fully complying with federal risk-and-resilience requirements.

EPA ENFORCEMENT ALERT · SDWA §1433


THE TERAENCE SOLUTION

“Specifically, ‘remove inbound port exposure,’ so the OT system is never directly exposed to the internet or external networks.”

FBI & EPA Public Service Announcement I-073026-PSA, 30 July 2026 – first recommendation

WE TOOK THAT LITERALLY. THE DATA GETS OUT. NOTHING GETS BACK IN.

Not filtered by a rule somebody can change — **the return path is absent from the circuit.** An FPGA moves frames one way at Layer 1/2: no CPU, no OS, no IP or MAC on the data path. Nothing to scan, nothing to log into, nothing to misconfigure.

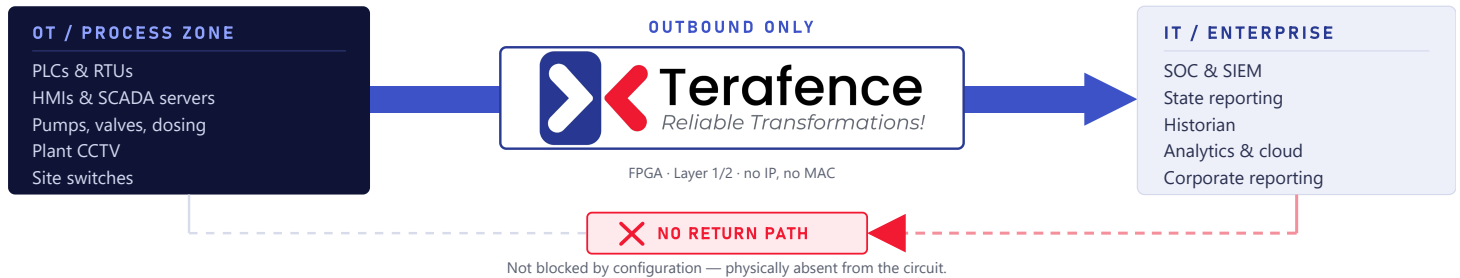

WHY TERAENCE

Unbreachable, Unmatched

Data leaves your plant. Nothing returns. The way back is absent from the hardware, not blocked by a rule someone can edit.

Fits the plant you already run.

No re-addressing, no downtime, no retraining. No IP, no MAC — it goes in beside your equipment and disappears into the topology.

Bought once. Trusted for years.

No patch cycle, no CVE watch, no licence renewal. Fanless, no moving parts. A capital asset, not a subscription.

Proven where failure is fatal.

Defence, national space programmes, power grids and water authorities on six continents already run behind it.

WHAT LEAVES THE PLANT

HMI, PLC and switch events → SOC and SIEM	Syslog
Production and compliance records → state reporting	SFTP · SMB
Process telemetry, tank level, pressure, flow → historian	OPC UA · Modbus · DNP3
Plant CCTV → security operations	RTSP · ONVIF
Alarms and equipment status → analytics	HTTP/S

**No topological change, no disconnection of the work environment.
Effective, convenient and at a very high security level.**

Yariv Karmel · CIO and Information Security · Jordan Valley Water Association

A regulator required continuous equipment status at a state security operations centre — without the plant network ever becoming reachable.

DEFENCE / SPACE PROGRAMMES / POWER GRIDS / WATER AUTHORITIES / MANUFACTURING

Assessed against IEC 62443-4-2 at SL 2 by an independent laboratory. Independently penetration tested by specialist laboratories, with no vulnerabilities reported. EMI/EMC and FCC tested. Certificates, test reports and model-specific specifications on request — we would rather you read them than take our word for it.

BOOK A SESSION WITH OUR EXPERTS

We map what actually needs to leave your plant, what is reachable today, and what it would take to remove the inbound path. You keep the map whether or not you ever buy anything from us.

terafence.us/contact · info@terafence.us

