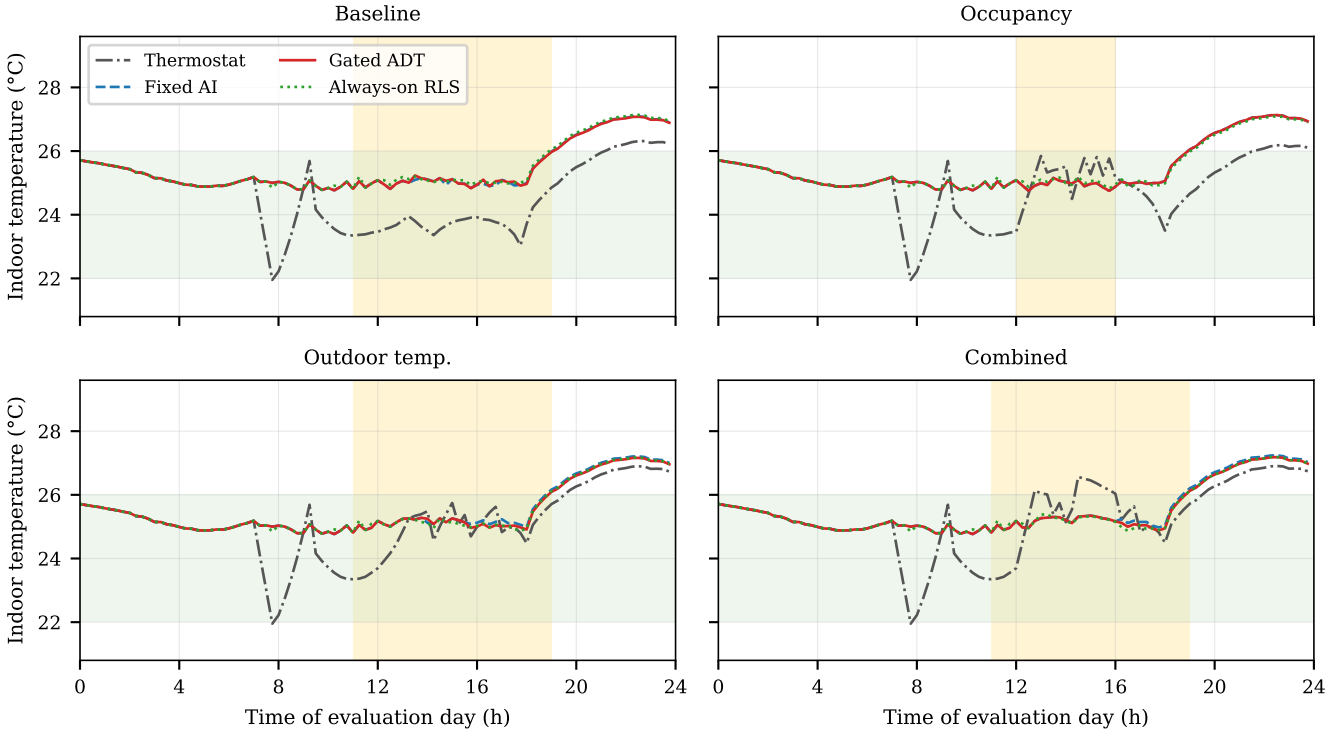
Baseline
Occupancy
Outdoor temp.
Combined
Thermostat
Fixed AI
Gated ADT
Always-on RLS
Indoor temperature (°C)
22
24
26
28
0
4
8
12
16
20
24
Time of evaluation day (h)