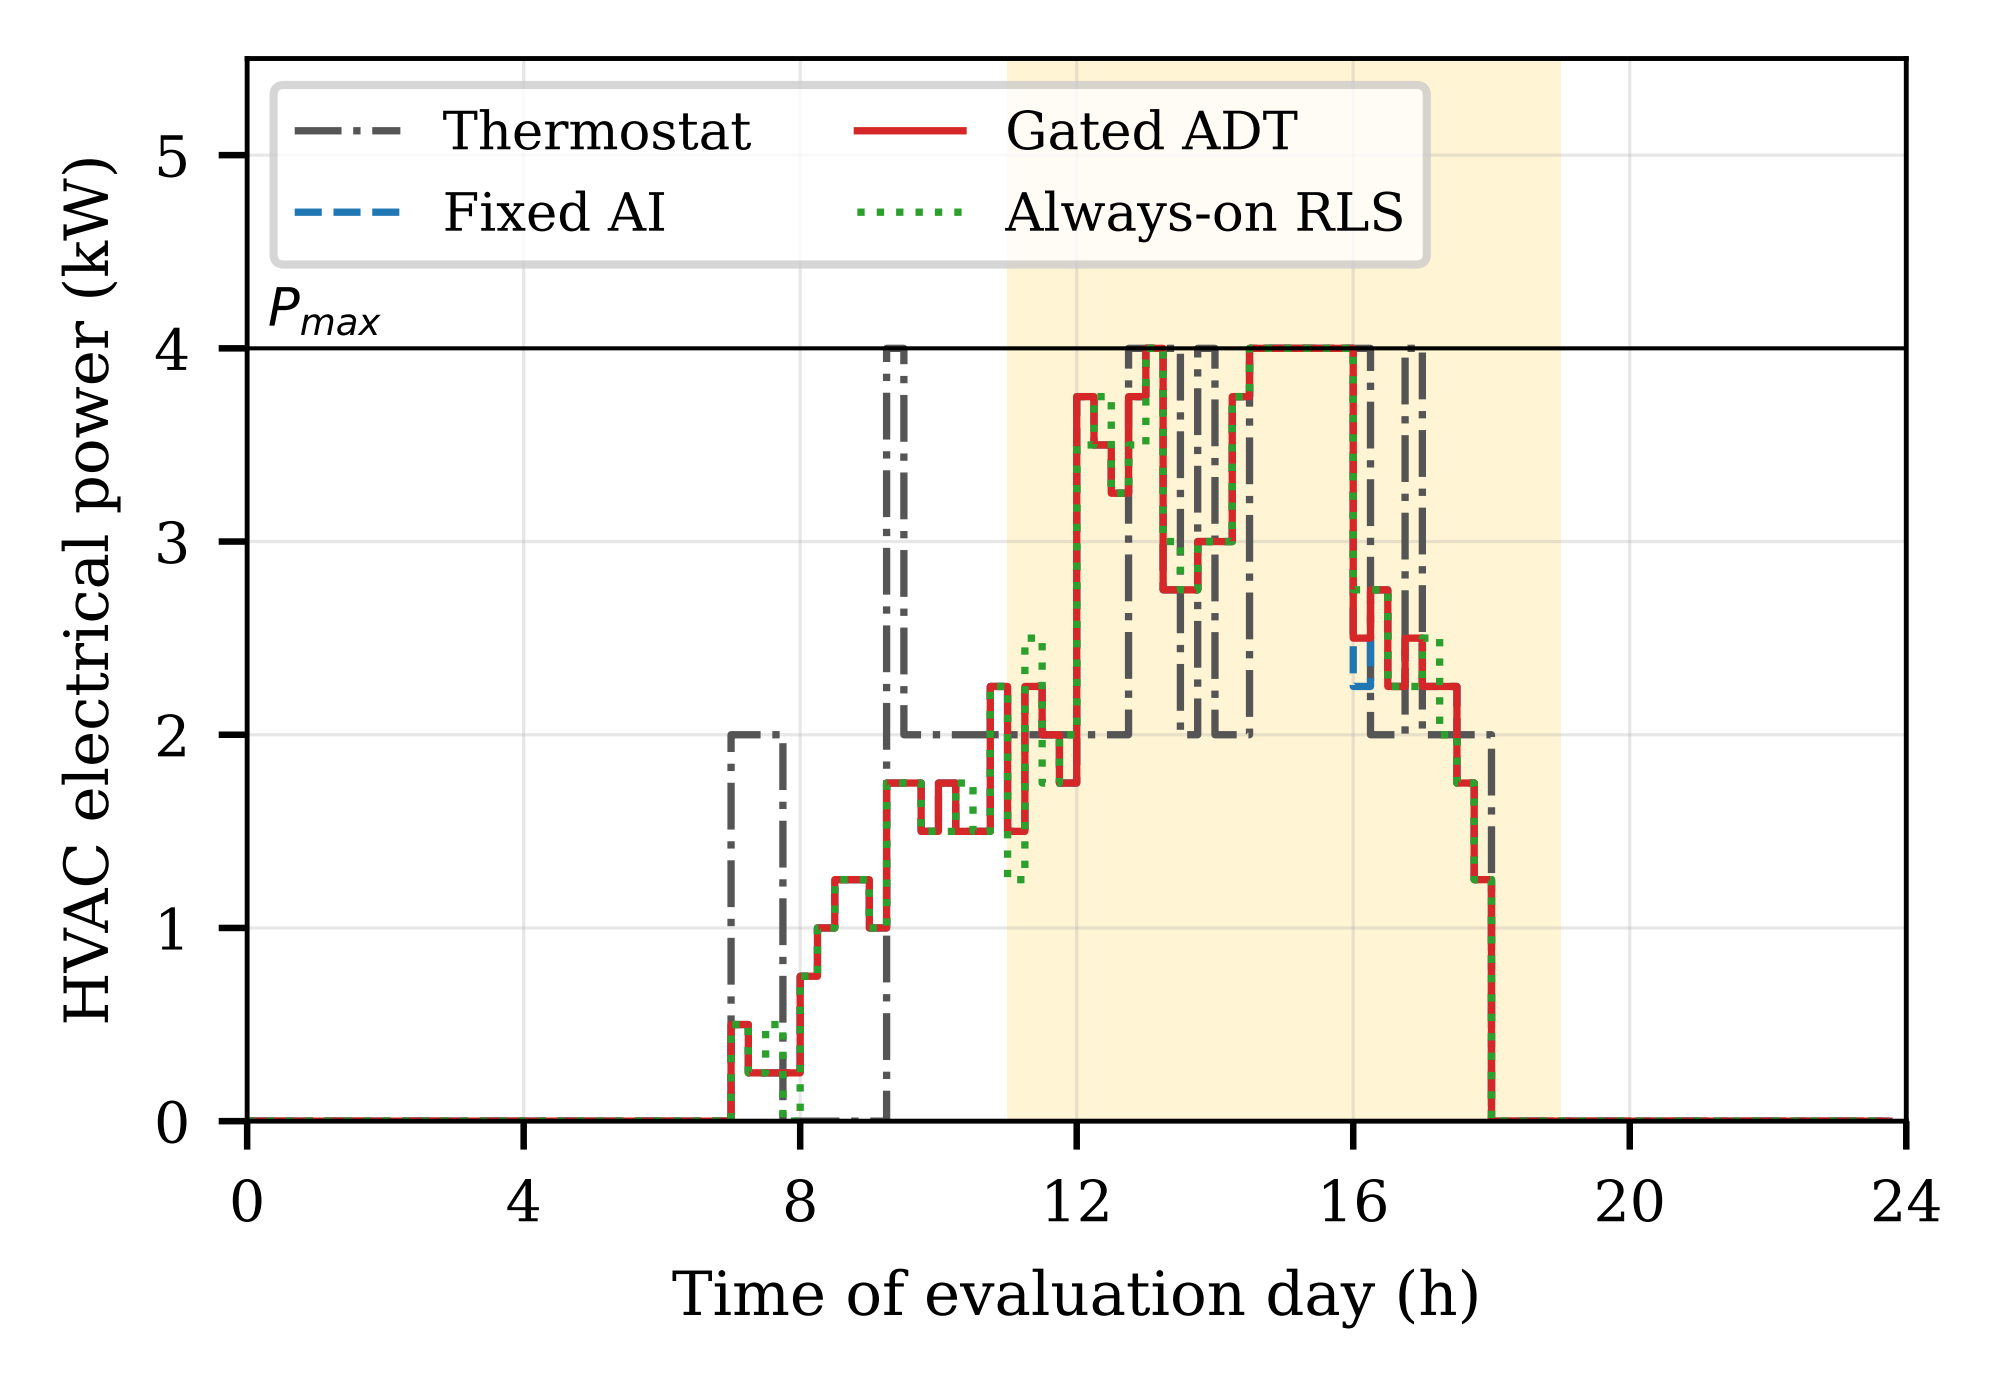
Thermostat
Fixed AI
Gated ADT
Always-on RLS
P_{max}
HVAC electrical power (kW)
0
1
2
3
4
5
0
4
8
12
16
20
24
Time of evaluation day (h)