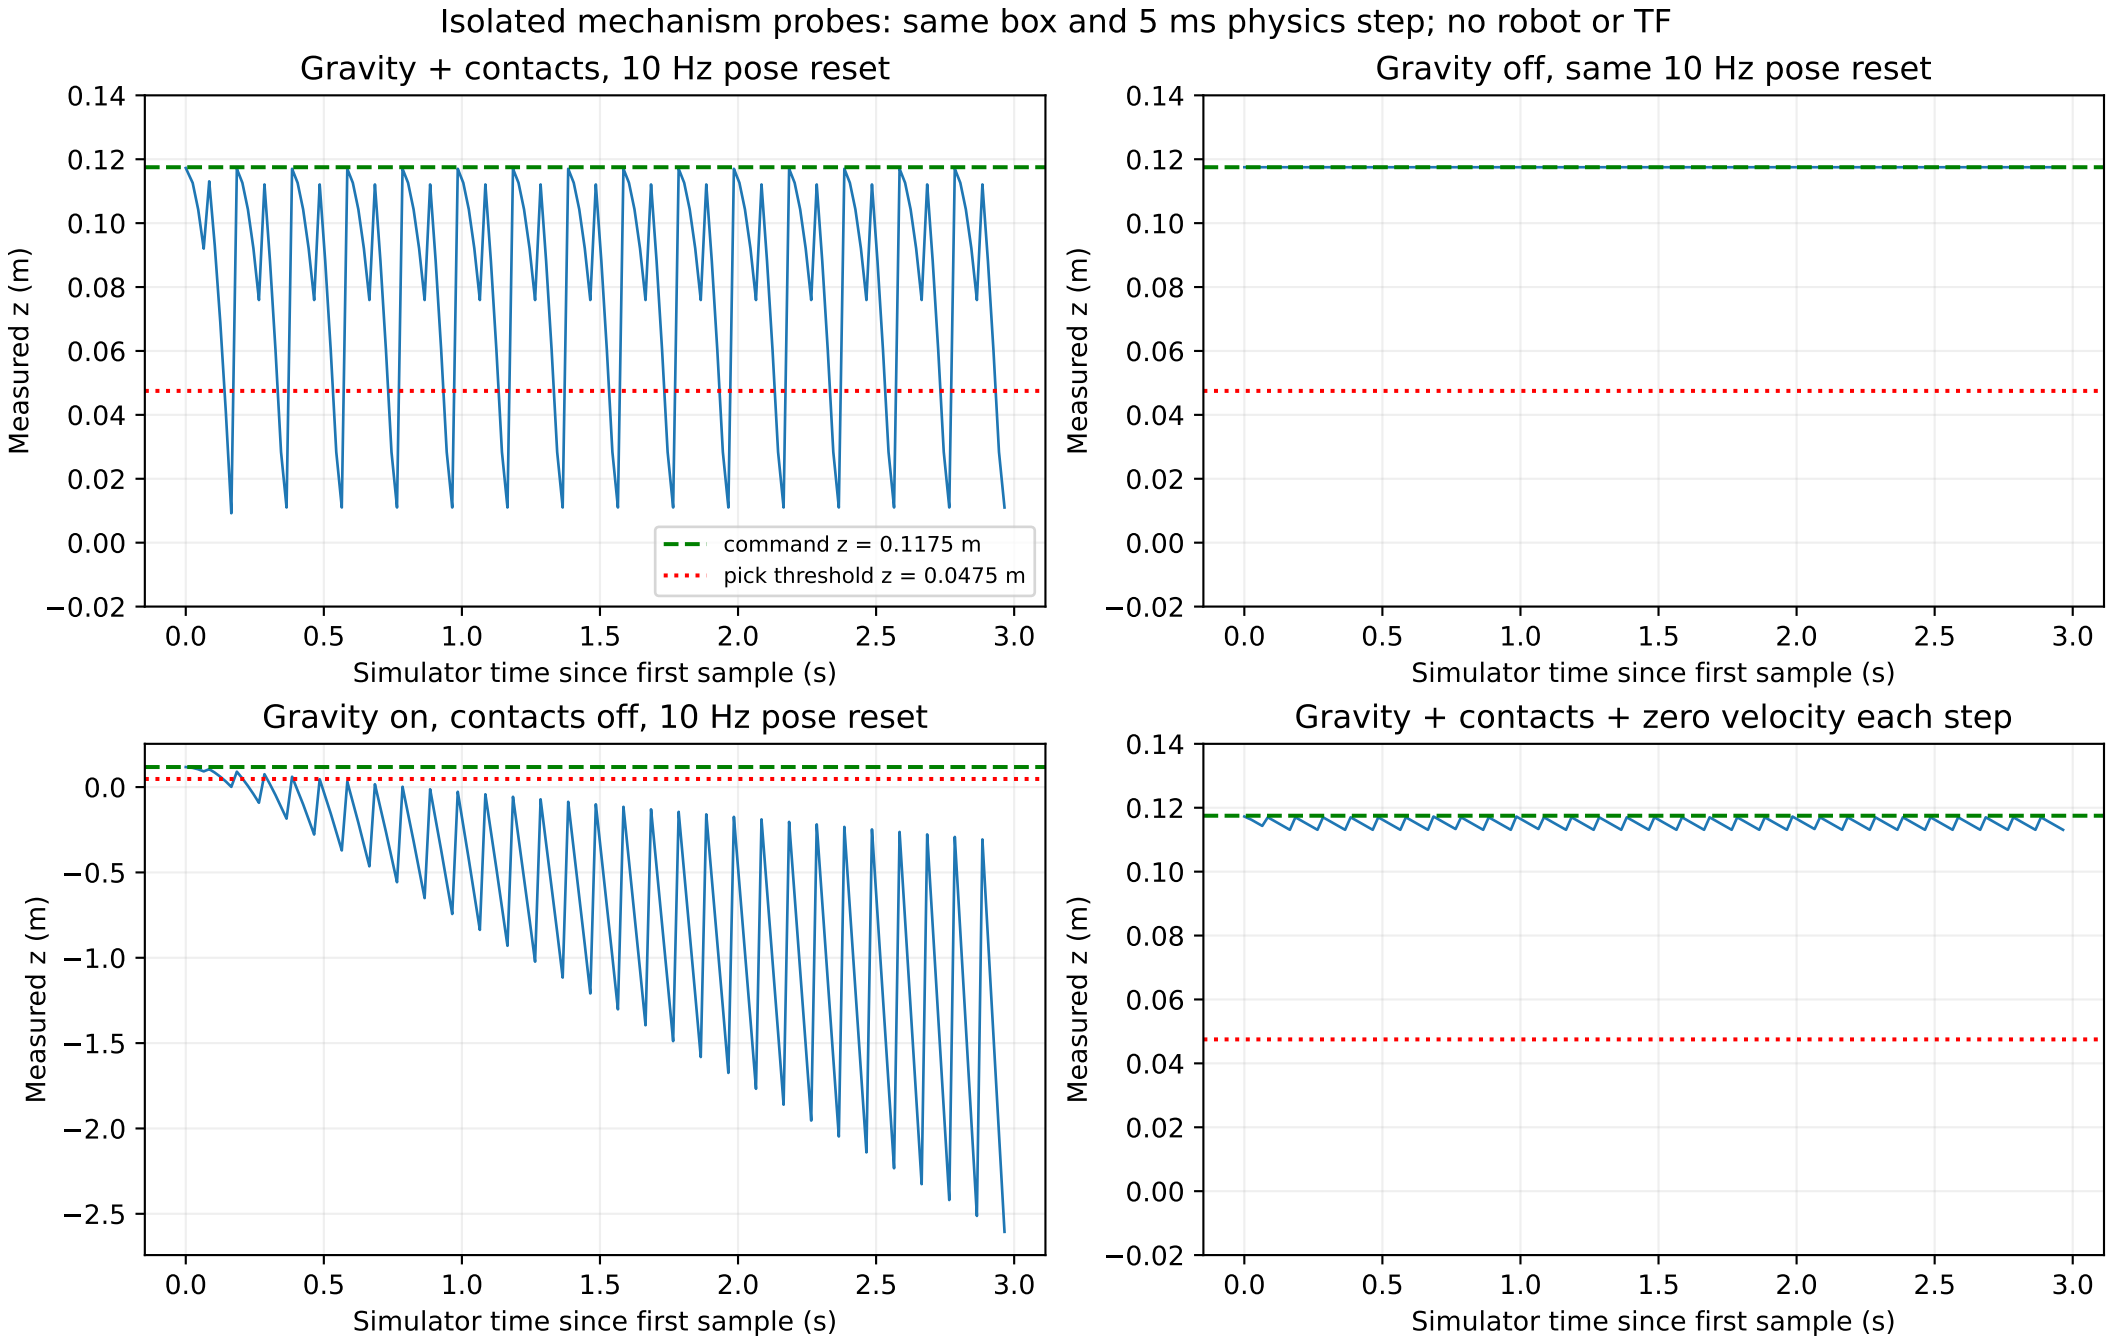
Isolated mechanism probes: same box and 5 ms physics step; no robot or TF
Gravity + contacts, 10 Hz pose reset
Gravity off, same 10 Hz pose reset
Gravity on, contacts off, 10 Hz pose reset
Gravity + contacts + zero velocity each step
Measured z (m)
Simulator time since first sample (s)
command z = 0.1175 m
pick threshold z = 0.0475 m