
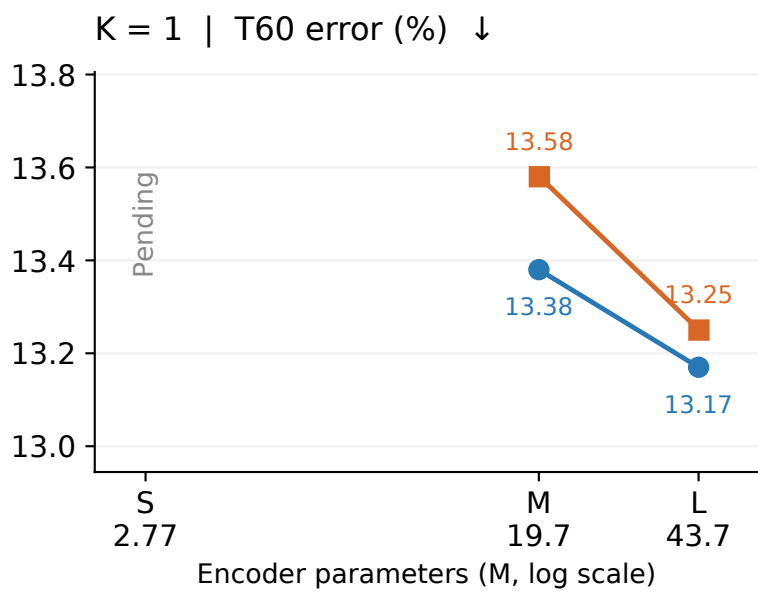
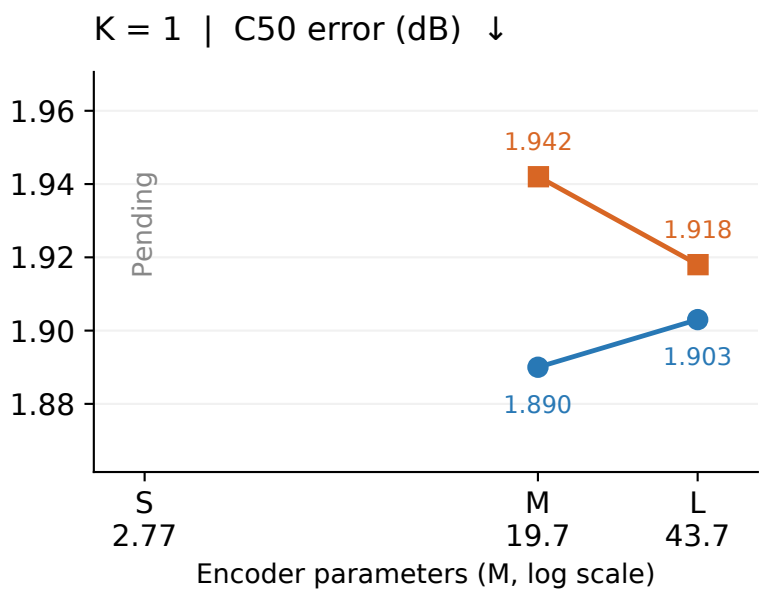
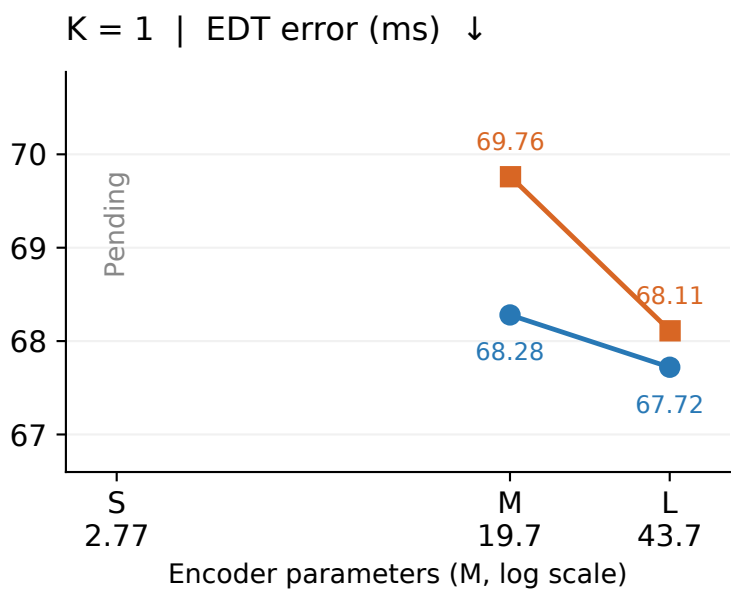
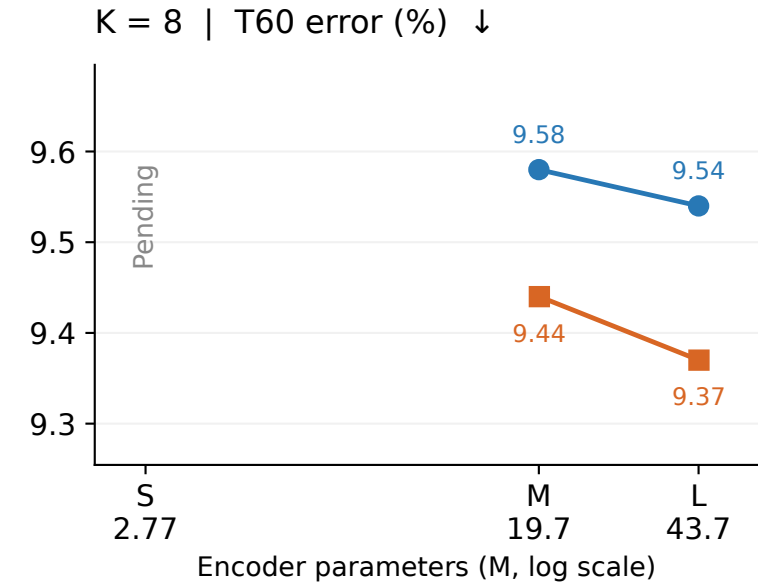
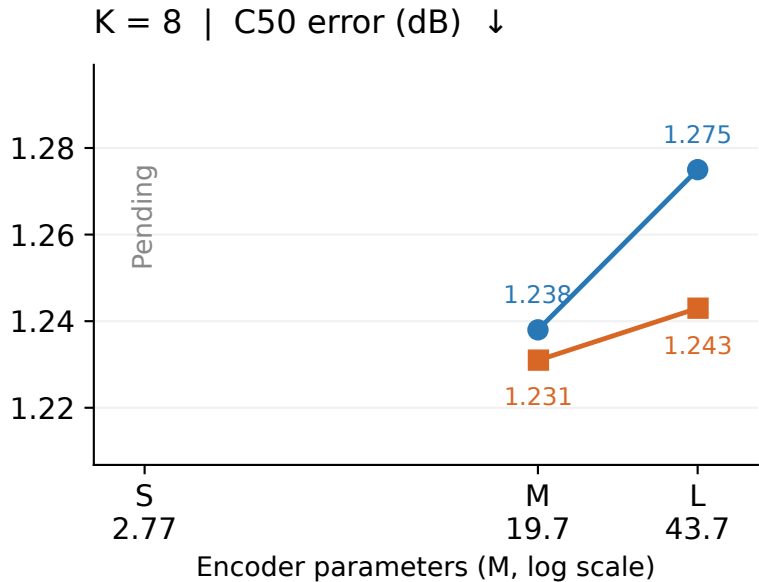


xRIR | Parameter efficiency

M/L reported means | S evaluation pending

SimpleViT CylindricalViT

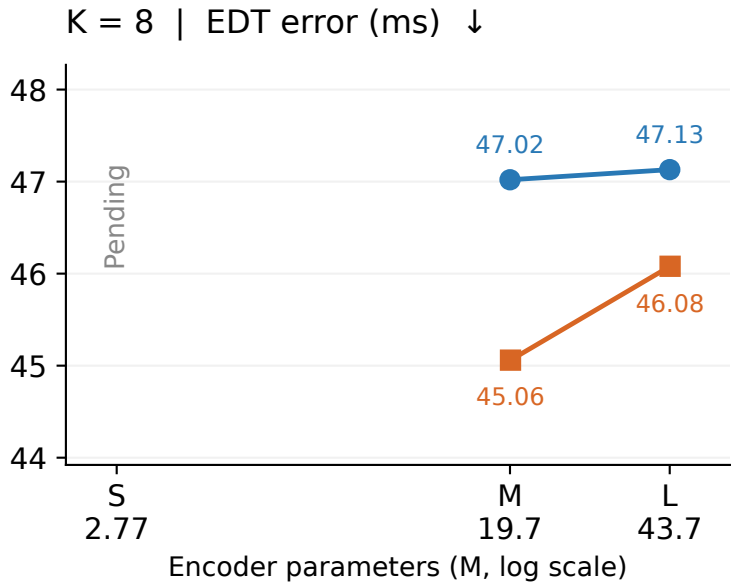

Source: user-supplied rounded five-evaluation-seed means; M reused from exp_04, L from exp_05.
One training run per arm. No CI available in this preview. Row scales differ; lower is better.