



Product overview

The Most Widely Used Application for Air Conditioning Disconnects is for Residential and Light Commerical AirConditioning Units.An Air Conditioning Disconnects are also found in use with Heat Pumps, Swimming Pools,Spas, Whirlpools and Pump Houses and Required for Servicing Electric Water Heaters.

Features & benefits

- ◇ Metallic and non-metallic options are NEMA 3R rated outdoor enclosures
- ◇ Easy-to-remove high-strength protective shield
- ◇ Easy-to-remove front cover
- ◇ Copper-rated line and load lugs
- ◇ Ample wiring space for mounting with a stud gun
- ◇ Padlock-able door provision for safety and reduction of tampering
- ◇ Factory-installed tamper resistant/weather-resistant ground fault receptacles

Product certification

c UL us	UL	UL 1429	RoHS	RoHS	RoHS Compliant

Specification


Air Conditioning Disconnects

Cat. No.	Description	Main Ampere Rating	HP Rating		Wire Size(AWG) & Torque Cu/AL	
			120V	240V	LINE/LOAD	GROUND
HDS1-30A	Enclosed Fused ACD	30AMP 240V 1 PHASE 2-Pole 3-WIRE	STD. 0.5 MAX. 2	STD. 1.5 MAX. 3	#14-10 35LB-IN #8 40LB-IN #6-4 45LB-IN #2 50LB-IN	#14-10 25LB-IN #8 40LB-IN
HDS1-60A	Enclosed Fused ACD	60AMP 240V 1 PHASE 2-Pole 3-WIRE	STD. 1.5 MAX. 3	STD. 3 MAX. 10	#14-10 35LB-IN #8 40LB-IN #6-4 45LB-IN #2 50LB-IN	#14-10 25LB-IN #8 40LB-IN
HDS1-60AN	Enclosed Non-Fused ACD	60AMP 240V 1 PHASE 2-Pole 3-WIRE	-	STD. 3 MAX. 10	#14-10 35LB-IN #8 40LB-IN #6-4 45LB-IN #2 50LB-IN	#14-10 25LB-IN #8 40LB-IN

Dimensions

inch[mm]

HDS1-30A, HDS1-60AN

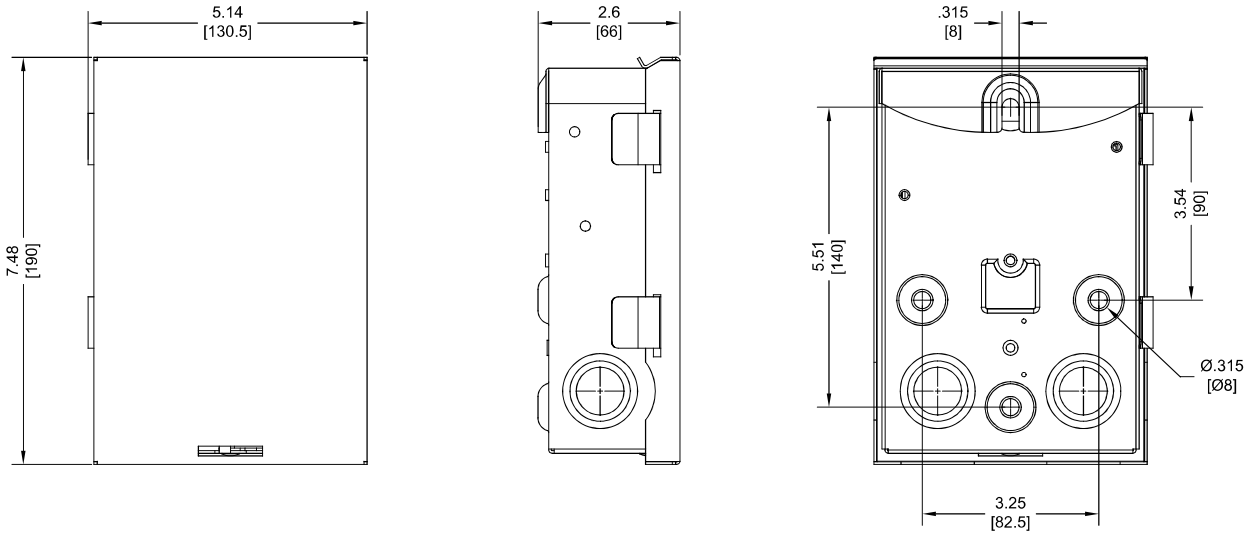

HDS1-60A

