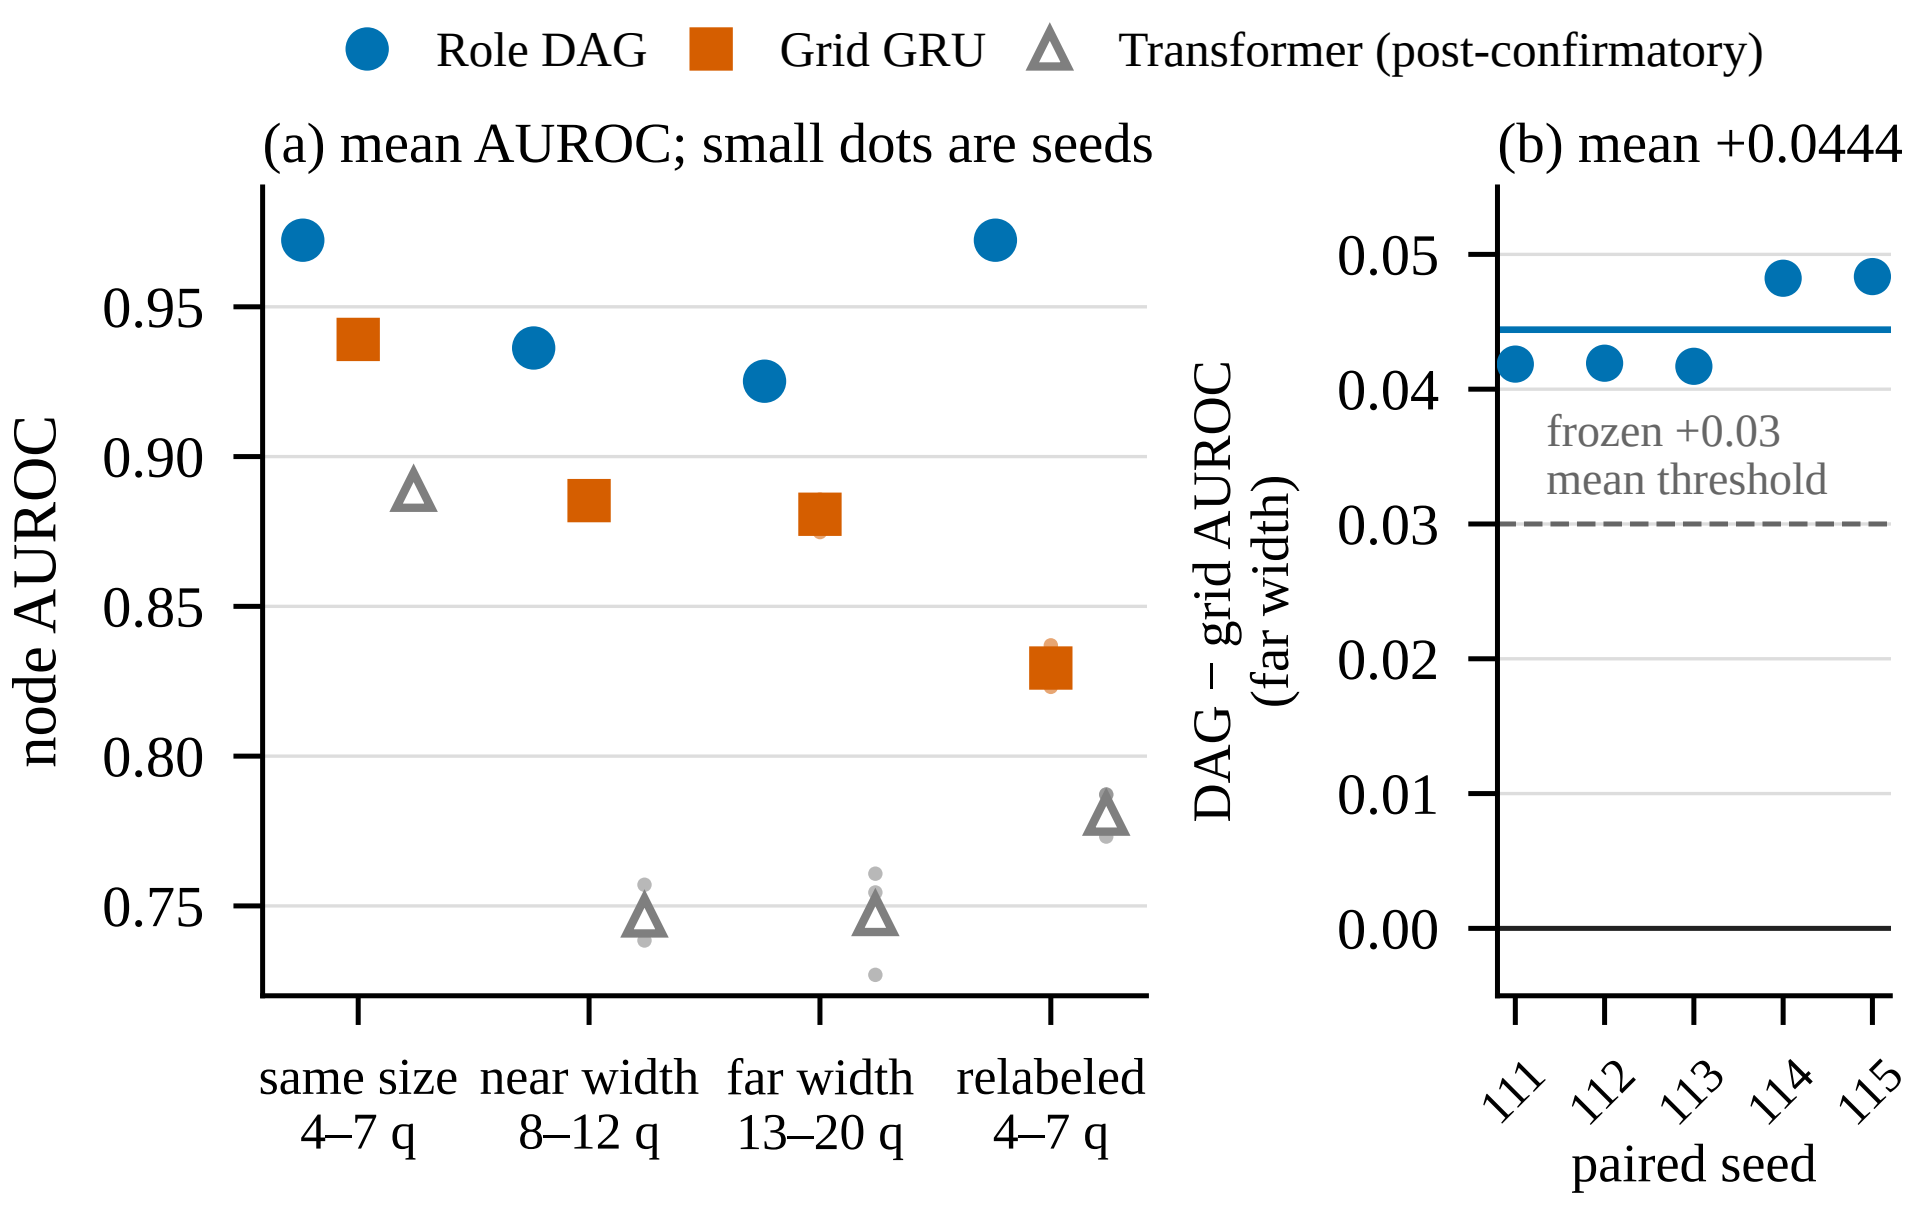
Role DAG
Grid GRU
Transformer (post-confirmatory)
(a) mean AUROC; small dots are seeds
node AUROC
0.95
0.90
0.85
0.80
0.75
same size
4–7 q
near width
8–12 q
far width
13–20 q
relabeled
4–7 q
(b) mean +0.0444
DAG – grid AUROC
(far width)
0.05
0.04
0.03
0.02
0.01
0.00
frozen +0.03
mean threshold
111
112
113
114
115
paired seed