


Exploratory VALIDATION comparison: feature-group ablation

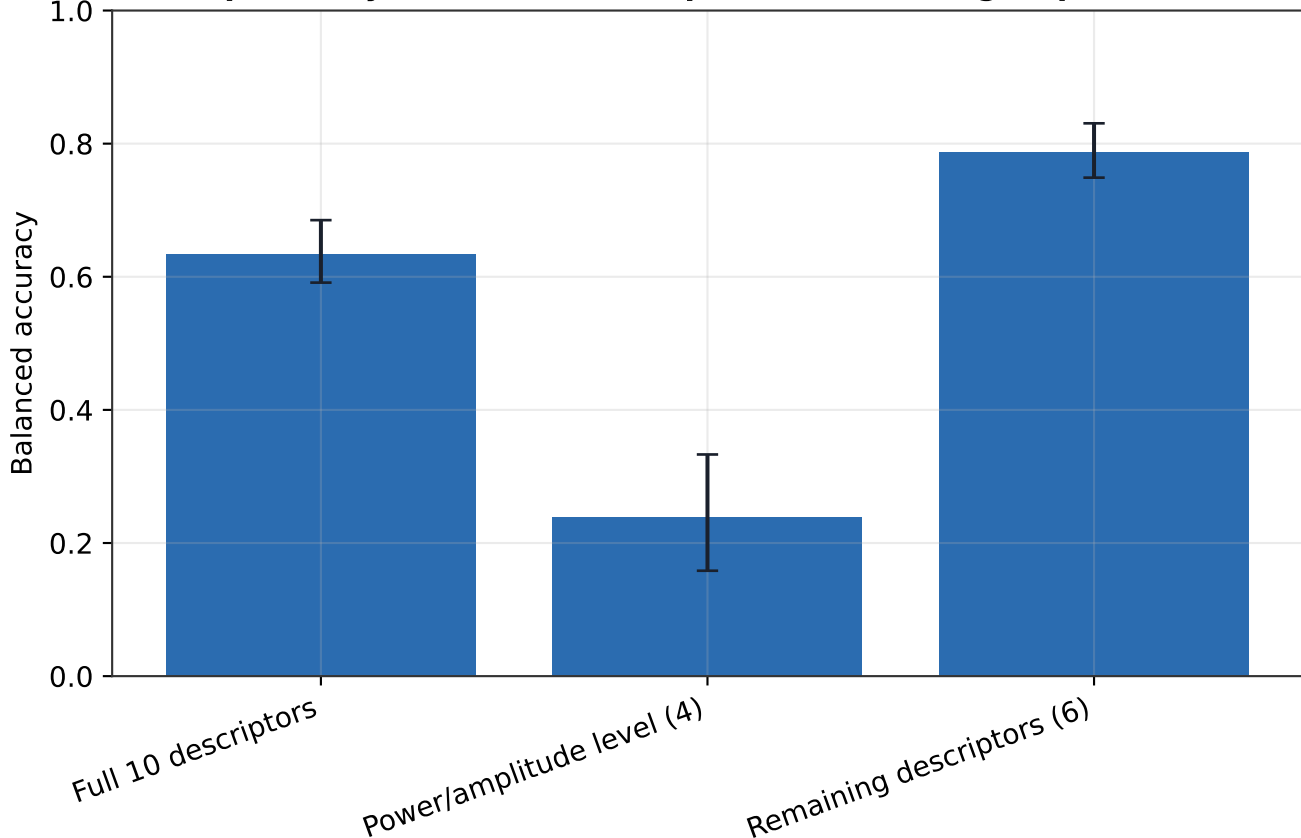

2203 matched validation examples, 12 acquisition sessions (identical across all three conditions) | Power/amplitude level and Remaining descriptors are independent TRAIN-only re-fits; Full reuses the existing PRIMARY model; TEST not opened for either new fit | delta BA (Full - Power/amplitude) = 0.396, 95% CI [0.276, 0.508] | delta BA (Full - Remaining) = -0.153, 95% CI [-0.165, -0.139]