

STAMP

REVISIONS		
No.	DATE	DESCRIPTION

CLIENT INFORMATION



PROJECT NAME
GEN KOREAN BBQ HOUSE
75-971 HENRY STREET
KAILUA-KONA, HI 96740
SHEET NAME
PLUMBING GAS FLOOR PLAN

DRAWN	DD	CHECKED	MB
DATE	09-12-25		
SCALE			
PROJECT NUMBER	24-079		
SHEET			



P203

GENERAL NOTES

- A. PRIOR TO DETAILING & INSTALLING PLUMBING PIPING COORDINATE EXACT ROUTING AND ELEVATIONS WITH MECHANICAL, ELECTRICAL, AND FIRE SPRINKLER CONTRACTORS. PROVIDE WRITTEN CONFIRMATION THAT THIS COORDINATION HAS BEEN IMPLEMENTED PRIOR TO PROCEEDING WITH INSTALLATION OF PIPING.
- B. PRIOR TO INSTALLATION OF SEWER AND WATER PIPING BELOW GRADE COORDINATE EXACT LOCATIONS AND DEPTHS OF BURIAL WITH CIVIL AND FOUNDATION DRAWINGS AND CORRESPONDING ENGINEERS.
- C. ALL PLUMBING FIXTURES SHALL BE WATER CONSERVATION TYPE AS MANDATED BY LOCAL BUILDING DEPARTMENT.
- D. ALL PLUMBING FIXTURES SHALL HAVE AN ANGLED SHUT OFF VALVE.
- E. ALL PLUMBING FIXTURES SHALL HAVE A TRAP INSTALLED AND SHALL BE PROPERLY VENTED IN ORDER TO MAINTAIN THE TRAP SEAL.
- F. ALL PLUMBING FLOOR SINKS, FLOOR DRAINS, MOP SINKS, AND HUB DRAINS SHALL HAVE A TRAP PRIMER INSTALLED AND SHALL BE PROPERLY VENTED IN ORDER TO MAINTAIN THE TRAP SEAL.
- G. CONTROLS FOR SERVICE WATER HEATING SYSTEMS SHALL LIMIT THE OUTLET TEMPERATURE AT PUBLIC LAVATORIES TO 100°F (CEC 110.3(c)3). THE WATER HEATER THERMOSTAT MAY NOT BE USED FOR COMPLIANCE WITH THIS CODE SECTION (CPC 421.2).
- H. FAUCET CONTROLS AND OPERATING MECHANISMS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE CONTROLS SHALL NOT BE GREATER THAN 5 LB-FT.
- I. HOT WATER AND DRAIN PIPES EXPOSED UNDER SINKS SHALL BE INSULATED OR OTHERWISE CONFIGURED SO AS TO PROTECT AGAINST CONTACT. THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER SINKS.
- J. ALL WATER CLOSETS DESIGNATED AS HANDICAP SHALL BE INSTALLED SUCH THAT THE ACTUATOR IS OPERABLE FROM THE WIDE SIDE OF THE WATER CLOSET.
- K. PRIOR TO BID, CONTRACTOR SHALL SCOPE CAMERA ALL SEWER LINES.
- L. ALL CONDENSATE LINES SHALL MAINTAIN A 1% SLOPE.

KEYNOTES

- 1 GAS LINE DOWN BELOW GRADE TO TABLE GRILLS.
- 2 ZONAL SHUT-OFF PANEL TO BE INTERLOCKED WITH KITCHEN EXHAUST CONTROL PANEL BY FIRE/ALARM-ANSUL CONTRACTOR. PROVIDE MIN. 30"30" WALL BOX AT 36" A.F.F. FOR COOK LINE GAS MANUAL AND AUTOMATIC SHUT-OFF VALVES. MAINTAIN 30" CLEARANCE IN FRONT OF GAS SHUT-OFF VALVE AND WALL BOX ACCESS AT ALL TIMES.
- 3 UL LISTED LINE SIZED LPG ON/OFF SOLENOID VALVE TO AUTOMATICALLY SHUT-OFF GAS COOKING EQUIPMENT UPON DETECTION OF ACTIVATION OF KITCHEN HOOD ANSUL SYSTEM. CONTROL WIRED BY CERTIFIED CONTRACTOR INSTALLING ANSUL SYSTEM. TYPICAL.
- 4 PROVIDE 1/2" GAS CONNECTION WITH LISTED SHUT-OFF VALVE AND QUICK-DISCONNECT FLEXIBLE CONNECTION TO EQUIPMENT.

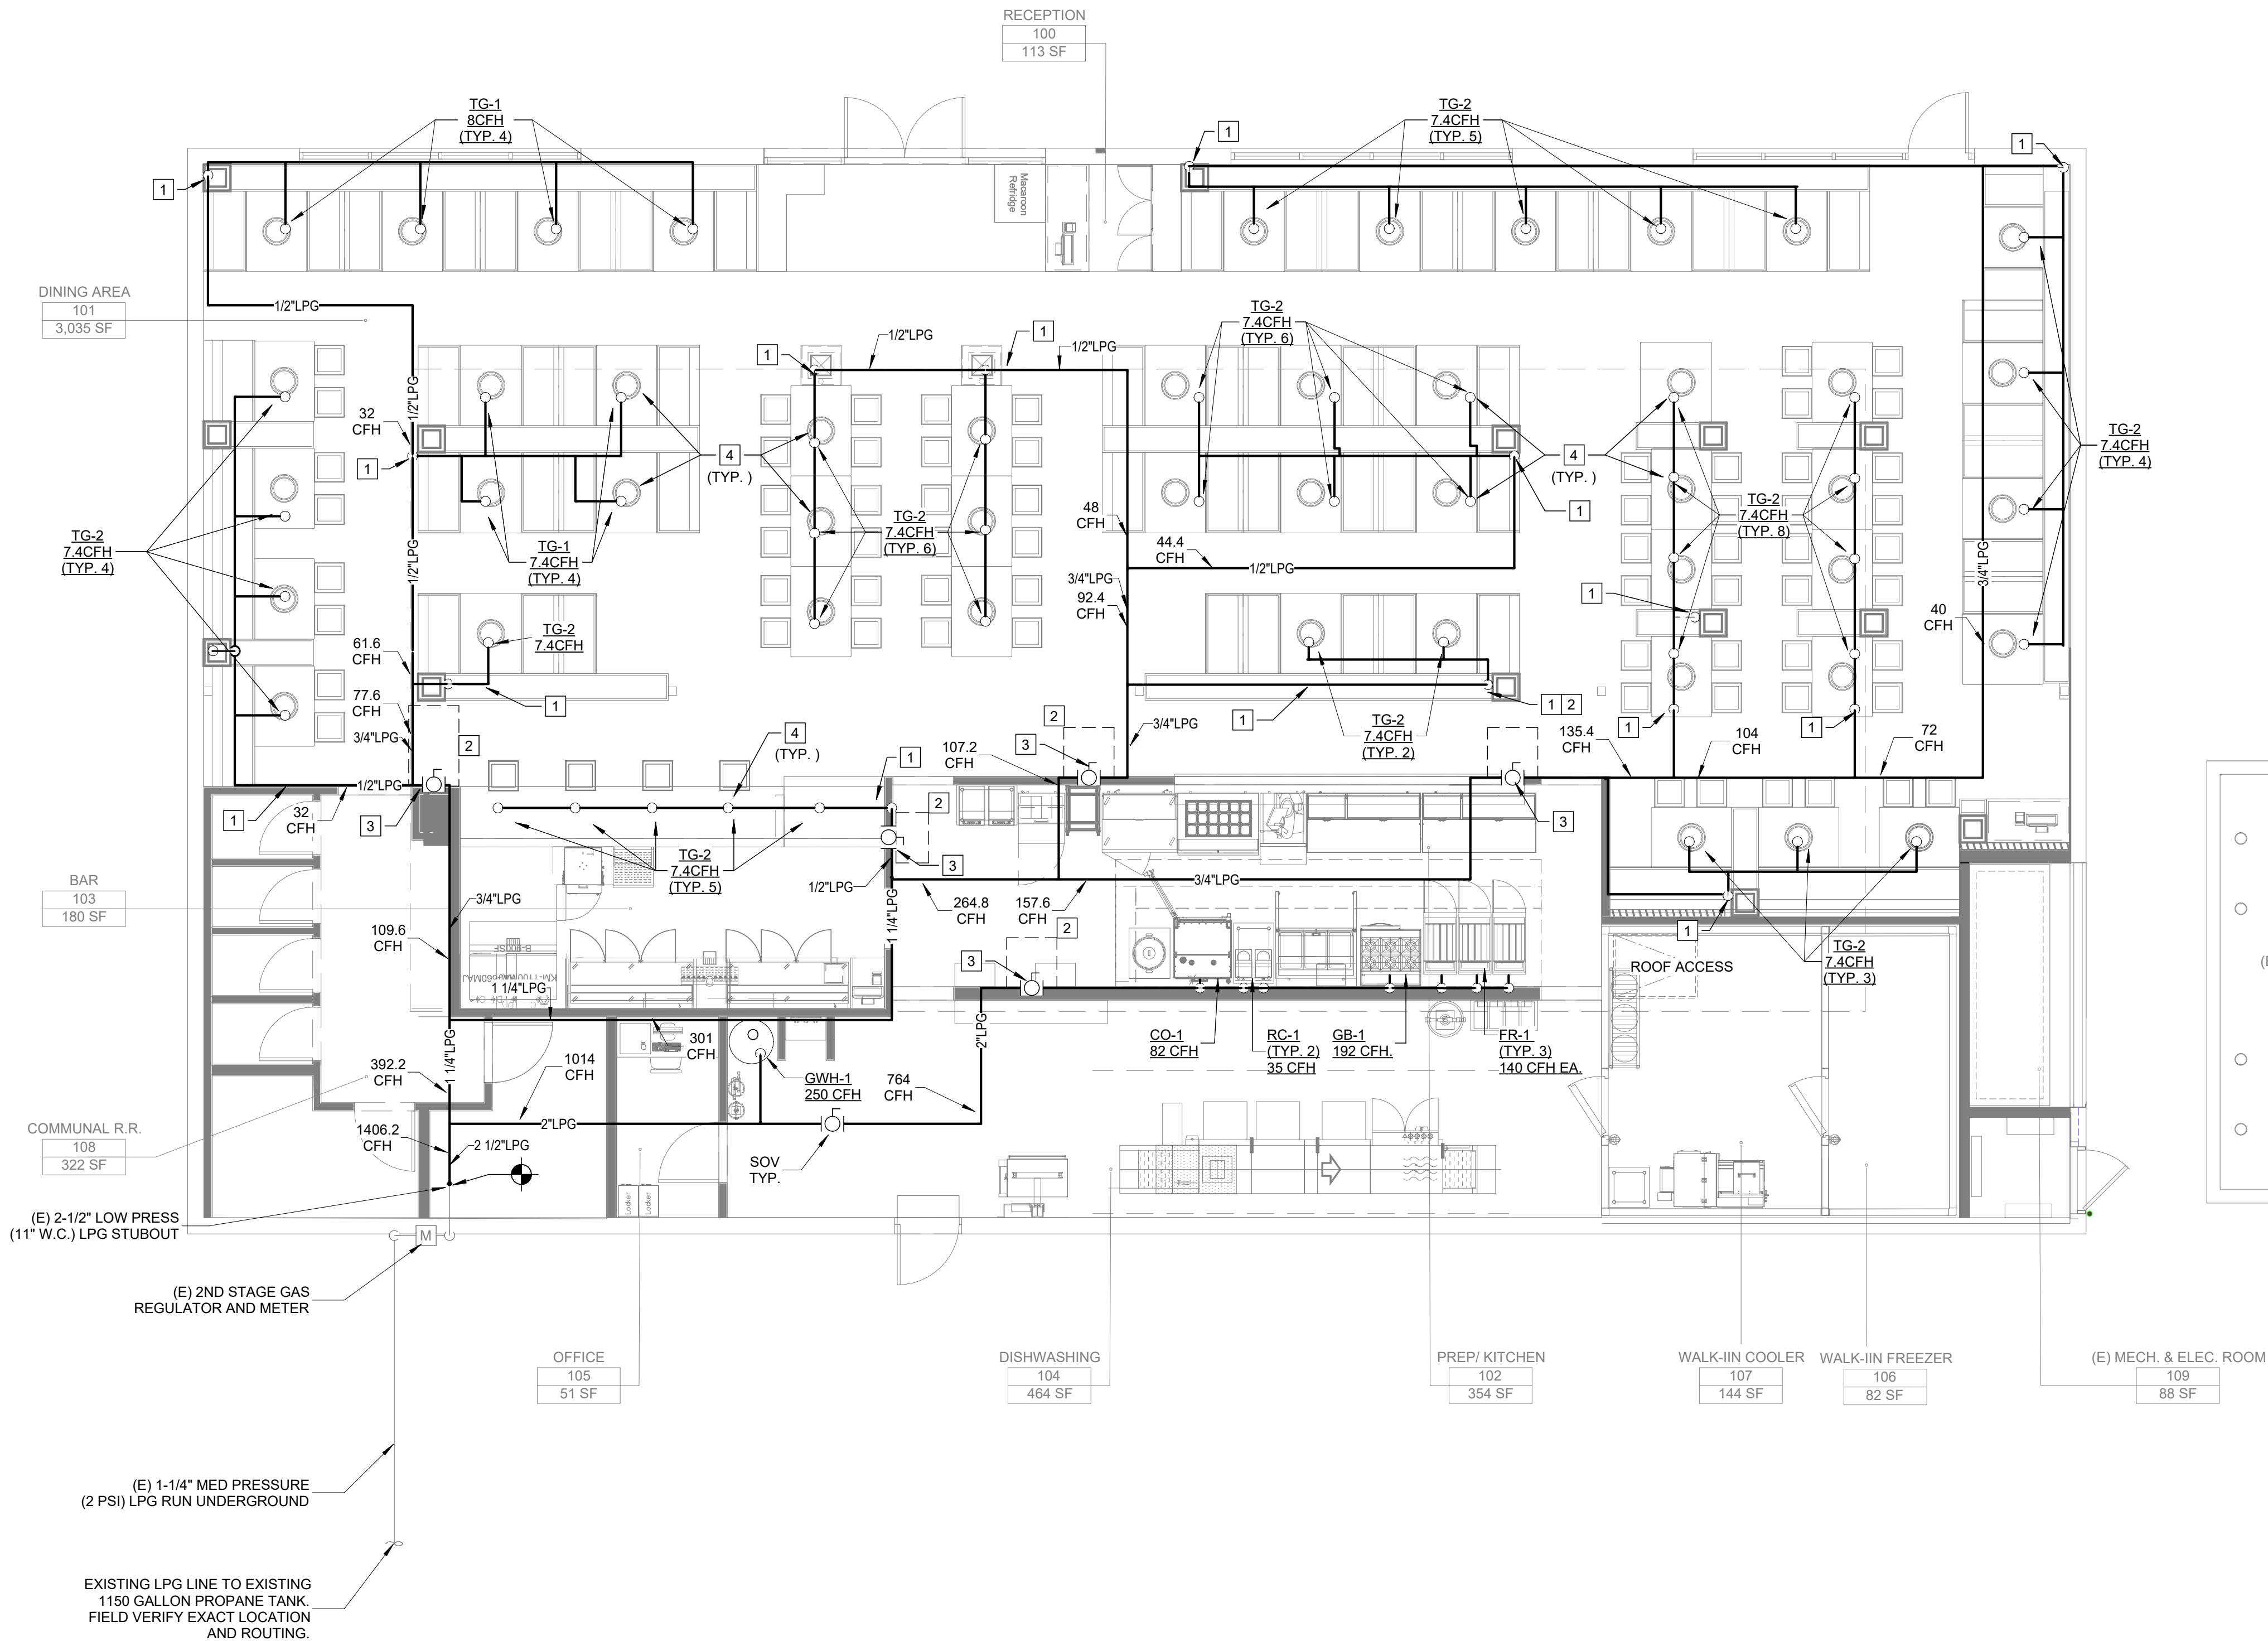

REVIEWED
BLDG DIV. - MECHANICAL
ntanaka 10/16/2025
REVIEWER DATE

ALL PLUMBING MATERIALS AND INSTALLATIONS SHALL COMPLY WITH THE LATEST AMENDED VERSION OF HAWAII COUNTY CODES CHAPTER 5, ADMINISTRATIVE CODE, AND CHAPTER 5F PLUMBING CODE