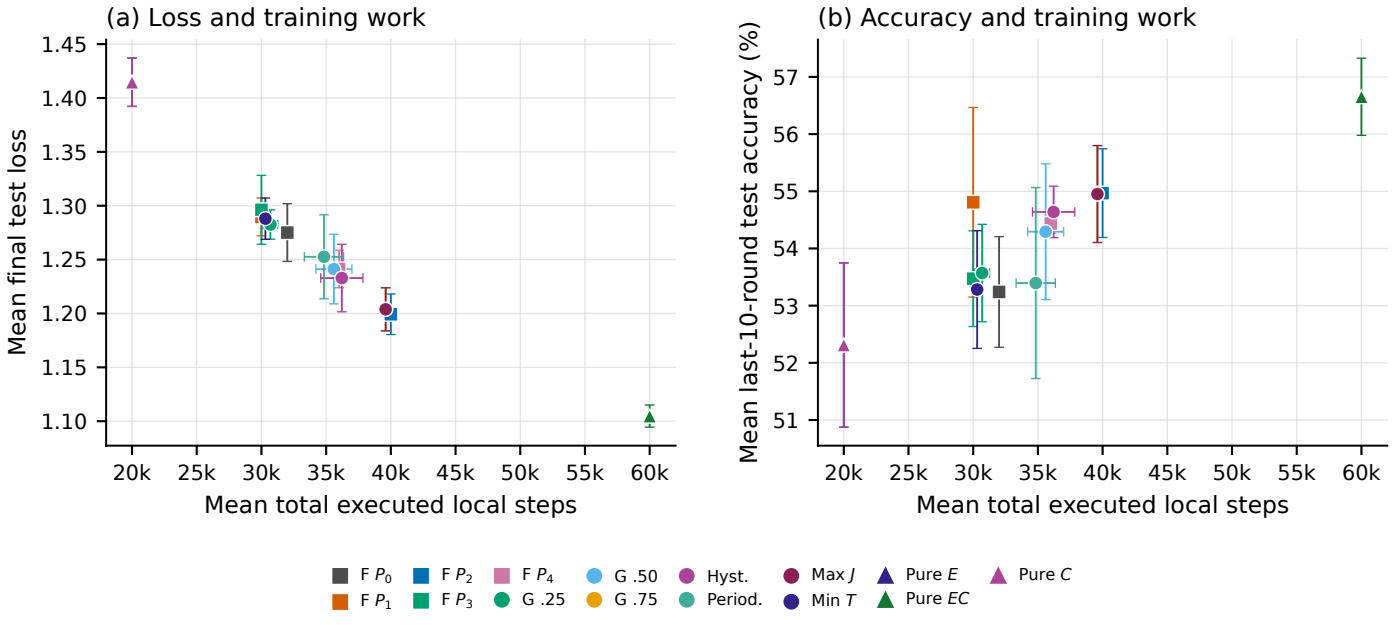
(a) Loss and training work
Mean final test loss
1.45
1.40
1.35
1.30
1.25
1.20
1.15
1.10
20k
25k
30k
35k
40k
45k
50k
55k
60k
Mean total executed local steps
(b) Accuracy and training work
Mean last-10-round test accuracy (%)
57
56
55
54
53
52
51
20k
25k
30k
35k
40k
45k
50k
55k
60k
Mean total executed local steps
F P_0
F P_1
F P_2
F P_3
F P_4
G .25
G .50
G .75
Hyst.
Period.
Max J
Min T
Pure E
Pure EC
Pure C