



Task-conditioned grid synthesis: response targets and finite AC experiments


Voltage-control test grid
37 buses | 3/3 complete tasks

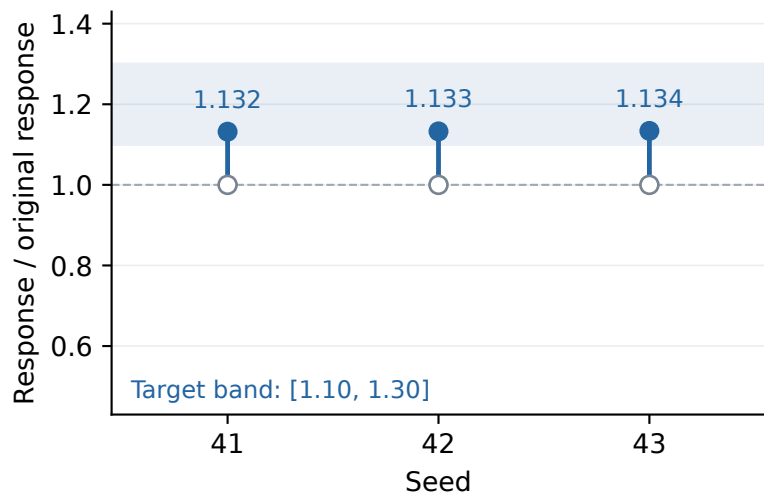


Static PV-impact test grid
25 buses | 3/3 complete tasks

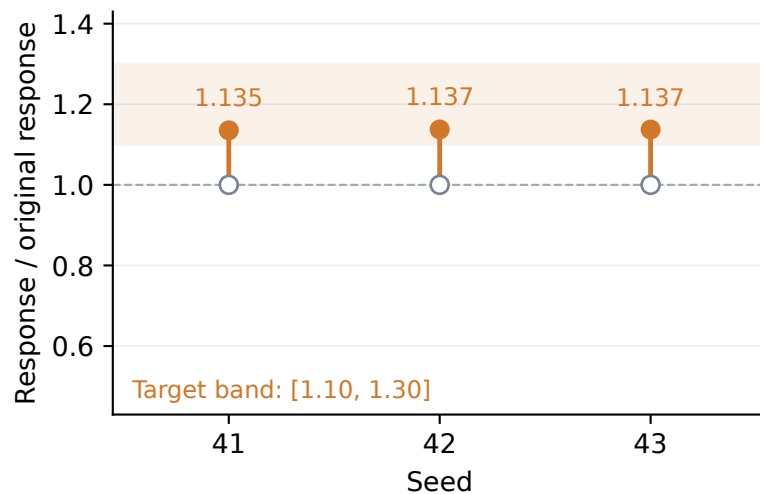


Transmission-transfer test grid
139 buses | 3/3 complete tasks

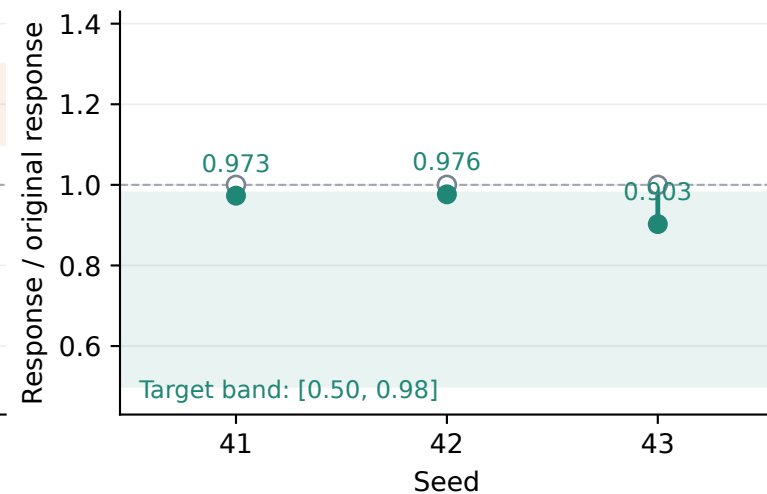


External Q support: 20 kvar

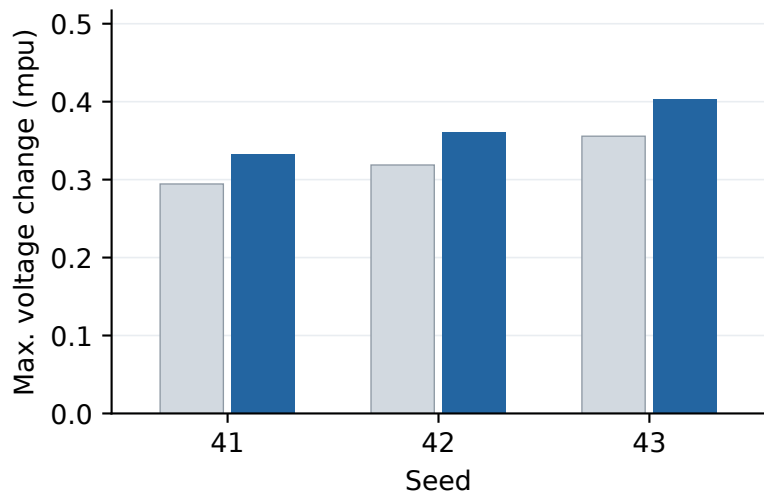

PV off / on: 216 kW

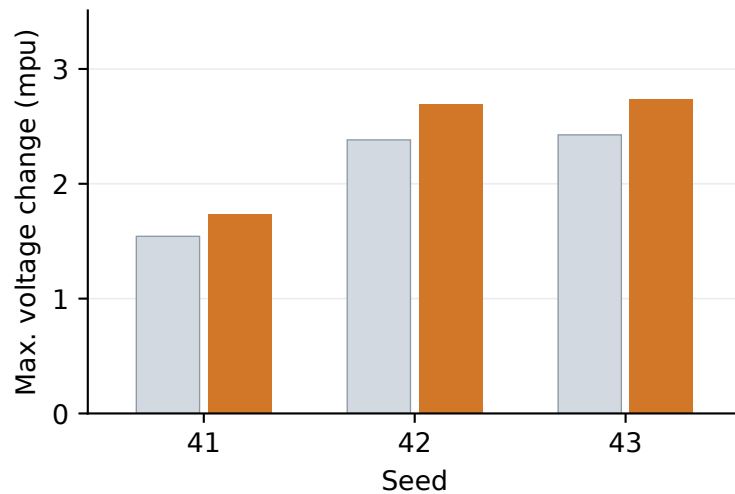

Balanced transfer: 10 MW; fixed Q

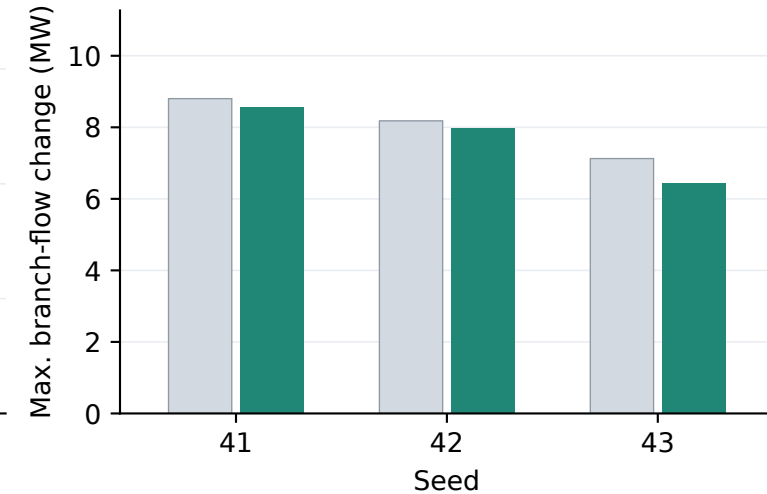

○ Original grid ● Selected grid (task color)