




COMPOUND WALL 1350
COURTYARD 6270X2885
BALCONY ABOVE 1000 WIDE
SUNSHADE 450 WIDE
INTERNAL DIM 1350X350 DEEP SPACE FOR ELEC METERS
STAIRS AS/ DETAIL
DRG.ROOM 2770X4020
ROOM 3270X2770
KITCHEN 1750X2770
DINNING /LOUNGE 2860X2770
BOUNDARY WALL 2100 HIGH
COURTYARD 4040X2770
VER. 1250 WIDE
IU-GF-01 WS-09 2.6 kW
IU-GF-02 WS-09 2.6 kW
IU-GF-03 WS-09 2.6 kW
IU-GF-04 WS-09 2.6 kW
IU-GF-05 WS-09 2.6 kW
IU-GF-06 WS-09 2.6 kW
IU-GF-07 WS-09 2.6 kW
IU-GF-08 WS-09 2.6 kW
IU-GF-11 DS-18 5.3 kW
IU-GF-12 DS-18 5.3 kW
IU-GF-10 DS-18 5.3 kW
FAF-GF-01 9 L/s
FAF-GF-02 9 L/s
FAF-GF-03 9 L/s
FAF-GF-04 9 L/s
FAF-GF-08 9 L/s
FAF-GF-07 9 L/s
SD-GF-05 150 L/s
SD-GF-07 150 L/s
SD-GF-06 150 L/s
SD-GF-01 150 L/s
SD-GF-02 150 L/s
SD-GF-03 150 L/s
SD-GF-04 150 L/s
400x250 300 L/s
RG-GF-01 600x450
RG-GF-02 600x450
RG-GF-04 600x450
FAL-GF-01A 32 L/s
FAL-GF-01 FA 32 L/s
FAL-GF-02 FA 32 L/s
FAL-GF-03 FA 32 L/s
EG-GF-01 50 L/s
EG-GF-02 25 L/s
EG-GF-03 25 L/s
EG-GF-04 25 L/s
EG-GF-05 25 L/s
EG-GF-06 50 L/s
EG-GF-07 25 L/s
EG-GF-08 25 L/s
EG-GF-09 25 L/s
EG-GF-10 25 L/s
EG-GF-11 50 L/s
EG-GF-12 25 L/s
EG-GF-13 25 L/s
EG-GF-14 25 L/s
EG-GF-15 50 L/s
EF-GF-01 EF-50
EF-GF-02 EF-25
EF-GF-03 EF-25
EF-GF-04 EF-25
EF-GF-05 EF-25
EF-GF-06 EF-50
EF-GF-07 EF-25
EF-GF-08 EF-25
EF-GF-09 EF-25
EF-GF-10 EF-25
EF-GF-11 EF-50
EF-GF-12 EF-25
EF-GF-13 EF-25
EF-GF-14 EF-25
EF-GF-15 EF-50
T-GF-01
T-GF-02
T-GF-03
T-GF-04
T-GF-05
T-GF-06
T-GF-07
T-GF-08
T-GF-09
T-GF-10
T-GF-12
RP-IU-GF-01 6.35/9.52
RP-IU-GF-02 6.35/9.52
RP-IU-GF-03 6.35/9.52
RP-IU-GF-04 6.35/9.52
RP-IU-GF-05 6.35/9.52
RP-IU-GF-06 6.35/9.52
RP-IU-GF-07 6.35/9.52
RP-IU-GF-08 6.35/9.52
CD-IU-GF-01 Ø25
CD-IU-GF-02 Ø25
CD-IU-GF-03 Ø25
CD-IU-GF-04 Ø25
CD-IU-GF-05 Ø25
CD-IU-GF-06 Ø25
CD-IU-GF-07 Ø25
CD-IU-GF-08 Ø25
RP-IU-GF-12 Ø25/12.7
RP-IU-GF-11 Ø25/12.7
RP-IU-GF-10 Ø25/12.7
RP-IU-GF-09 Ø25/12.7
Ø125 32 L/s
Ø125 25 L/s
Ø125 50 L/s
Ø125 25 L/s
Ø125 25 L/s
Ø125 25

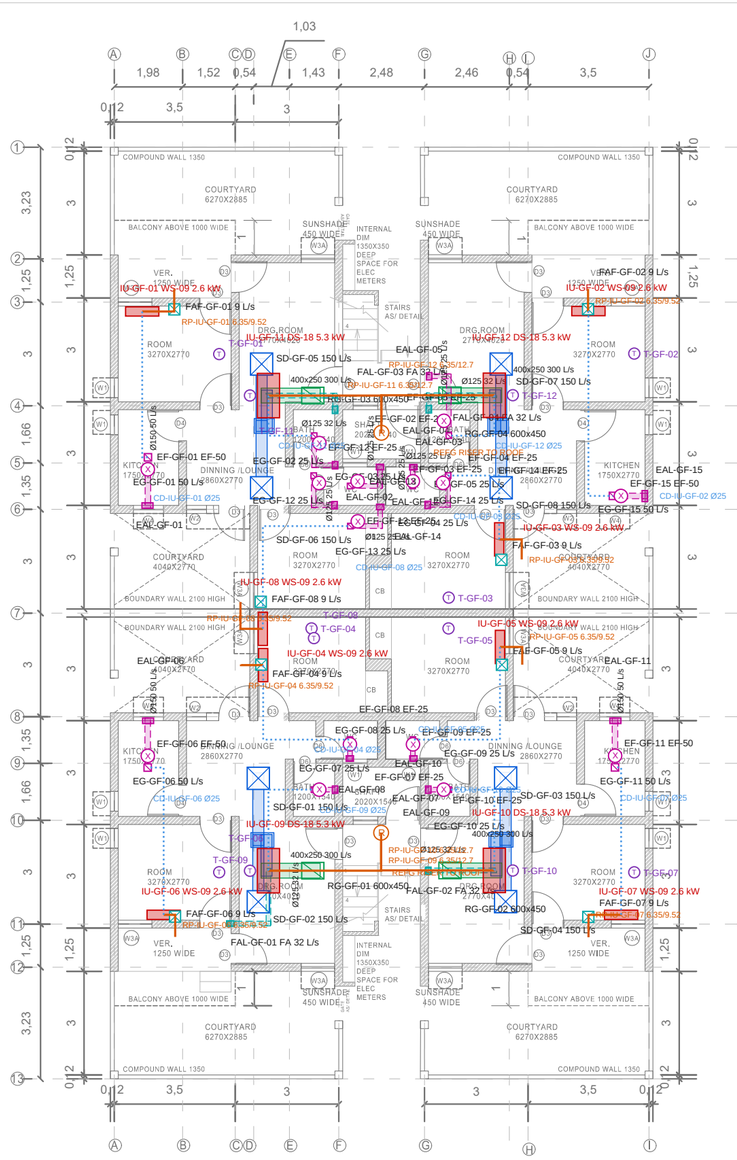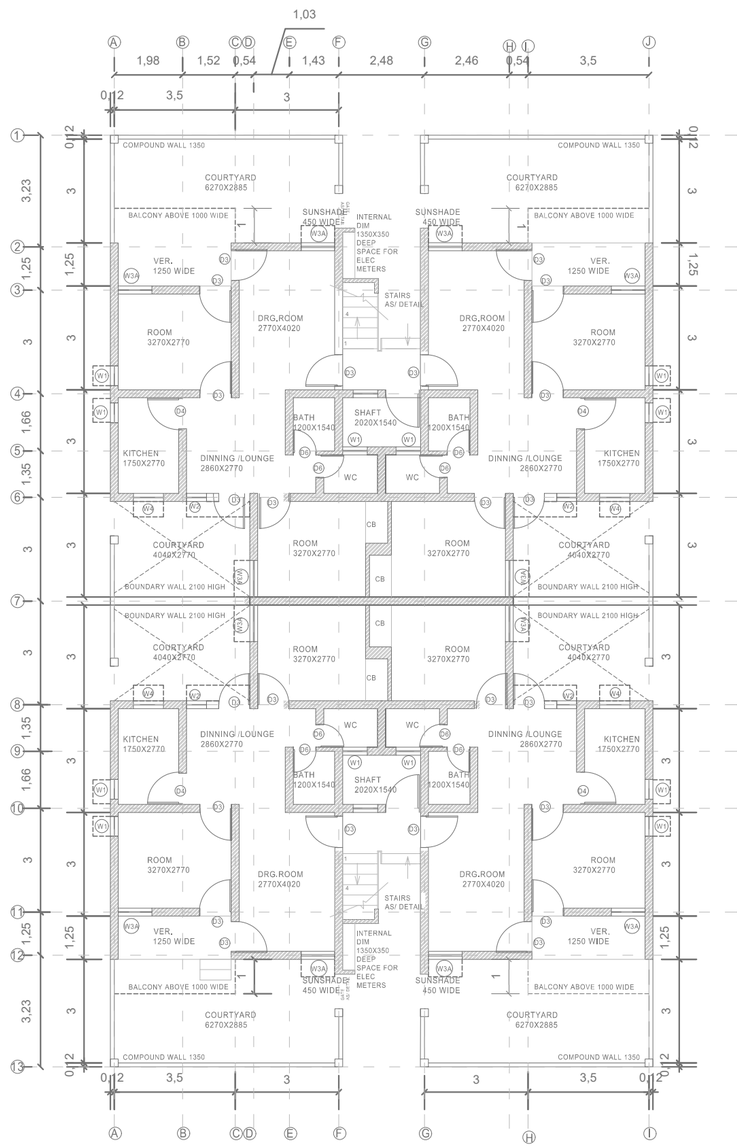

GROUND FLOOR PLAN

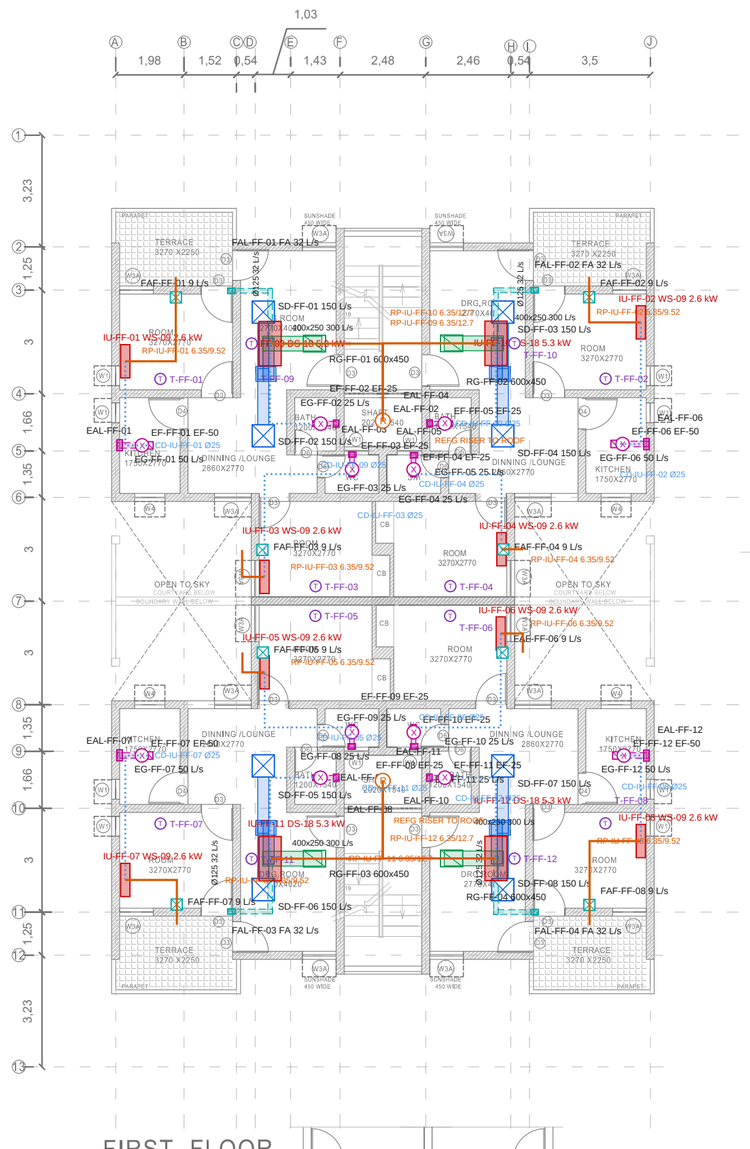

FIRST FLOOR PLAN

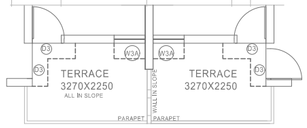

DETAIL OF JOINING BLOCK OR ROW HOUSIG FIRST FLOOR PLAN

DDA

HOUSING & URBAN PROJECTS WING

DATE :17.07.1980

NOTE :
THIS DRAWING HAS BEEN TRACED FROM THE ORIGINAL DRAWINGS DUE TO THEIR TORN UP AND NON READABLE CONDITIONS

CONTENT OF DRAWING :-

S.NO DRAWINGS

1.GROUND FLOOR PLAN &FIRST FLOOR PLAN
2.SECOND FLOOR PLAN &THIRD FLOOR PLAN
3.TERRACE
4. ELEVATIONS
5. SECTIONS
6.DETAILS OF STAIRCASE
7.DETAILS OF KITCHEN,BATH &WC
8.MISC DAW/H (DETAIL OF DOOR & WINDOW)
9.WINDOW GRILL 171 ~A/4
10.FOR JALLI DETAIL REFER DRG. NO 135 R/60
11FOR COMPOUND GATE ,REFER DRG. NO.,142 A/8

NOTE:-
1.W2 DOTTED WINDOW WITH SUNSHADEARE TO BE PROVIDED IN ALL FLOORS WHERE THE BLOCKS ARE NOT JOINING BACK TO BACK
2.DETAIS OF JOINING BBLOCK FOR ROW HOUSING IS ADDED
3. THE SPACE FOR ELECT. METERS HAS BEEN CHANGED ACCORDING TO VIDE EXTEN(LETTER NO EDVI/26(4)85/1202 DATED 15.04.85

SCHEDULE OF DOORS AND WINDOWS

S.NO.	TYPE		SHUTTER SIZE	OPENINGS
1	D3	DOOR	900X2020	950X250
2	D4	DOOR	900X2020	850X2050
3	D6	DOOR	650X2020	700X2050
4	W1	WINDOW	575X875	600X900
5	W2	WINDOW	575X1175	600X1200
6	W3A	WINDOW	975X1175	100X1200
7	W4	WINDOW	975X1175	100X1200
8	W36	WINDOW	925X1175	950X1200
9	FG1	VENTILATOR	975X425	100X450

NOTE:-
THE MODIFICATION IN THE DRG. HAS BEEN DONE AS DISCUSSED WITH SAII VIDE LETTER NO.ACE/D/III/SP/ 407 DATED 23.04.83
NO OF DUS AT GF=4 NOS
NO OF DUS AT F.F.=4 NOS
NO OF DUS AT S.F=4 NOS
NO.OF DUS AT T.F=4 NOS

AREASTATEMENT
COVD. AREA OF ONE UNIT :-
GROUND FLOOR :62.40+5.04 SHARE OF STAIRS (67.44 SQM)
FIRST FLOOR :62,40+5,04 SHARE OF STAIRS (67.44 SQM)
SECOND FLOOR 58,0+5.04 SHARE OF STAIRS (63,04 SQM)
THIRD FLOOR :58.00+5.04 SHARE OF STAIRS

REVISION :
THE WALL BETWEEN KITCHEN AND LOUNGE HAS BEEN CHANGED FROM 15TH TO 23RD AS REWIED BY ELECTRICAL ENGINEER FOR PROVIDING DISTRIBUTION BOARD

NOTES:-
THE CHANGES SUCH AS
1.THE DRAWING ROOM WINDOW WITH FAN LIGHT HAVE BEEN MADE AS DECIDED IN THE EXPERT COMMITTEE MEETING HELD ON 24.11.83
2. THE WIDTH OF WALL HAS BEEN INCREASED FROM 115 TO 230 OF THE CUPBOARD BETWEEN THE REAR BED ROOM . AS PER STRUCTURE REQUIREMENT .

NOTES:-
THIS DRAWING HAS BEEN DIGITALIZED IN THE AUTOCADD VERSION FROM DWG NO.___NIL____, SCHEME NO._182A_ DATED -17.07.1980. FOR ANY OFFICE USE ORIGINAL TRACEING HAS TO BE REFERRED.

S.NO	LAYOUT NO	DESCRIPTION	AREA (HAC)	TOTAL DUS
5	159 L/BR1	PITAMPURA (D&P)	5.36	680
2	157/L/1R3	SHALIMAR BHAGH (P)	4.50	6.80
3	182/L/2	DILSHAD GARDEN	9M	1388
4	160 L/A	PASHCHIM PURI	1.60	224
5	191-L/3	JAHANGIRPURI	4.12	656

PROJECT TITLE :
STANDARD DESIGN FOR MIG HOUSING

SHEET TITLE :
GROUND AND FIRST FLOOR PLANS

DRG. NO. 2
Sch.no. 182A

ARCH. ASSTT.	ASSTT. DIR.	DEPUTY DIRECTOR
SR. ARCHITECT	ADD. CH. ARCH.	CHIEF ARCH.

DATE : DEC.2021 | SCALE : 1:50

DIGITIZED BY		
ARCH. ASSTT.	ASSTT. ARCH.	ARCHITECT
SR. ARCHITECT	ADD. CH. ARCH.	CHIEF ARCH.

UPHW
HOUSING & URBAN PROJECT WING, OFFICE OF THE SR. ARCHITECT, EAST ZONE, VIKAS MINAR, D.D.A.

PRELIMINARY DESIGN - FOR COORDINATION ONLY. To be checked and stamped by a qualified HVAC engineer before construction.

HVAC LAYOUT - FIRST FLOOR

N

North 0° from page-up
Scale 1:139 (as architectural sheet)

LEGEND

- Supply duct (size, flow) / flex dashed
- Supply diffuser SD
- Return duct
- Return grille RG
- Fresh air duct / louver FAL
- Exhaust duct / grille EG / fan EF
- Refrigerant pipe (liquid/gas mm)
- Condensate drain
- Chilled water pipe
- Indoor / outdoor unit
- Thermostat / controller

EQUIPMENT ON THIS SHEET


IU-FF-01 WS-09 2.6 kW 140 L/s Z-FF-01
IU-FF-02 WS-09 2.6 kW 140 L/s Z-FF-02
IU-FF-03 WS-09 2.6 kW 140 L/s Z-FF-03
IU-FF-04 WS-09 2.6 kW 140 L/s Z-FF-04
IU-FF-05 WS-09 2.6 kW 140 L/s Z-FF-05
IU-FF-06 WS-09 2.6 kW 140 L/s Z-FF-06
IU-FF-07 WS-09 2.6 kW 140 L/s Z-FF-07
IU-FF-08 WS-09 2.6 kW 140 L/s Z-FF-08
IU-FF-09 DS-18 5.3 kW 300 L/s Z-FF-09
IU-FF-10 DS-18 5.3 kW 300 L/s Z-FF-10
IU-FF-11 DS-18 5.3 kW 300 L/s Z-FF-11
IU-FF-12 DS-18 5.3 kW 300 L/s Z-FF-12
ODU-13 WS-O-09 2.6 kW serves IU-FF-01
ODU-14 WS-O-09 2.6 kW serves IU-FF-02
ODU-15 WS-O-09 2.6 kW serves IU-FF-03
ODU-16 WS-O-09 2.6 kW serves IU-FF-04
ODU-17 WS-O-09 2.6 kW serves IU-FF-05
ODU-18 WS-O-09 2.6 kW serves IU-FF-06
ODU-19 WS-O-09 2.6 kW serves IU-FF-07
ODU-20 WS-O-09 2.6 kW serves IU-FF-08
EF-FF-01 EF-50 50 L/s FF-07
EF-FF-02 EF-25 25 L/s FF-08
EF-FF-03 EF-25 25 L/s FF-09
EF-FF-04 EF-25 25 L/s FF-11
EF-FF-05 EF-25 25 L/s FF-12
EF-FF-06 EF-50 50 L/s FF-13
EF-FF-07 EF-50 50 L/s FF-18
EF-FF-08 EF-25 25 L/s FF-19
EF-FF-09 EF-25 25 L/s FF-20
EF-FF-10 EF-25 25 L/s FF-22
EF-FF-11 EF-25 25 L/s FF-23
EF-FF-12 EF-50 50 L/s FF-24
EF-FF-04 EF-25 25 L/s FF-11

NOTES

- Duct sizes W x H mm (clear internal); Ø = round.
- Ducts at high level in ceiling void; coordinate with beams.
- Door undercut 20 mm / transfer grilles for return air.
- Refrigerant/condensate routes are indicative.

PROJECT: DDA MIG Housing Scheme 182A (test run under H
LOCATION: Riyadh, Saudi Arabia
SHEET: HVAC LAYOUT - First Floor
SHEET NO. M-102 REV P0 2026-10-15
SCALE: 1:139 CODES: Saudi Building Code + ASHRAE
PREPARED WITH hvac-designer skill (automated)

PRELIMINARY DESIGN - FOR COORDINATION ONLY. To be checked and stamped by a qualified HVAC engineer before construction.

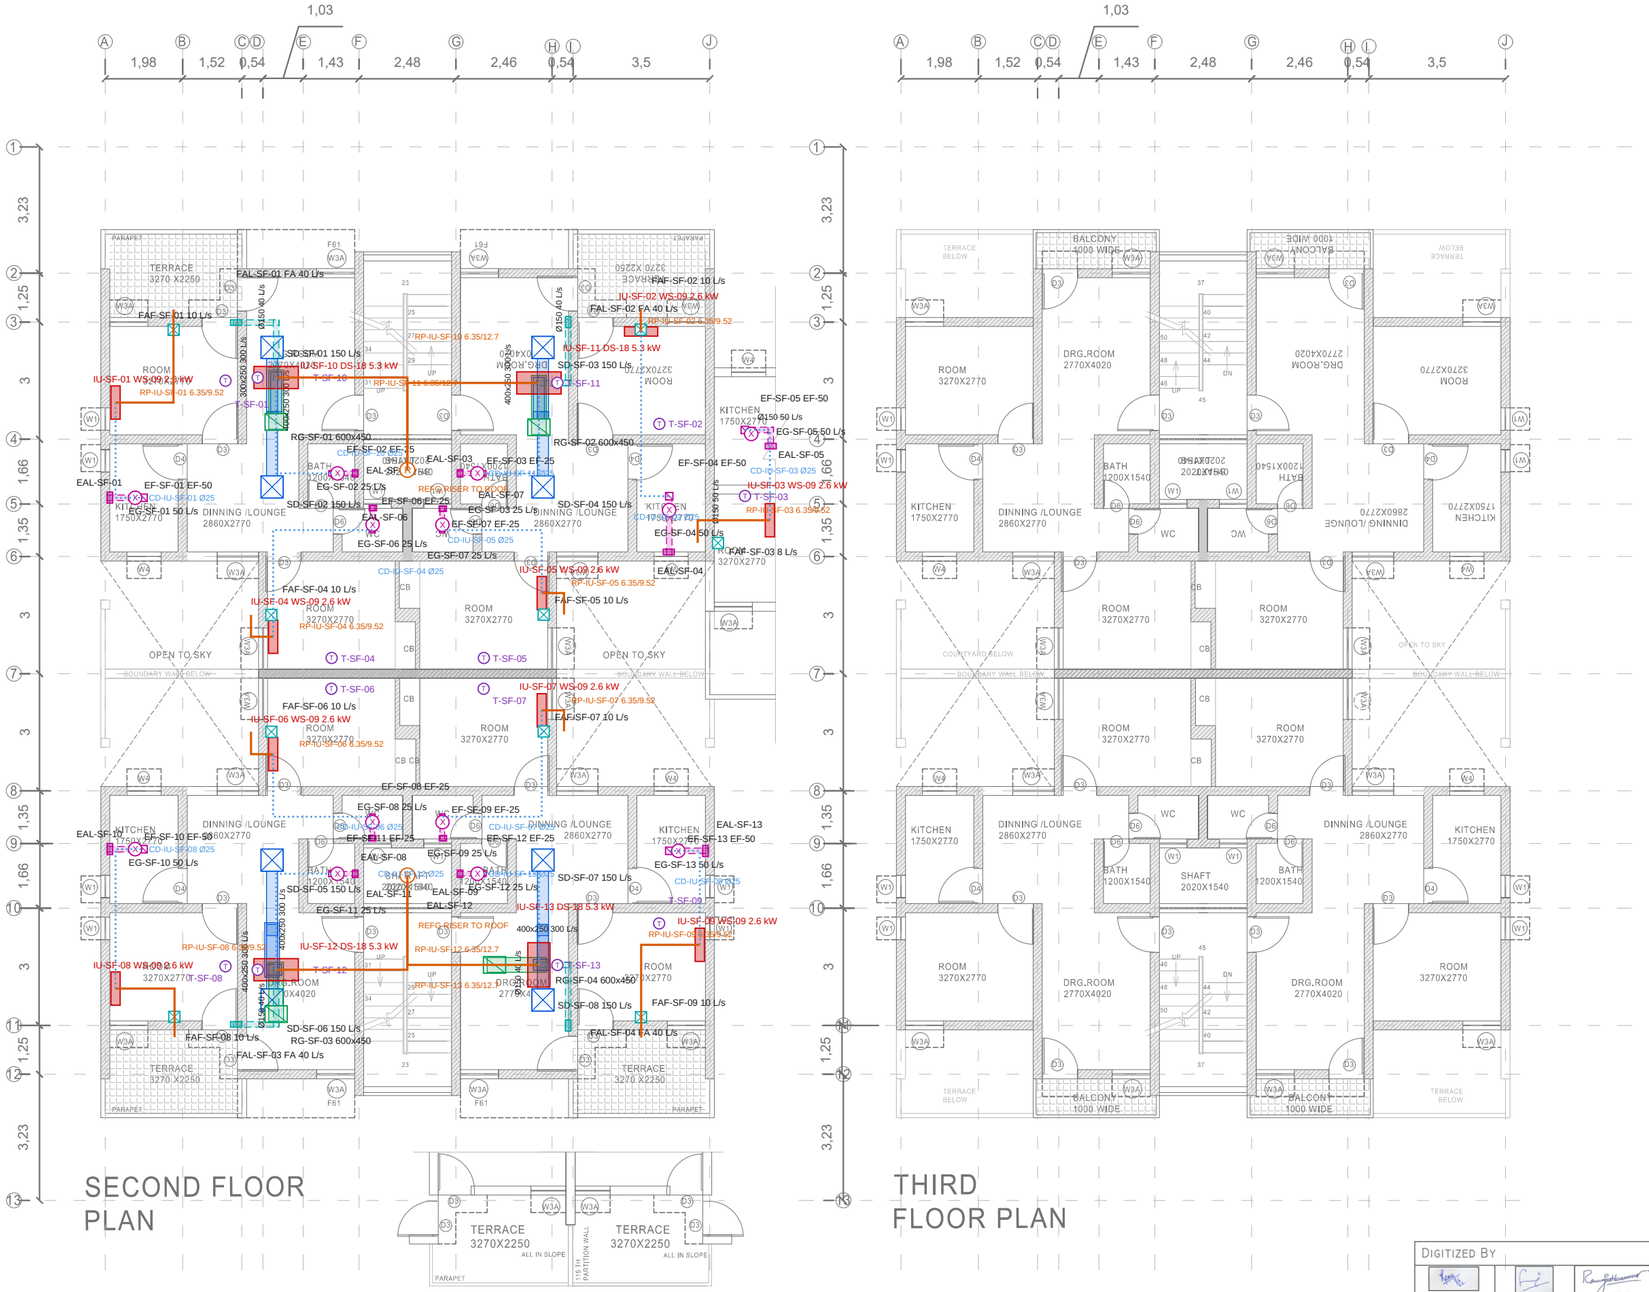

DDA

HOUSING & URBAN PROJECTS WING

DATE :21.07.1980

NOTE :
THE MODIFICATIONS IN THE DRG. HAS DONE AS DISCUSSED WITH SA VIDE LETTER NO.ACE/D/III/S.D/9/E$_{\text{IV}}$ DATED 23.09.83

NOTES:-
THIS DRAWING HAS BEEN DIGITALIZED IN THE AUTOCADD VERSION FROM DWG NO. ___NIL_____. SCHEME NO._182A_ DATED -21.07.1980

SCHEDULE OF DOORS AND WINDOWS

S.NO.	TYPE		SHUTTER SIZE	OPENINGS
1	D3	DOOR	900X2020	950X250
2	D4	DOOR	900X2020	850X2050
3	D6	DOOR	650X2020	700X2050
4	W1	WINDOW	575X875	600X900
5	W2	WINDOW	575X1175	600X1200
6	W3A	WINDOW	975X1175	100X1200
7	W4	WINDOW	975X1175	100X1200
8	W36	WINDOW	925X1175	950X1200
9	FG1	VENTILATOR	975X425	100X450

S.NO	LAYOUT NO	DESCRIPTION	AREA (HAC)	TOTAL DUS
1	159 L/8R1	PITAMPURA (D&P)	5.36	680
2	157/L/1R3	SHALIMAR BHAGH (P)	4.50	6.80
3	182 L/2	DILSHAD GARDEN	9M	1388
4	160 L/A	PASHCHIM PURI	1.60	224
5	191-L/3	JAHANGIRPURI	4.12	656

PROJECT TITLE :
STANDARD DESIGN FOR MIG HOUSING

SHEET TITLE :
SECOND AND THIRD FLOOR PLANS

DRG. NO. I
Sch.no. 182A

ARCH. ASSTT.	ASSTT. DIR.	DEPUTY DIRECTOR
SR. ARCHITECT	ADD. CH. ARCH.	CHIEF ARCH.

DATE : DEC.2021 | SCALE : 1:50

DIGITIZED BY

ARCH. ASSTT.	ASSTT. ARCH.	ARCHITECT
SR. ARCHITECT	ADD. CH. ARCH.	CHIEF ARCH.

HOUSING & URBAN PROJECT WING,
OFFICE OF THE SR. ARCHITECT,
EAST ZONE, VIKAS MINAR, D.D.A.

HVAC LAYOUT - SECOND FLOOR

N

North 0° from page-up
Scale 1:139 (as architectural sheet)

LEGEND

- Supply duct (size, flow) / flex dashed
- Supply diffuser SD
- Return duct
- Return grille RG
- Fresh air duct / louver FAL
- Exhaust duct / grille EG / fan EF
- Refrigerant pipe (liquid/gas mm)
- Condensate drain
- Chilled water pipe
- Indoor / outdoor unit
- Thermostat / controller

EQUIPMENT ON THIS SHEET

IU-SF-01 WS-09 2.6 kW 140 L/s Z-SF-01
IU-SF-02 WS-09 2.6 kW 140 L/s Z-SF-02
IU-SF-03 WS-09 2.6 kW 140 L/s Z-SF-03
IU-SF-04 WS-09 2.6 kW 140 L/s Z-SF-04
IU-SF-05 WS-09 2.6 kW 140 L/s Z-SF-05
IU-SF-06 WS-09 2.6 kW 140 L/s Z-SF-06
IU-SF-07 WS-09 2.6 kW 140 L/s Z-SF-07
IU-SF-08 WS-09 2.6 kW 140 L/s Z-SF-08
IU-SF-09 WS-09 2.6 kW 140 L/s Z-SF-09
IU-SF-10 DS-18 5.3 kW 300 L/s Z-SF-10
IU-SF-11 DS-18 5.3 kW 300 L/s Z-SF-11
IU-SF-12 DS-18 5.3 kW 300 L/s Z-SF-12
IU-SF-13 DS-18 5.3 kW 300 L/s Z-SF-13
ODU-25 WS-O-09 2.6 kW serves IU-SF-01
ODU-26 WS-O-09 2.6 kW serves IU-SF-02
ODU-27 WS-O-09 2.6 kW serves IU-SF-03
ODU-28 WS-O-09 2.6 kW serves IU-SF-04
ODU-29 WS-O-09 2.6 kW serves IU-SF-05
ODU-30 WS-O-09 2.6 kW serves IU-SF-06
ODU-31 WS-O-09 2.6 kW serves IU-SF-07
ODU-32 WS-O-09 2.6 kW serves IU-SF-08
ODU-33 WS-O-09 2.6 kW serves IU-SF-09
EF-SF-01 EF-50 50 L/s SF-05
EF-SF-02 EF-25 25 L/s SF-07
EF-SF-03 EF-25 25 L/s SF-09
EF-SF-04 EF-50 50 L/s SF-11
EF-SF-05 EF-50 50 L/s SF-12
EF-SF-06 EF-25 25 L/s SF-13
EF-SF-07 EF-25 25 L/s SF-14
EF-SF-08 EF-25 25 L/s SF-20
EF-SF-09 EF-25 25 L/s SF-21
EF-SF-10 EF-50 50 L/s SF-23
EF-SF-11 EF-25 25 L/s SF-25
EF-SF-12 EF-25 25 L/s SF-27
EF-SF-13 EF-50 50 L/s SF-29


NOTES


- Duct sizes W x H mm (clear internal); Ø = round.
- Ducts at high level in ceiling void; coordinate with beams.
- Door undercut 20 mm / transfer grilles for return air.
- Refrigerant/condensate routes are indicative.

PROJECT: DDA MIG Housing Scheme 182A (test run under H
LOCATION: Riyadh, Saudi Arabia
SHEET: HVAC LAYOUT - Second Floor
SHEET NO. M-103 REV P0 2026-10-15
SCALE: 1:139 CODES: Saudi Building Code + ASHRAE
PREPARED WITH hvac-designer skill (automated)

PRELIMINARY DESIGN - FOR COORDINATION ONLY. To be checked and stamped by a qualified HVAC engineer before construction.

PRELIMINARY DESIGN - FOR COORDINATION ONLY. To be checked and stamped by a qualified HVAC engineer before construction.

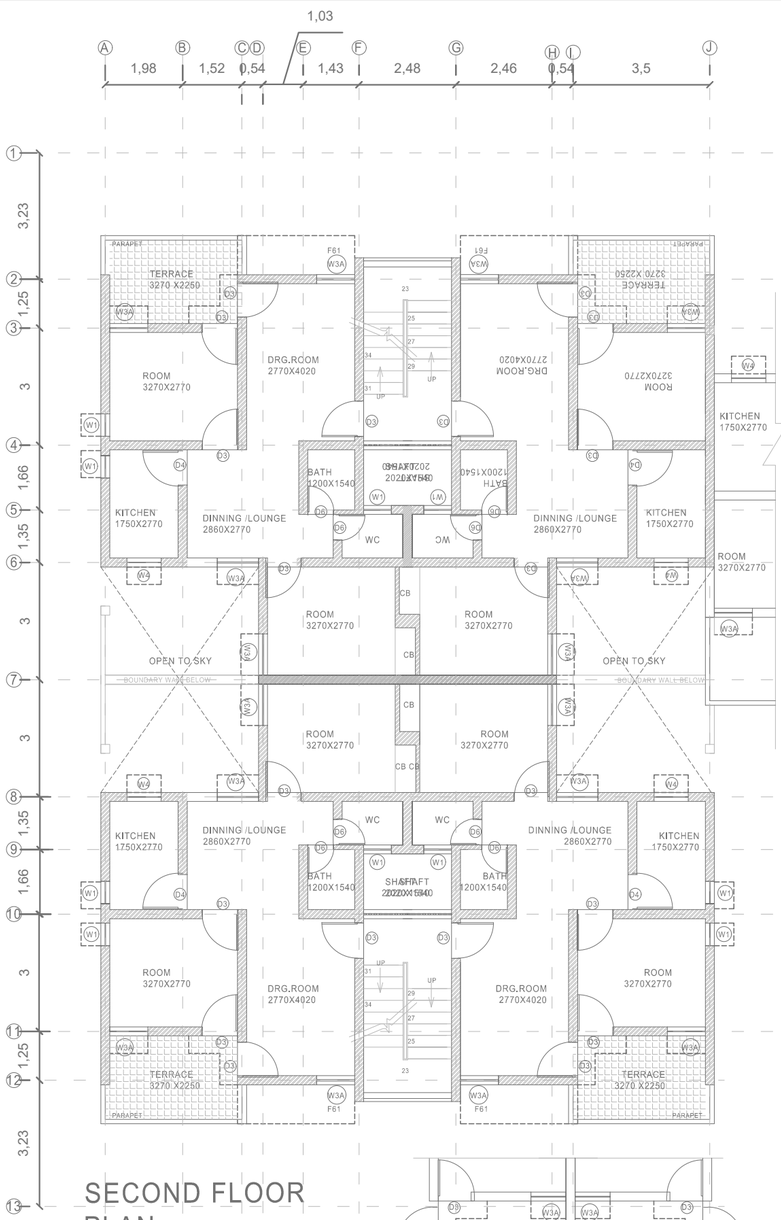

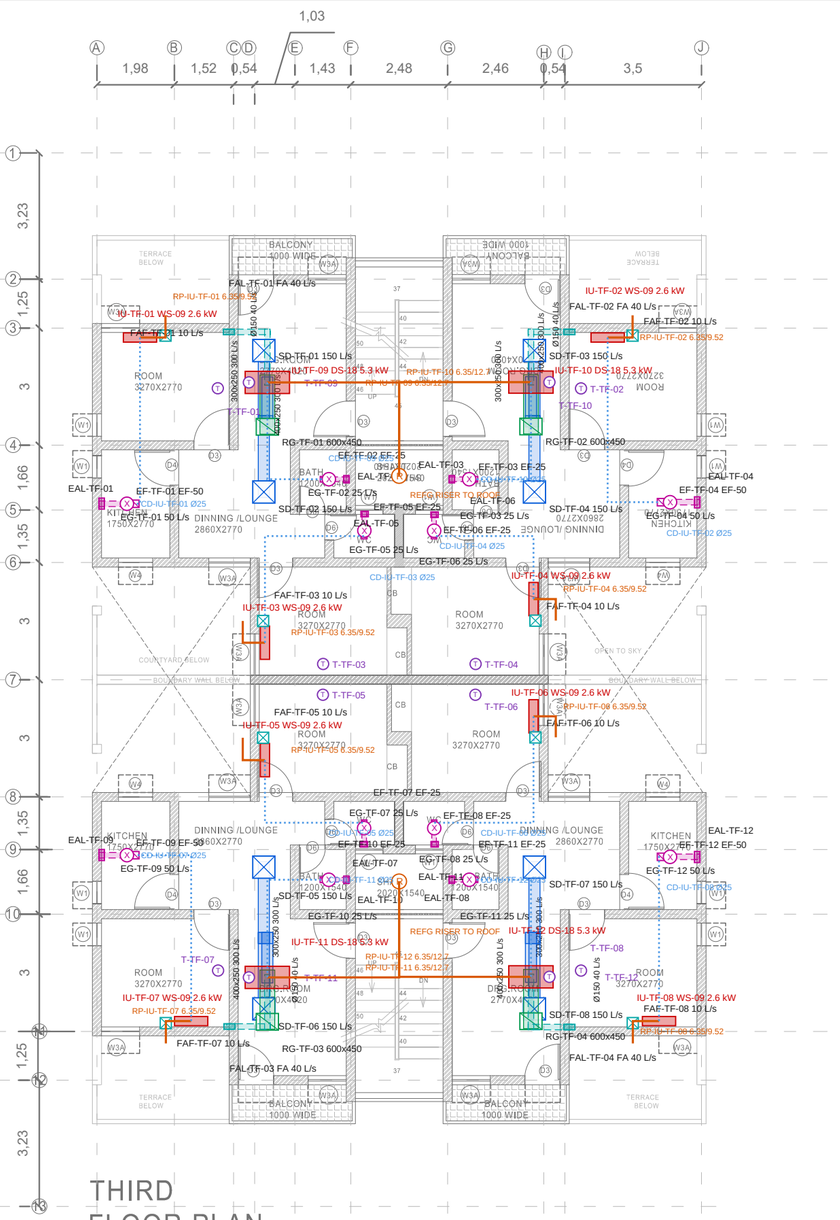

DDA

HOUSING & URBAN PROJECTS WING

DATE :21.07.1980

NOTE :
THE MODIFICATIONS IN THE DRG. HAS DONE AS DISCUSSED WITH SA VIDE LETTER NO.ACE/D/III/S.D/9/E$_{137}$ DATED 23.09.83

NOTES:-
THIS DRAWING HAS BEEN DIGITALIZED IN THE AUTOCADD VERSION FROM DWG NO. ___NIL_____. SCHEME NO._182A_ DATED -21.07.1980

SCHEDULE OF DOORS AND WINDOWS

S.NO.	TYPE		SHUTTER SIZE	OPENINGS
1	D3	DOOR	900X2020	950X250
2	D4	DOOR	900X2020	850X2050
3	D6	DOOR	650X2020	700X2050
4	W1	WINDOW	575X875	600X900
5	W2	WINDOW	575X1175	600X1200
6	W3A	WINDOW	975X1175	100X1200
7	W4	WINDOW	975X1175	100X1200
8	W3B	WINDOW	925X1175	950X1200
9	FG1	VENTILATOR	975X425	100X450

S.NO	LAYOUT NO	DESCRIPTION	AREA (HAC)	TOTAL DUS
1	159 L/8R1	PITAMPURA (D&P)	5.36	680
2	157/L/1R3	SHALIMAR BHAGH (P)	4.50	6.80
3	182 L/2	DILSHAD GARDEN	9M	1388
4	160 L/A	PASHCHIM PURI	1.60	224
5	191-L/3	JAHANGIRPURI	4.12	656

PROJECT TITLE :
STANDARD DESIGN FOR MIG HOUSING

SHEET TITLE :
SECOND AND THIRD FLOOR PLANS

DRG. NO. I
Sch.no. 182A

ARCH. ASSTT.	ASSTT. DIR.	DEPUTY DIRECTOR
SR. ARCHITECT	ADD. CH. ARCH.	CHIEF ARCH.

DATE : DEC.2021 | SCALE : 1:50

DIGITIZED BY

ARCH. ASSTT.	ASSTT. ARCH.	ARCHITECT
SR. ARCHITECT	ADD. CH. ARCH.	CHIEF ARCH.

UPHW
HOUSING & URBAN PROJECT WING,
OFFICE OF THE SR. ARCHITECT,
EAST ZONE, VIKAS MINAR, D.D.A.

PRELIMINARY DESIGN - FOR COORDINATION ONLY. To be checked and stamped by a qualified HVAC engineer before construction.

HVAC LAYOUT - THIRD FLOOR

N

North 0° from page-up
Scale 1:139 (as architectural sheet)

LEGEND

- Supply duct (size, flow) / flex dashed
- Supply diffuser SD
- Return duct
- Return grille RG
- Fresh air duct / louver FAL
- Exhaust duct / grille EG / fan EF
- Refrigerant pipe (liquid/gas mm)
- Condensate drain
- Chilled water pipe
- Indoor / outdoor unit
- Thermostat / controller

EQUIPMENT ON THIS SHEET


IU-TF-01 WS-09 2.6 kW 140 L/s Z-TF-01
IU-TF-02 WS-09 2.6 kW 140 L/s Z-TF-02
IU-TF-03 WS-09 2.6 kW 140 L/s Z-TF-03
IU-TF-04 WS-09 2.6 kW 140 L/s Z-TF-04
IU-TF-05 WS-09 2.6 kW 140 L/s Z-TF-05
IU-TF-06 WS-09 2.6 kW 140 L/s Z-TF-06
IU-TF-07 WS-09 2.6 kW 140 L/s Z-TF-07
IU-TF-08 WS-09 2.6 kW 140 L/s Z-TF-08
IU-TF-09 DS-18 5.3 kW 300 L/s Z-TF-09
IU-TF-10 DS-18 5.3 kW 300 L/s Z-TF-10
IU-TF-11 DS-18 5.3 kW 300 L/s Z-TF-11
IU-TF-12 DS-18 5.3 kW 300 L/s Z-TF-12
ODU-38 WS-O-09 2.6 kW serves IU-TF-01
ODU-39 WS-O-09 2.6 kW serves IU-TF-02
ODU-40 WS-O-09 2.6 kW serves IU-TF-03
ODU-41 WS-O-09 2.6 kW serves IU-TF-04
ODU-42 WS-O-09 2.6 kW serves IU-TF-05
ODU-43 WS-O-09 2.6 kW serves IU-TF-06
ODU-44 WS-O-09 2.6 kW serves IU-TF-07
ODU-45 WS-O-09 2.6 kW serves IU-TF-08
EF-TF-01 EF-50 50 L/s TF-07
EF-TF-02 EF-25 25 L/s TF-09
EF-TF-03 EF-25 25 L/s TF-11
EF-TF-04 EF-50 50 L/s TF-13
EF-TF-05 EF-25 25 L/s TF-14
EF-TF-06 EF-25 25 L/s TF-15
EF-TF-07 EF-25 25 L/s TF-19
EF-TF-08 EF-25 25 L/s TF-20
EF-TF-09 EF-50 50 L/s TF-22
EF-TF-10 EF-25 25 L/s TF-24
EF-TF-11 EF-25 25 L/s TF-26
EF-TF-12 EF-50 50 L/s TF-28

NOTES

- Duct sizes W x H mm (clear internal); Ø = round.
- Ducts at high level in ceiling void; coordinate with beams.
- Door undercut 20 mm / transfer grilles for return air.
- Refrigerant/condensate routes are indicative.

PROJECT: DDA MIG Housing Scheme 182A (test run under H
LOCATION: Riyadh, Saudi Arabia
SHEET: HVAC LAYOUT - Third Floor
SHEET NO. M-104 REV P0 2026-10-15
SCALE: 1:139 CODES: Saudi Building Code + ASHRAE
PREPARED WITH hvac-designer skill (automated)

PRELIMINARY DESIGN - FOR COORDINATION ONLY. To be checked and stamped by a qualified HVAC engineer before construction.

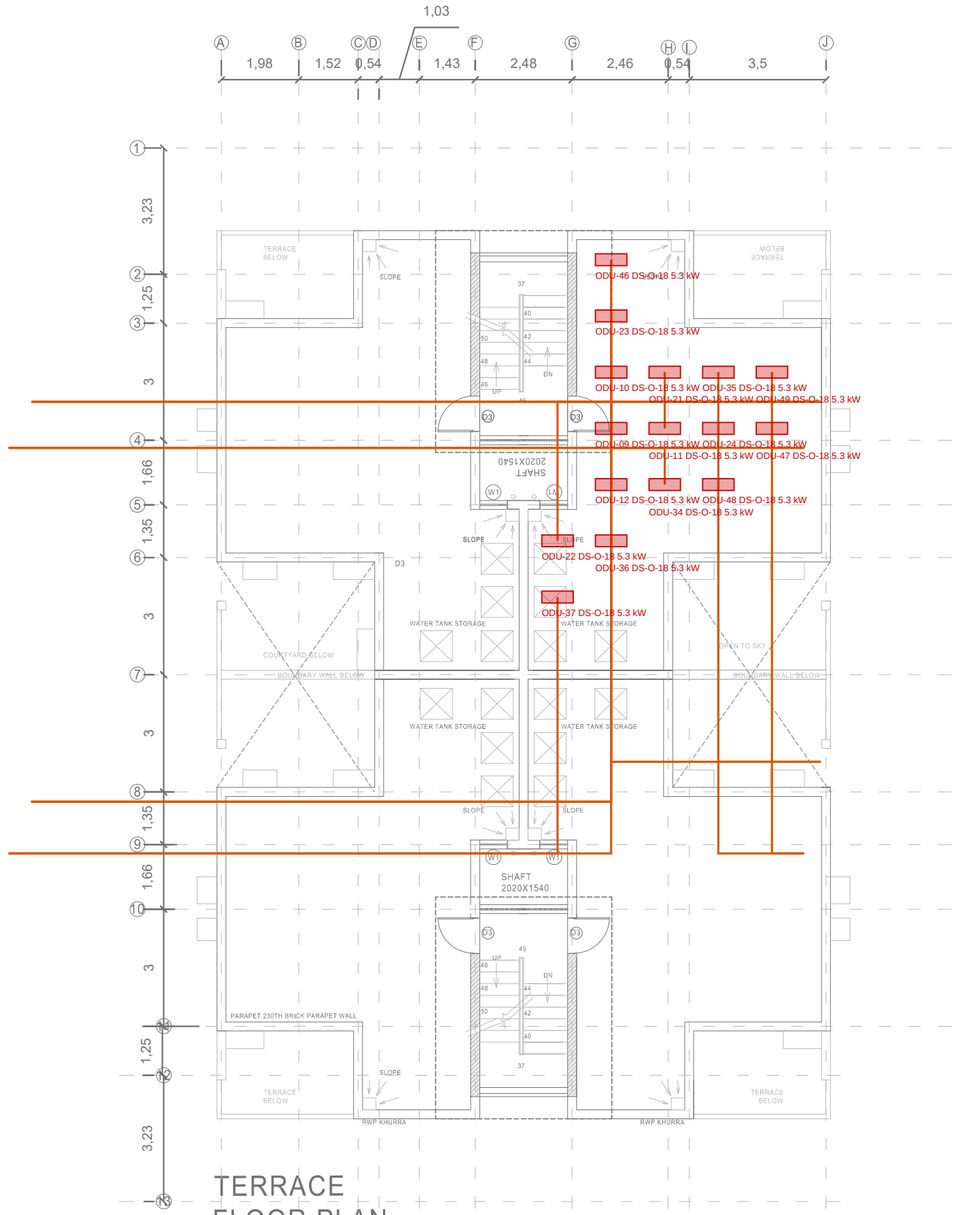

TERRACE FLOOR PLAN

DDA

HOUSING & URBAN PROJECTS WING

DATE :21.07.1980

NOTE :
THE MODIFICATIONS IN THE DRG. HAS DONE AS DISCUSSED WITH SA VIDE LETTER NO.ACE/D/III/S.D/9/E$\frac{2}{107}$ DATED 23.09.83

NOTES:-
THIS DRAWING HAS BEEN DIGITALIZED IN THE AUTOCADD VERSION FROM DWG NO. ___NIL___, SCHEME NO._182A_ DATED -23.07.1980

PROJECT TITLE :
STANDARD DESIGN FOR MIG HOUSING

SHEET TITLE :
TERRACE FLOOR PLAN

DRG. NO. 3

Sch.no. 182A

ARCH. ASSTT.	ASSTT. DIR.	DEPUTY DIRECTOR
SR. ARCHITECT	ADD. CH. ARCH.	CHIEF ARCH.

DIGITIZED BY

ARCH. ASSTT.	ASSTT. ARCH.	ARCHITECT
SR. ARCHITECT	ADD. CH. ARCH.	CHIEF ARCH.

DATE : DEC.2021 SCALE : 1:50

HOUSING & URBAN PROJECT WING, OFFICE OF THE SR. ARCHITECT, EAST ZONE, VIKAS MINAR, D.D.A.

HVAC LAYOUT - ROOF

N

North 0° from page-up
Scale 1:139 (as architectural sheet)

LEGEND

- Supply duct (size, flow) / flex dashed
- Supply diffuser SD
- Return duct
- Return grille RG
- Fresh air duct / louver FAL
- Exhaust duct / grille EG / fan EF
- Refrigerant pipe (liquid/gas mm)
- Condensate drain
- Chilled water pipe
- Indoor / outdoor unit
- Thermostat / controller

EQUIPMENT ON THIS SHEET

ODU-09 DS-O-18 5.3 kW serves IU-GF-09
ODU-10 DS-O-18 5.3 kW serves IU-GF-10
ODU-11 DS-O-18 5.3 kW serves IU-GF-11
ODU-12 DS-O-18 5.3 kW serves IU-GF-12
ODU-21 DS-O-18 5.3 kW serves IU-FF-09
ODU-22 DS-O-18 5.3 kW serves IU-FF-10
ODU-23 DS-O-18 5.3 kW serves IU-FF-11
ODU-24 DS-O-18 5.3 kW serves IU-FF-12
ODU-34 DS-O-18 5.3 kW serves IU-SF-10
ODU-35 DS-O-18 5.3 kW serves IU-SF-11
ODU-36 DS-O-18 5.3 kW serves IU-SF-12
ODU-37 DS-O-18 5.3 kW serves IU-SF-13
ODU-46 DS-O-18 5.3 kW serves IU-TF-09
ODU-47 DS-O-18 5.3 kW serves IU-TF-10
ODU-48 DS-O-18 5.3 kW serves IU-TF-11
ODU-49 DS-O-18 5.3 kW serves IU-TF-12

NOTES

- Duct sizes W x H mm (clear internal); Ø = round.
- Ducts at high level in ceiling void; coordinate with beams.
- Door undercut 20 mm / transfer grilles for return air.
- Refrigerant/condensate routes are indicative.

PROJECT: DDA MIG Housing Scheme 182A (test run under H
LOCATION: Riyadh, Saudi Arabia
SHEET: HVAC LAYOUT - Roof
SHEET NO. M-105 REV P0 2026-10-15
SCALE: 1:139 CODES: Saudi Building Code + ASHRAE
PREPARED WITH hvac-designer skill (automated)

PRELIMINARY DESIGN - FOR COORDINATION ONLY. To be checked and stamped by a qualified HVAC engineer before construction.

PRELIMINARY DESIGN - FOR COORDINATION ONLY. To be checked and stamped by a qualified HVAC engineer before construction.

HVAC CONTROLS SCHEMATIC AND EQUIPMENT SCHEDULE

T-GF-01 wired controller in GF-02 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-01 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-GF-01	power + comm.	ODU-01 WS-O-09 outdoor - GF		FAF-GF-01 through-wall FA fan interlocked with IU-GF-01
T-GF-02 wired controller in GF-03 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-02 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-GF-02	power + comm.	ODU-02 WS-O-09 outdoor - GF		FAF-GF-02 through-wall FA fan interlocked with IU-GF-02
T-GF-03 wired controller in GF-11 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-03 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-GF-03	power + comm.	ODU-03 WS-O-09 outdoor - GF		FAF-GF-03 through-wall FA fan interlocked with IU-GF-03
T-GF-04 wired controller in GF-14 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-04 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-GF-04	power + comm.	ODU-04 WS-O-09 outdoor - GF		FAF-GF-04 through-wall FA fan interlocked with IU-GF-04
T-GF-05 wired controller in GF-15 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-05 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-GF-05	power + comm.	ODU-05 WS-O-09 outdoor - GF		FAF-GF-05 through-wall FA fan interlocked with IU-GF-05
T-GF-06 wired controller in GF-24 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-06 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-GF-06	power + comm.	ODU-06 WS-O-09 outdoor - GF		FAF-GF-06 through-wall FA fan interlocked with IU-GF-06
T-GF-07 wired controller in GF-27 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-07 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-GF-07	power + comm.	ODU-07 WS-O-09 outdoor - GF		FAF-GF-07 through-wall FA fan interlocked with IU-GF-07
T-GF-08 wired controller in GF-38 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-08 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-GF-08	power + comm.	ODU-08 WS-O-09 outdoor - GF		FAF-GF-08 through-wall FA fan interlocked with IU-GF-08
T-GF-09 wired programmable thermostat in GF-25 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-09 DS-18 (ducted_split) 5.3 kW, 300 L/s - zone Z-GF-09	power + comm.	ODU-09 DS-O-18 outdoor - RF		Motorised FA damper interlocked to IU-GF-09 fan (open when fan runs; closed when off) - 32 L/s
T-GF-10 wired programmable thermostat in GF-26 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-10 DS-18 (ducted_split) 5.3 kW, 300 L/s - zone Z-GF-10	power + comm.	ODU-10 DS-O-18 outdoor - RF		Motorised FA damper interlocked to IU-GF-10 fan (open when fan runs; closed when off) - 32 L/s
T-GF-11 wired programmable thermostat in GF-31 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-11 DS-18 (ducted_split) 5.3 kW, 300 L/s - zone Z-GF-11	power + comm.	ODU-11 DS-O-18 outdoor - RF		Motorised FA damper interlocked to IU-GF-11 fan (open when fan runs; closed when off) - 32 L/s
T-GF-12 wired programmable thermostat in GF-32 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-GF-12 DS-18 (ducted_split) 5.3 kW, 300 L/s - zone Z-GF-12	power + comm.	ODU-12 DS-O-18 outdoor - RF		Motorised FA damper interlocked to IU-GF-12 fan (open when fan runs; closed when off) - 32 L/s
T-FF-01 wired controller in FF-03 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-FF-01 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-FF-01	power + comm.	ODU-13 WS-O-09 outdoor - FF		FAF-FF-01 through-wall FA fan interlocked with IU-FF-01
T-FF-02 wired controller in FF-06 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-FF-02 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-FF-02	power + comm.	ODU-14 WS-O-09 outdoor - FF		FAF-FF-02 through-wall FA fan interlocked with IU-FF-02
T-FF-03 wired controller in FF-14 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-FF-03 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-FF-03	power + comm.	ODU-15 WS-O-09 outdoor - FF		FAF-FF-03 through-wall FA fan interlocked with IU-FF-03
T-FF-04 wired controller in FF-15 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-FF-04 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-FF-04	power + comm.	ODU-16 WS-O-09 outdoor - FF		FAF-FF-04 through-wall FA fan interlocked with IU-FF-04
T-FF-05 wired controller in FF-16 - setpoint 24 °C, fan auto/low/med/high	2-core comm.	IU-FF-05 WS-09 (wall_split) 2.6 kW, 140 L/s - zone Z-FF-05	power + comm.	ODU-17 WS-O-09 outdoor - FF		FAF-FF-05 through-wall FA fan interlocked with IU-FF-05

PROJECT: DDA MIG Housing Scheme 182A (test run under KSA codes

LOCATION: Riyadh, Saudi Arabia

SHEET: CONTROLS SCHEMATIC & SCHEDULE

SHEET NO. M-901 REV P0 2026-10-15

SCALE: NTS CODES: Saudi Building Code + ASHRAE

PREPARED WITH hvac-designer skill (automated)

PRELIMINARY DESIGN - FOR COORDINATION ONLY. To be checked and stamped by a qualified HVAC engineer before construction.